


LIST OF MATERIAL

ITEM	DESCRIPTION
1	DOUBLE CHECK BACKFLOW PREVENTION DEVICE, USC APPROVED TYPE (SEE SECTION 5-01)
2	BRASS UNION
3	RISER, NIPPLES, ELBOW - BRASS OR COPPER
4	90° ELBOW - BRASS OR COPPER
5	PIPE/FITTING IN CONTACT WITH CONCRETE WILL BE WRAPPED TO PREVENT DETERIORATION

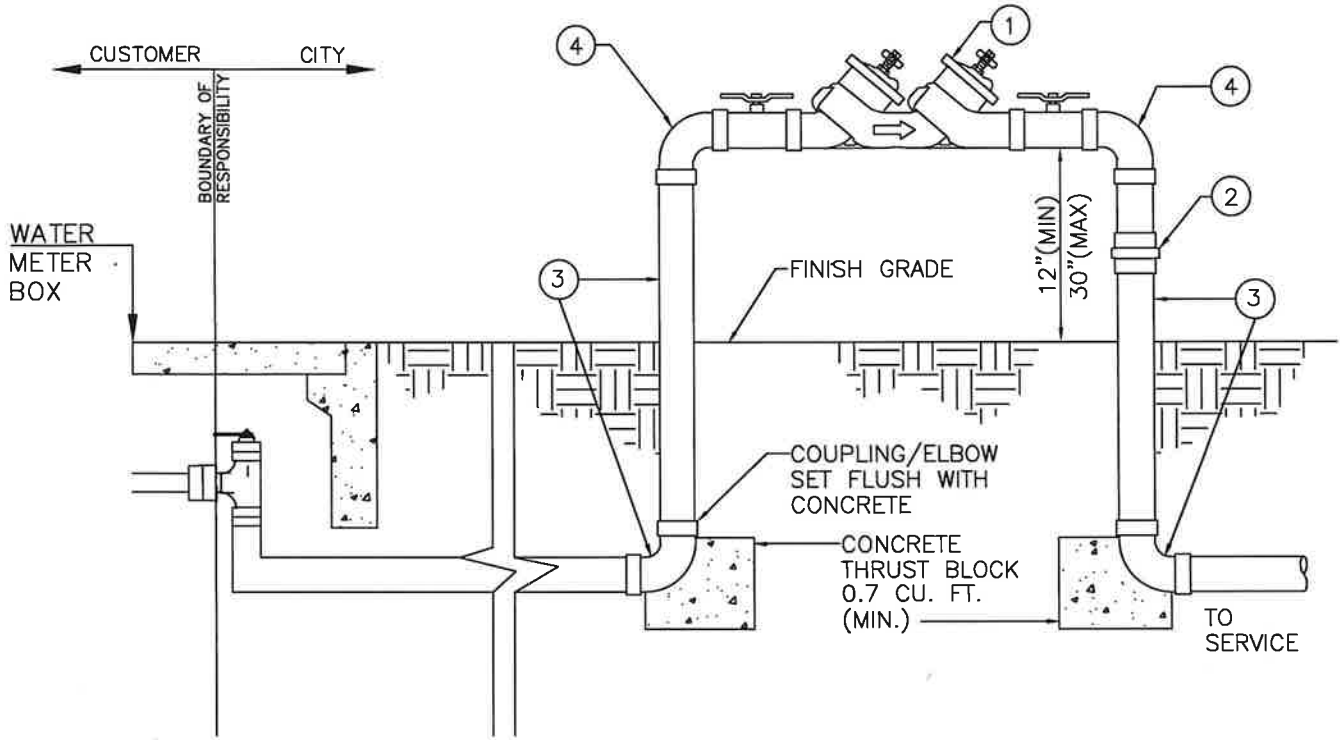

NOTES:

1. THE BACKFLOW PREVENTION ASSEMBLY SHALL CONSIST OF AN APPROVED DOUBLE CHECK ASSEMBLY. THE DEVICE SHALL BE LEAD FREE FOR DOMESTIC SERVICE.
2. LOCATION AND INSTALLATION SHALL BE PER PLAN AS SUBMITTED TO AND APPROVED BY THE UTILITY.
3. NO CONNECTIONS TO BE MADE BETWEEN METER AND BACKFLOW PREVENTER.
4. BACKFLOW DEVICE SHALL NOT BE LOCATED WITHIN THE PUBLIC RIGHT OF WAY (ROW) AND SHALL BE OUTSIDE OF THE SETBACK AREA (TYPICALLY 5-FT MIN. FROM ROW). UNLESS OTHERWISE APPROVED BY PLANNING DEPT.
5. SECURITY ENCLOSURE (OPTIONAL) SHALL BE AS SPECIFIED PER PROJECT PLAN OR AS DIRECTED BY THE UTILITY. ENCLOSURE WITH HEIGHT GREATER THAN 36" SHALL BE SUBMITTED FOR APPROVAL BY THE PLANNING DEPARTMENT.

3/4 INCH THROUGH 2 INCH DOUBLE CHECK BACKFLOW PREVENTION ASSEMBLY

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-103

DRAWN	BY AM	DATE 09/26/24	APPROVED WATER UTILITY MANAGER	DATE 12/10/24
REVISED			APPROVED CITY ENGINEER	DATE 12/11/24
CHANGED				

SHEET 1 OF 1