


PLAN VIEW
NO SCALE

CITY TO APPROVE SIDE WALL CLEARANCE
MINIMUM 12" CLEARANCE

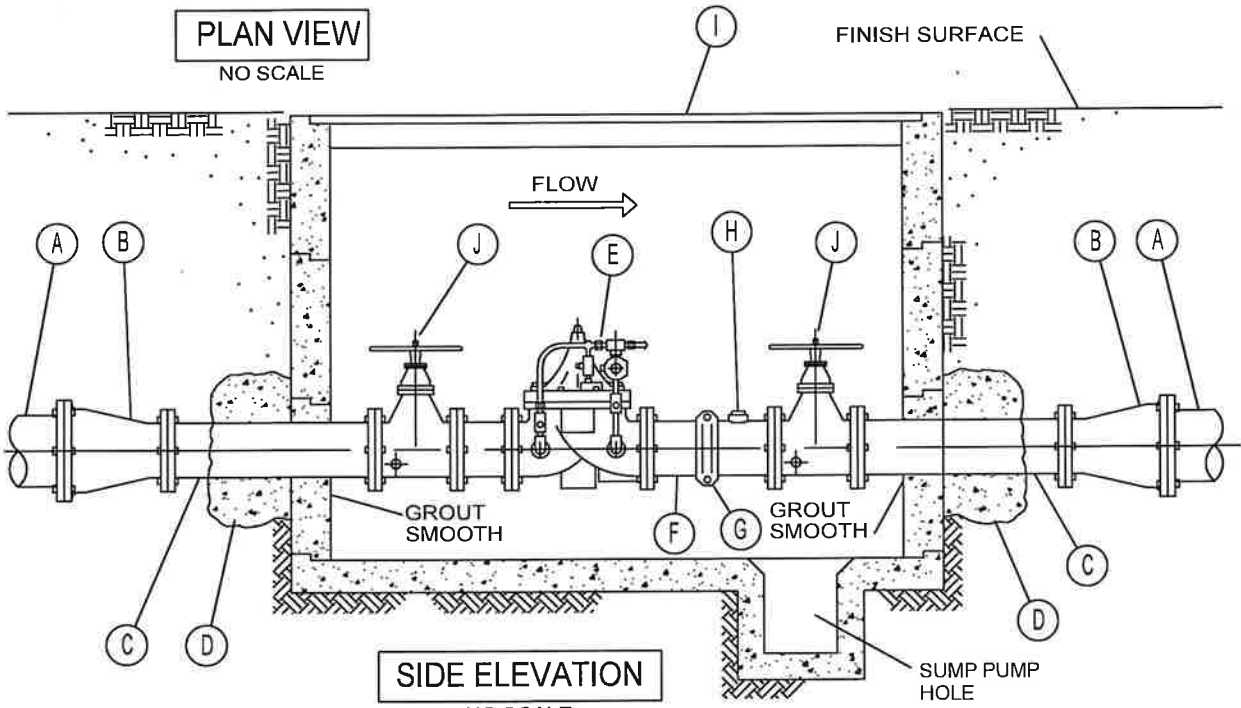

SIDE ELEVATION
NO SCALE

LEGEND

A 6" CLASS 350 DUCTILE IRON PIPE, MIN. 3' EACH SIDE INST TRANS CPLG AS REQUIRED	F 4" D.I. SPOOL CUT IN HALF
B B 6" PO WITH FIELD LOCK GASKET X 4" FLG. REDUCER OR 6" M.J. W/ MEGALUG RESTRAINTS X 4" FLANGE REDUCER	G FLEX. CPLG.
C 4" DIP CLASS 350 SPOOL	H 1" TAP WITH PLUG, DOUBLE STRAP CC SADDLE WITH 1" TAP WITH 1" M.I.P. X F.I.P. BALL VALVE WITH LOCK WINGS
D CONCRETE THRUST BLOCK (MUST BE SET IN UNDISTURBED SOIL)	I CONSULT WATER DIVISION FOR SIZE AND MAKE PER JOB
E 4" PRESS. RED. VLV. CLA-VAL OR APPROVED EQUAL CONSULT WATER DIV. FOR APPLICATION AND PART NUMBER	J 4" FLG RESILIENT WEDGE GATE VALVE WITH HANDWHEEL AFC SERIES 2500 WITH STAINLESS STEEL TRIM KIT

PRESSURE REGULATING VAULTS

CITY OF MONTEREY PARK
PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.
W-210

DRAWN	BY AM	DATE 10/02/24	APPROVED WATER UTILITY MANAGER	DATE 12/10/24
REVISD	DZ	10/02/24		
CHANGED	XX	XX/XX/XX	APPROVED CITY ENGINEER	DATE 12/11/24

SHEET 1 OF 1