


LIST OF MATERIAL

ITEM	DESCRIPTION
1	TEE (PIPE SIZE BY 2" OUTLET), FLANGED
2	GATE VALVE (PIPE SIZE), RESILIENT WEDGE, FLANGED, N.R.S. W/ HAND WHEEL PER SECTION 2-05.01
3	METER (SEE SECTION 4-01)
4	STRAINER
5	FLG. X P.E. SPOOL
6	FLANGE ADAPTER PER SECTION 2-09.04
7	90° BENDS, FLANGED (2TYP.)
8	2" BRASS NIPPLE, HEX
9	2" BALL VALVE, FULL OPENING, BRASS, IPS THREAD
10	2" BRASS PLUG, IPS THREAD
11	REDUCER, FLANGED
12	COMPANION FLANGE WITH 2" IPS THREAD
13	FLAT PIPE SUPPORT (2 TYP.) PER STD. NO. W-270

METER SIZE	PAD LENGTH	DIMENSIONS						
		A	B	C	D	E	F	G
3"	7'-2"	55"	8"	6"	12"	11"	6.5"	9"
4"	7'-9"	62.5"	9"	7 1/2"	14"	13"	6.5"	9"
6"	9'-2"	74"	10 1/2"	9"	18"	16"	8"	10"

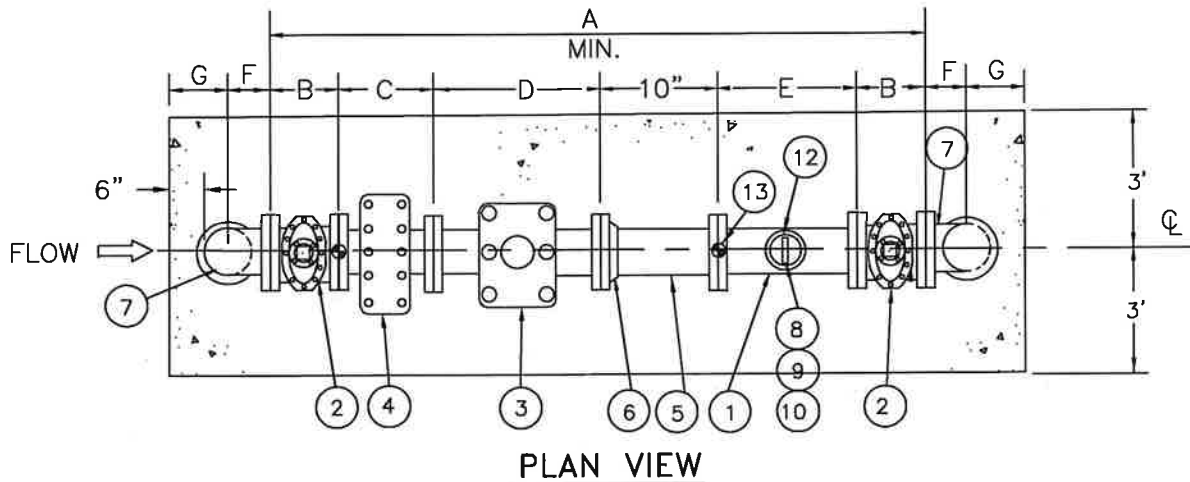

3", 4" AND 6" IRRIGATION METER - ABOVE GROUND ASSEMBLY

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-250A

	BY	DATE
DRAWN	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED WATER UTILITY MANAGER	<i>[Signature]</i>	DATE	12/10/24
APPROVED CITY ENGINEER	<i>[Signature]</i>	DATE	12/11/24

SHEET 1 OF 2

NOTES:

1. ALL PIPE SHALL BE DUCTILE IRON PER SECTION 2-01.
2. ALL PIPE FITTINGS AND APPURTENANCES (GASKETS, NUTS, BOLTS, ADAPTER) SHALL BE PER SECTION 2-08.
3. THE COMPLETED ASSEMBLY SHALL BE PAINTED PER SECTION 2-14.
4. CONCRETE PAD SHALL BE MINIMUM 4-INCH THICK, SIZE AS INDICATED HEREIN. CONCRETE SHALL BE CLASS 520-C-2500.
5. A BACKFLOW PREVENTION DEVICE SHALL BE INSTALLED IN ACCORDANCE WITH SECTION 5-01.

3",4" AND 6" IRRIGATION METER - ABOVE GROUND ASSEMBLY

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-250A

DRAWN	BY AM	DATE 10/02/24	APPROVED WATER UTILITY MANAGER		DATE 12/10/24
REVISED	DZ	10/02/24			
CHANGED	XX	XX/XX/XX	APPROVED CITY ENGINEER		DATE 12/11/24

SHEET 2 OF 2