



WATER SERVICES STANDARD SPECIFICATIONS

DECEMBER 2024


CITY OF MONTEREY PARK
PUBLIC WORKS DEPARTMENT
Water/Engineering Division

320 W. Newmark Avenue
Monterey Park, CA 91754
Engineering (626) 307-1320, Water (626) 307-1293 | www.montereypark.ca.gov

CITY OF MONTEREY PARK
PUBLIC WORKS DEPARTMENT
WATER AND ENGINEERING
DIVISIONs

**STANDARD SPECIFICATIONS
FOR
CONSTRUCTION OF WATER SYSTEMS**

Approved By: _____

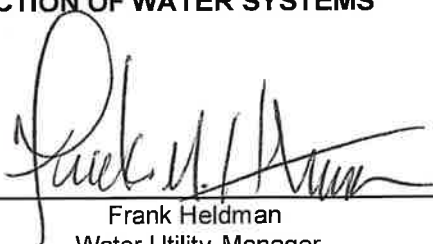

Frank Heldman
Water Utility Manager

Approved By: _____



Shawn Igoe
Director of Public Works

INTRODUCTION

These Standard Specifications are to be used as a guide by Private Engineers and Contractors in the design and installation of additions or modifications to the City of Monterey Park's Public Water System.

It is the intent that these Standard Specifications will provide uniformity in materials and installation of piping, valves, fire hydrants, service laterals and other appurtenant equipment. The Standard Specifications will also provide for construction methods and controls to be used by Contractors to construct, pressure test, chlorinate and place into service domestic water systems in the City of Monterey Park.

Table of Contents

SECTION 1	GENERAL PROVISIONS	1-1
1-01	PLANS AND SPECIFICATIONS	1-1
1-02	DEFINITIONS	1-2
1-03	ABBREVIATIONS	1-3
SECTION 2	MATERIALS	2-1
2-00	GENERAL	2-1
2-00.01	PROTECTION OF METAL SURFACES	2-1
2-01	DUCTILE IRON PIPE	2-1
2-01.01	GENERAL	2-1
2-01.02	PIPE JOINTS	2-1
2-01.03	COATING AND LINING	2-1
2-01.04	POLYETHYLENE PROTECTIVE WRAPPING	2-1
2-02	POLYVINYL CHLORIDE PIPE	2-2
2-02.01	GENERAL	2-2
2-02.02	PIPE JOINTS	2-2
2-02.03	FITTINGS	2-3
2-02.04	INSTALLATION CURVATURE	2-3
2-02.05	TRACER WIRE AND WARNING TAPE	2-3
2-03	COPPER TUBING	2-10
2-03.01	GENERAL	2-10
2-03.02	DIMENSIONS	2-10
2-03.03	TEMPER	2-10
2-04	RED BRASS PIPE	2-10
2-05	MAIN LINE VALVES	2-10
2-05.01	GATE VALVES	2-10
2-05.02	BUTTERFLY VALVES	2-11
2-05.03	END CONNECTIONS AND GASKET MATERIAL	2-12
2-06	AIR AND VACUUM, AIR RELEASE AND COMBINATION AIR VALVES	2-13
2-07	FIRE HYDRANTS	2-13
2-07.01	GENERAL	2-13

2-07.02 MATERIALS AND PARTS.....	2-13
2-07.03 APPROVED FIRE HYDRANT MANUFACTURERS	2-14
2-08 MAIN LINE PIPE FITTINGS.....	2-14
2-08.01 GENERAL	2-14
2-08.02 END CONNECTIONS	2-14
2-08.03 GASKETS.....	2-14
2-08.04 BOLTS AND NUTS FOR MECHANICAL JOINTS AND FLANGED FITTINGS	2-15
2-08.05 TAPPING SLEEVES.....	2-15
2-09 MAIN LINE COUPLINGS	2-17
2-09.01 SLEEVE TYPE COUPLINGS.....	2-17
2-09.02 MECHANICAL GROOVED-TYPE COUPLINGS	2-18
2-09.03 DISMANTLING JOINTS.....	2-18
2-09.04 FLANGE ADAPTERS.....	2-18
2-10 SERVICE LATERAL INSTALLATION	2-19
2-10.01 GENERAL	2-19
2-10.02 FITTINGS	2-19
2-10.03 SERVICE SADDLES.....	2-20
2-10.04 METER BOXES	2-21
2-11 WATER METERS	2-21
2-12 THRUST RESTRAINING MATERIALS.....	2-22
2-12.01 MECHANICAL JOINT RESTRAINT	2-22
2-12.02 PUSH-ON PIPE BELL RESTRAINTS.....	2-23
2-12.03 CONCRETE.....	2-23
2-13 SHOP DRAWING AND MATERIAL SUBMITTALS	2-23
2-14 PAINTING - ABOVE GROUND INSTALLATIONS.....	2-23
2-15 ACCESS TO MANUFACTURING AND TEST FACILITIES	2-24
SECTION 3 CONSTRUCTION METHODS AND CONTROL	3-1
3-01 INSPECTION	3-1
3-02 PRE-CONSTRUCTION DETAILS.....	3-2
3-02.01 LICENSES AND PERMITS.....	3-2
3-02.02 TRAFFIC CONTROL	3-2

- 3-02.03 SURVEYING 3-2
- 3-02.04 POLLUTION PREVENTION & BEST MANAGEMENT PRACTICES 3-3
- 3-03 REMOVALS AND TRENCH EXCAVATION3-3
 - 3-03.01 REMOVAL OF PAVEMENT..... 3-3
 - 3-03.02 REMOVAL OF UTILITIES..... 3-3
 - 3-03.03 TRENCH EXCAVATION..... 3-3
- 3-04 CONNECTION TO EXISTING FACILITIES3-4
 - 3-04.01 GENERAL 3-4
 - 3-04.02 PRESSURE TAPPING..... 3-5
 - 3-04.03 SHUTDOWN OF MAIN..... 3-5
- 3-05 LAYING OF DUCTILE IRON PIPE WATER MAIN3-6
 - 3-05.01 GENERAL 3-6
 - 3-05.02 THRUST RESTRAINT..... 3-6
 - 3-05.03 STANDARD ASSEMBLIES..... 3-6
 - 3-05.04 PROTECTION AND CLEANING OF PIPE AND FITTINGS 3-7
 - 3-05.05 HANDLING PIPE AND OTHER MATERIALS 3-7
 - 3-05.06 PROTECTION OF METAL SURFACES..... 3-7
- 3-06 LAYING OF PVC AND PVCO PIPE WATER MAIN.....3-7
- 3-07 SERVICE LATERALS3-8
 - 3-07.01 GENERAL 3-8
 - 3-07.02 ABANDONMENT OF SERVICES..... 3-9
 - 3-07.03 IRRIGATION SERVICES 3-9
- 3-08 INSTALLATION OF PIPE BEDDING, PIPE ZONE AND TRENCH BACKFILL3-10
- 3-09 REPAVING AND FINISHING 3-11
- 3-10 TESTING, DISINFECTION AND FLUSHING 3-11
 - 3-10.01 GENERAL 3-11
 - 3-10.02 HYDROSTATIC PRESSURE TESTING 3-12
 - 3-10.03 DISINFECTION 3-14
 - 3-10.04 DISPOSAL OF TEST WATER 3-17
- 3-11 SPECIAL CONDITIONS3-19
 - 3-11.01 SHEETING AND SHORING..... 3-19

3-11.02 JACKING OF STEEL CASING	3-19
3-11.03 POLYETHYLENE PROTECTIVE WRAPPING.....	3-19
3-12 DEDICATION OF IMPROVEMENTS TO THE CITY	3-20
3-13 AS-BUILT DRAWINGS	3-21
SECTION 4 LARGE SERVICES AND FIRE LINES	4-1
4-00 GENERAL	4-1
4-01 METERS	4-1
4-02 VAULT INSTALLATIONS.....	4-2
4-03 THRUST RESTRAINT - VAULT INSTALLATION.....	4-2
4-04 PAINTING - ABOVE GROUND INSTALLATIONS.....	4-2
SECTION 5 BACKFLOW PREVENTION	5-1
5-01 BACKFLOW PROTECTION	5-1
5-02 FIRE LINE ASSEMBLY.....	5-1
5-03 BACKFLOW PREVENTION DEVICES – TESTING AND MAINTENANCE.....	5-2
5-04 SINGLE CHECK DETECTOR ASSEMBLY	5-2
SECTION 6 STANDARD DRAWINGS.....	6-1
W-630 Destruction of Abandoned Water We	6-2

SECTION 1 GENERAL PROVISIONS

1-01 PLANS AND SPECIFICATIONS

Construction of all water system improvements intended to be dedicated to the City of Monterey Park's Public Water System will be governed by plans and specifications approved by the City. All plans and specifications must be prepared by, or under the supervision of a current registered civil engineer licensed to practice in the State of California. All work shall be subject to fees as provided for in the City's Water Rates, Rules and Regulations and shall be inspected by the City to ensure conformity to these specifications.

In cases of conflict of information, the following documents will have precedence in the order listed:

1. Permits and licenses from affected agencies issued for the improvements.
2. Special provisions for the improvements.
3. Construction plans for the improvements.
4. City of Monterey Park Public Works Water Services Standard Specifications (WSSS).
5. Latest edition of Standard Specifications for Public Works Construction (SSPWC).
6. Manufacturer's recommendations of product use and installation.

Conflicts and discrepancies noted by the Contractor shall be brought to the attention of the Engineer. The Engineer will review the conflicts or discrepancies and determine the appropriate course of action to follow, if any. Unless otherwise determined by the Engineer, the most stringent/restricted condition shall govern over all.

Provisions of reference specifications noted in these specifications and plans shall have the same effect as if written herein, unless expressly modified by these specifications. Any reference specification in the absence of designation to the contrary, shall be understood to refer to the latest revision at the time of the beginning of work.

1-02 DEFINITIONS

Whenever the following terms or corresponding pronouns are used in these specifications or plans, the intent and meaning shall be interpreted as follows:

- a. City: The City of Monterey Park, California.
- b. Engineer: The City Engineer or his authorized representative.
- c. Water Division: The Public Works Director, City of Monterey Park or his authorized representative.
- d. Developer: The person or organization having legal responsibility for construction of water systems in conjunction with development of property.
- e. Contractor: The agent of the developer or independent contractor who furnishes labor, material, equipment, method, etc. to perform the requirements of these specifications in the construction of water systems.
- f. Private Engineer: The agent of the developer or independent engineer who has responsibility for the design and drawing of construction documents.
- g. Or approved equal: An equivalent product to that specified in these standard specifications, approved by the Water Division before beginning of construction. No approved equal product is intended, unless so stated in these standard specifications.
- h. Construction Plans: The words "Construction Plans" or "Plans" or "Drawings" or "Contract Drawings" shall mean those drawings accompanying the specifications which show the location, nature, extent and form of the work, together with applicable details.

1-03 ABBREVIATIONS

Whenever the following abbreviations are used in these specifications, the meaning shall be interpreted as follows:

ANSI:	American National Standards Institute
ASTM:	American Society for Testing and Materials
AWWA:	American Water Works Association
CAL-OSHA:	California Occupational Safety and Health Administration
CBC:	California Building Code
CFC:	California Fire Code
CPC:	California Plumbing Code
DIPRA:	Ductile Iron Pipe Research Association
MS4:	Municipal Separate Storm Sewer System
NFPA:	National Fire Protection Association
NSF:	National Sanitation Foundation
EP:	Encroachment Permit (City of Monterey Park Public Works Department)
SCAQMD:	South Coast Air Quality Management District
SSPC:	Steel Structures Painting Council
SSPWC:	Standard Specifications for Public Works Construction (Green Book) - Latest Edition
UL:	Underwriters Laboratories
WSSS:	Water Services Standard Specifications (Monterey Park Department of Public Works Water Division)

SECTION 2 MATERIALS

2-00 GENERAL

All materials and equipment installed in City of Monterey Park's water system shall meet all state and federal standards, as well as standards developed by nationally recognized organizations such as AWWA, ANSI and NSF. In order to protect human health, all materials, chemicals, lubricants, and products in contact with drinking water shall be tested and certified as meeting NSF/ANSI standard 60 (Drinking Water Treatment Chemicals-Health Effects) and ANSI/NSF Standard 61 (Drinking Water System Components- Health Effects).

In addition, all materials coming in contact with potable water shall be lead-free per California Health & Safety Code Section 116875. All materials are required to be certified as lead-free by NSF or other ANSI accredited certifier per SB 1334.

2-00.01 PROTECTION OF METAL SURFACES

All buried metal surfaces including bolts, nuts, flanges, restraining devices, couplings and other appurtenances in contact with the earth and backfill materials shall be coated with a minimum 30 mils of JS160H Mastic manufactured by Protecto Wrap Co., 30 mils of Bituminous Mastic 50-HT by Water Division Coating Company, or approved equal.

Valves and fittings shall only require coating on bolts, nuts, and flanged or mechanical joint end connections.

In addition to the bituminous coating, all metal surfaces shall be encased in 8 mil polyethylene protective wrapping and tape wrapped to the pipe barrel in accordance with AWWA C105 and Sections 2-01.04 and 3-11.03.

2-00.01.1 CORROSIVE SOIL PROTECTION

For all construction areas where corrosive soil is determined to be present by the Water Division, in lieu of bitumastic coating, all buried metal surfaces including bolts, nuts, flanges, restraining devices, couplings and other appurtenances in contact with the earth and backfill materials shall be coated with a layer of Trenton Wax-Tape® Primer then wrapped with Trenton #1 Wax-Tape® and Trenton Poly-Ply™ outer wrap manufactured by The Trenton Corporation, Densyl Tape manufactured by Denso, Inc., or approved equal. Wax tape system shall be in accordance with AWWA C217.

Valves and fittings shall only require wax tape system on bolts, nuts, and flanged or mechanical joint end connections.

In addition to the wax tape system, all metal surfaces shall be encased in 8 mil polyethylene protective wrapping and tape wrapped to the pipe barrel in accordance with AWWA C105 and Sections 2-01.04 and 3-11.03

2-01 DUCTILE IRON PIPE

2-01.01 GENERAL

Ductile iron pipe shall conform to the requirements of AWWA Standard C151. Unless otherwise specified, size four-inch (4") through twelve-inch (12") shall be Thickness Class 52. Pipes larger than twelve-inch (12") shall be Thickness Class 51. Above ground pipe shall be Thickness Class 53.

Special order pipe sizes, such as fourteen-inch (14"), is not allowed unless otherwise authorized by Water Division.

2-01.02 PIPE JOINTS

Ductile iron pipe shall be furnished in eighteen-foot (18') or twenty-foot (20') nominal laying lengths and shall have a push-on joint employing a single rubber gasket in accordance with AWWA Standard C111, (TYTON JOINT® as manufactured by U.S. Pipe, Fastite Joint by AMERICAN Pipe, or approved equal). Push-on joints shall be restrained in accordance with the requirements of Section 2-12.02, unless otherwise indicated on the Drawings. Deflection at joints shall not exceed 4 degrees or 80% of the manufacturer's recommendation, whichever is less.

Above ground or exposed pipe joints shall be flanged or as indicated on the construction plans.

2-01.03 COATING AND LINING

All ductile iron pipe shall have the interior cement-mortar lined (double thickness-sizes 4" to 24") with a seal coat in accordance with AWWA Standard C104.

The exterior of ductile iron pipe and fittings shall be coated with a layer of arc-sprayed zinc per ISO 8179. The mass of the zinc applied shall be a minimum of 130 g/m² of pipe surface area. A finished layer of asphaltic topcoat per AWWA Standard C151 shall be applied to the zinc. The coating system shall conform in every respect to ISO 8179-1 "Ductile iron pipes, fittings, accessories and their joints – External zinc-based coating – Part 1: Metallic zinc with finishing layer."

2-01.04 POLYETHYLENE PROTECTIVE WRAPPING

All ductile iron pipe, pipe fittings, and valves shall be encased with Polyethylene Protective Wrapping.

Polyethylene protective wrapping ("Polywrap") shall conform to the requirements of ANSI/AWWA C105/A21.5 and be eight (8) mils thick tubing of virgin polyethylene or four (4) mil thick high-density, cross laminated (HDCL) polyethylene. The tubing shall be marked with legible print denoting the conformance to ANSI/AWWA C105.

Tubing shall be installed in accordance with AWWA C600 and taped and secured with general purpose polyethylene tape, 2 inches wide and 10 mils thick (Scotchrap™ 50, Protecto Wrap 200, Polyken 900, or approved equal)

2-02 POLYVINYL CHLORIDE PIPE

2-02.01 GENERAL

Polyvinyl Chlorine pipe shall conform to the requirements of AWWA Standard C900 "Polyvinyl Chloride (PVC) Pressure Pipe", Pressure Class 305 (DR 14), or AWWA Standard C909 "Molecularly Oriented Polyvinyl Chlorine (PVCO) Pressure Pipe", Pressure Class 305. Unless otherwise specified, PVC or PVCO pipe shall only be used for pipe sizes four-inch (4") through twelve-inch (12"). PVC or PVCO pipe for pipes larger than twelve-inch (12") shall require special approval by the Water Division.

All PVC and PVCO pipe shall be furnished in twenty-foot (20') nominal laying lengths and shall be colored blue. Tracer wire and warning tape are required on all PVC and PVCO installations per Sections 2-02.05 and 3-06.

PVC and PVCO pipe shall be legible and permanently marked in ink with the following information:

- Manufacturer and Trade Name
- Nominal Size and DR Rating/Pressure Class
- Hydrostatic Proof Test Pressure
- [NSF-61]
- Manufacturing Date Code

2-02.02 PIPE JOINTS

PVC (C900) pipe joints shall be restrained using a restrained joint pipe system with bell-end push-on joints per Section 2-02.02.1, installed with beveled plain ends and restrained couplings per Section 2-02.02.2. or other restraint system as identified in construction plans and approved per the Water Division.

PVCO (C909) pipe joints shall be installed with beveled plain ends and restrained couplings in accordance per Section 2-02.02.1, or other restraint system as identified in the construction plans and approved by the Water Division.

2-02.02.1 RESTRAINED JOINT PIPE SYSTEMS FOR PVC (C900)

Approved restrained joint PVC (C900) pipe systems are Eagle Loc 900 manufactured by JM Eagle, Diamond Loc-21® by Diamond Plastics, or approved equal. Restrained joint PVC pipe systems shall conform to the requirements of Section 2-02.01.

2-02.02.2 RESTRAINED COUPLINGS FOR BEVELED PLAIN END PVC (C900) AND PVCO (C909) PIPE

PVC (C900) and PVCO (C909) pipe with beveled plain ends shall be restrained with ductile iron solid sleeves per Section 2-09.01 and mechanical joint restraints per Section 2-12.01, Flex-Tite restrained couplings manufactured by RCT, or approved equal. A signed

materials Certificate of Analysis shall be provided with the delivery of all RCT couplings.

2-02.03 FITTINGS

Main line PVC or PVCO pipe fittings shall be ductile iron fittings in accordance with Section 2-08 and the construction plans.

Per AWWA Standard C605-21, spigot end bevels shall be shortened prior to insertion into a non self-restraining mechanical joint fitting. The cut off end of PVC or PVCO pipe shall be beveled prior to insertion into a self-restraining mechanical joint fitting.

2-02.03.1 SELF-RESTRAINING FITTINGS

Self-restraining fittings shall be made of ductile iron pipe in accordance with ASTM A536 Grade 65-45-12. The fittings shall conform to ANSI/AWWA C153/A21.53 and shall have a minimum pressure rating of 350 PSI. The fittings shall be furnished with integral restraining gaskets. All gasket material shall meet ANSI/AWWA C111/A21.11. All gaskets material shall be SBR (Styrene Butadiene Rubber) and have NSF 61 approved compounds. The series of segments that are molded into the gasket shall be made of 316 or higher grade stainless steel. All self-restraining fittings shall be coated with protective fusion bonded epoxy coating for both exterior and interior surfaces in conformance with ANSI/AWWA C116/A21.16. The fusion bonded epoxy coating material shall meet or exceed the requirements of NSF/ANSI 61.

Approved self-restraining fittings for PVC and PVCO pipes, 4-inch through 12-inch sizes, shall be Flex-Tite fittings as manufactured by RCT, or approved equal. A signed materials Certificate of Analysis shall be provided with the delivery of all RCT couplings.

2-02.04 INSTALLATION CURVATURE

Where the pipeline is to be installed in a curved alignment, the radius of curvature and specific alignment shall be as shown on the plans and shall be accomplished by means of deflecting the pipeline at the joints with couplings. Couplings used in a curved alignment shall be ductile iron solid sleeves per Section 2-09.01 and mechanical joint restraints per Section 2-12.01, Flex-Tite restrained couplings manufactured by RCT, or approved equal. A signed materials Certificate of Analysis shall be provided with the delivery of all RCT couplings.

Deflection at joints shall not exceed 4 degrees or 80% of the manufacturer's recommendation, whichever is less. Bending of PVC or PVCO pipe is not allowed.

2-02.05 TRACER WIRE AND WARNING TAPE

Tracer wire shall be installed in accordance with guidelines for installation of tracer wire for non-metallic pipe.

SECTION 2 MATERIALS

Warning/identification shall be installed 12 inches above PVC and PVCO pipe and tracer wire installations. Tape shall be 6 inches wide, blue in color and marked "Caution Water Line Below."

2-02.05.1 GENERAL

2-02.05.1.1 DESCRIPTION

- A. The CONTRACTOR shall furnish and install a conductive tracer wire with all buried plastic water mains, services and appurtenances in accordance with the WSSP, standard specifications, and approved drawings.
- B. All materials and installation shall be in accordance with the standards and specifications of the Public Works Department/Water Division.

2-02.05.1.2 STANDARDS

The following standards have been referenced in this Section:

ANSI B910/B190M	Standard Specifications for Annealed Copper-Clad Steel Wire
ASTM D1238	Standard Specifications for Oxygen-Free Electrolytic Copper
ASTM D 1238	Standard Test Method for Melt Flow Rates of Thermoplastics by Extrusion Plastometer

2-02.05.1.3 CONTRACTOR SUBMITTALS

- A. The CONTRACTOR shall submit manufacturer's data on materials furnished by the CITY in accordance with the requirements in the standard specifications, and as indicated in the individual sections.
- B. The CONTRACTOR shall submit information containing the following:
 - 1. Manufacturer's product data.
 - 2. Manufacturer's installation instructions.
 - 3. Manufacturer's certification of compliance.

2-02.05.1.4 QUALITY ASSURANCE

- A. Inspection: All tracer wire shall be subject to inspection at the place of manufacture. Defective,

SECTION 2 MATERIALS

damaged or unsound tracer wire will be rejected.

- B. Tests: Except where otherwise indicated, all materials used in the manufacture tracer wire shall be tested in accordance with the applicable specifications and standards. The CONTRACTOR shall perform all tests at no additional cost to the City. Copies of all test reports shall be submitted to the City.

2-02.05.1.5 MANUFACTURER'S SERVICE REPRESENTATIVE

Where the assistance of a manufacturer's service representative is advisable in order to obtain proper wire placement and connections, the CONTRACTOR shall furnish such assistance at no additional cost to the City.

2-02.05.1.6 CLEANUP

After completion of the work, all remaining tracer wire materials, and other scattered debris, shall be removed from the site by the CONTRACTOR.

2-02.05.2 MATERIALS

2-02.05.2.1 GENERAL

- A. Open-Trench Installation: direct burial #12 AWG Solid (0.0808" diameter), steel core soft drawn tracer wire, 250# average tensile break load, 30 mil high molecular-high density polyethylene jacket complying with ASTM-D-1248, 30 volt rating.

Color shall be "blue" for domestic water (potable) pipelines, "green" for sewer pipelines and "purple" for raw and recycled water (non-potable) pipelines. Manufactured by Copperhead Industries part number 1230-SF, or approved equal.

- B. Directional Bore or Jacked Installation: direct burial #12 AWG Solid (0.0808" diameter), steel core hard drawn extra high strength horizontal directional drill tracer wire, 1150# average tensile break load, 45 mil high molecular-high density polyethylene jacket complying with ASTM-D-1248, 30 volt rating. Color shall be "blue" for domestic water (potable) pipelines, "green" for sewer pipelines and "purple" for raw and recycled water (non-potable) pipelines. Manufactured by Copperhead Industries part number 1245-EHS, or approved equal.

2-02.05.2.2 CONNECTORS

- A. Splices along the continuous run of tracer wire for repair of a wire break or replacement of failed segment of wire shall use 3M Brand DBR Direct Bury' Splice Kit or approved equal. Approved alternatives must securely connect two or more wires, effectively moisture seal by means of a dielectric non-hardening silicone sealant, manufacturer approved for direct burial and rated for a minimum of 50V.
- B. Branch connections for laterals, turnouts, services and appurtenances shall use DryConn Direct Bury Lug Aqua, or approved equal. Approved alternatives must securely connect one or two wires to the main tracer wire without cutting the main tracer wire, effectively moisture seal by means of a dielectric non-hardening silicone sealant, manufacturer approved for direct burial and rated for a minimum of 50V.

2-02.05.2.3 GROUNDING

Tracer wire shall be properly grounded at all dead ends and stubs. Grounding of tracer wire shall be achieved by use of a drive-in magnesium grounding anode rod with a minimum of 20 feet of #14 HOPE copper clad wire connected to anode (minimum weight of 1.0 pound) specifically manufactured for this purpose and buried at the same elevation as the utility. The grounding rod shall be Copperhead 1 Lb., Drive-In Magnesium anode (Part #ANO-1005 with Part #SCB-01SR Connector), or equal.

2-02.05.2.4 ACCESS POINT STATION

Approved Tracer wire access point station is Copperhead Industries SnakePit™ Concrete/Driveway Two-terminal Switchable CD14B2T-SW Access Point or approved equal. Access point stations are to be installed in concrete pad and locations marked on construction plans

2-02.05.3 EXECUTION

2-02.05.3.1 GENERAL

Tracer wire shall be installed on all plastic pipes, laterals, services and appurtenances. The wire shall be installed in such a manner as to be able to properly

trace all pipelines and services without loss or deterioration of signal or without the transmitted signal migrating off the tracer wire.

2-02.05.3.2 INSTALLATION

- A. Tracer wire shall be installed in the same trench and inside bored holes and casing with pipe during pipe installation. It shall be secured to the pipe as required to ensure that the wire remains adjacent to the pipe. The tracer wire shall be securely bonded together at all wire joints with- an approved watertight connector to provide electrical continuity, and it shall be accessible at all tracer wire access points.
- B. Except for approved spliced-in repair or replacement connections, tracer wire shall be continuous and without splices from each tracer wire access point.
- C. The tracer wire system shall be installed as a continuous single wire. No looping or coiling of wire is allowed.
- D. Prior to backfill, install tracer wire on top of pipe and secure in place with ties or hitches at maximum 10-foot intervals. Run tracer wire continuously along pipe and terminate in approved access point stations. Where buried splices occur, use an electrical splicing kit 3M Brand DBR Direct Bury Splice Kif, or Water Division approved equal. Provide no less than 24 inches of coiled wire at access points for attachment of pipe locating equipment. Each installed run of pipe shall be capable of being located using the tracer wire. Protect wire insulation from damage during installation and backfilling. Wire insulation that is broken, cut, or damaged shall be replaced.
- E. At the point of connection between existing conductive pipes, the tracer wire shall not be connected to the iron pipe. This circumstance shall be treated as a mainline dead-end grounded using an approved waterproof connection to a grounding anode, buried at the same depth as the tracer wire. All such connection points shall be grounded.
- F. Where existing tracer wire is encountered on an existing utility that is being extended or tied into, the new and existing tracer wire shall be connected using approved splice connectors, shall be properly grounded at the splice location as specified, and

SECTION 2 MATERIALS

shall be completely waterproof to prohibit corrosion and loss of conductivity.

- G. Tracer wire shall be laid flat and securely affixed to the pipe at the 12 o'clock position. The wire shall be protected from damage during the execution of the works. No breaks or cuts in the tracer wire or tracer wire insulation shall be permitted. At service saddles, the tracer wire shall not be allowed to be placed between the saddle and the main.
- H. At all main end caps, a minimum of 6 feet of tracer wire shall be extended beyond the end of the pipe, coiled and secured to the cap for future connections. The end of the tracer wire shall be spliced to the wire of a six-pound zinc anode and is to be buried at the same elevations as the main. The tracer wire from the end cap shall be routed to the access point station installed next to the dead-end blowoff point or hydrant placed within the public right-of-way.
- I. Access point stations shall be placed in the maintenance pad within two feet of fire hydrants when fire hydrants are available or at 600 feet or less on center. Where no fire hydrants are available, a two-inch diameter hot-dipped galvanized marker post shall be placed within two feet of the valve box. The marker post shall be set in concrete 24-inches deep into the ground and 36-inches exposed and painted. The marker post shall be filled with concrete and crowned on top prior to painting. Two feet of tracer wire shall be looped in access point station.
- J. If the pipeline requiring tracer wire is over eight (8) feet deep, special circumstances exist and the installation method must be submitted to the AGENCY for approval.
- K. Provide as-built stations and offsets from the main line for all tracer wire access point station locations.

2-02.05.3.3 BRANCHED CONNECTION

- A. Connections between the main line tracer wire and branch connection tracer wire shall only be allowed at large diameter services, ARVs, blowoffs, and laterals.
- B. The branch connection tracer wire shall be a single tracer wire properly spliced to the main line tracer wire. DryConn Direct Bury Lug Aqua water tight

SECTION 2 MATERIALS

connectors, or approved equal, shall be used to provide electrical continuity.

- C. Access point stations will be placed at City side of the boundary-of-responsibility of large services and fire lines and in concrete maintenance pad within two feet of ARV. Blowoff or as required by the Water Division

2-02.05.3.4 DIRECTIONAL BORING

- A. For directional boring installations, two #12 tracer wires, listed above, shall be installed with the pipe and connected to the tracer wire at both ends, or cad welded to the existing iron pipe at both ends.
- B. The two tracer wires shall be laid flat and securely affixed to the top and three o'clock side of the pipeline at five-foot (5') intervals to insure its placement during the boring operation.

2-02.05.3.5 TESTING REQUIREMENTS

After all of the trench backfill operations are successfully completed, and prior to the final paving, the CONTRACTOR shall perform continuity and trace tests on all tracer wire in the presence of the Water Division. If the tracer wire is found to be not continuous after testing, the CONTRACTOR shall repair or replace the failed segment of the wire. The CONTRACTOR shall be responsible for all costs to confirm, locate, and repair any breaks in the tracer wire identified in the continuity test. In addition, the CONTRACTOR shall reimburse the Water Division for all costs incurred by the Water Division in relation to retesting the tracer wire continuity including, but not limited to, inspection and observation. The CONTRACTOR is advised to use care in the installation and backfilling operations to prevent damage to the wire. The CONTRACTOR shall notify the Water Division a minimum of two (2) working days in writing prior to installation of paving over the pipelines.

2-02.05.3.6 REPAIR AND RESTORATION

At all repair locations where there is existing tracer wire, the tracer wire shall be properly reconnected and spliced as in Section 2-02.05.3.2.D outlined above.

2-03 COPPER TUBING

2-03.01 GENERAL

This specification shall cover the requirements for 1-inch and 2-inch seamless, annealed, Type “K”, copper water tube. Copper tubing shall meet the requirements of ASTM B-88, “Specifications for Seamless Copper Water Tube”. The 2-inch copper water tube shall be of rigid or flexible type. Copper tubing shall comply with CA Health and Safety – Section 116875 (low lead).

2-03.02 DIMENSIONS

Copper tubing shall be furnished in coils or straight lengths, as follows:

<u>SIZE</u>	<u>FORM</u>	<u>LENGTH</u>
1" & 2"	Coils	60' to 100'
2"	Straight Lengths	20'

Coils shall be wound in a single layer flat with a minimum 24-inch inside diameter.

2-03.03 TEMPER

Copper tubing shall be furnished in the annealed condition in accordance with the technical property requirements of ASTM B-88. Straight lengths shall be annealed after being drawn.

2-04 RED BRASS PIPE

Brass pipe shall conform to the requirements of the “Specifications for Seamless Red Brass Pipe, Standard Sizes” ASTM Specification B-43 and referenced in the appendix to AWWA Standard C800.

Fittings shall be of bronze conforming to the requirements of ASTM B-62, “Specifications for Composition Bronze or Ounce Metal Castings.”

2-05 MAIN LINE VALVES

2-05.01 GATE VALVES

Gate valves shall be ductile iron body, fusion bonded epoxy lined, non-rising stem fully encapsulated resilient wedge disc type and shall not have more than two internal moving parts. All gate valves shall open by turning the wrench nut counter-clockwise.

When required, above ground installations shall be resilient seat/wedge disc type valves with outside screw and yoke.

All bronze parts shall contain no more than 7% zinc, nor more than 2% aluminum.

Stems shall be low zinc bronze. Valves shall have 2-inch operating (wrench) nut conforming to AWWA C509 or C515. The valve manufacturer shall employ a

SECTION 2 MATERIALS

positive physical means of indicating the specified stem material to ensure ready recognition during inspection.

The bolts and nuts on the bonnet shall be stainless steel type 304 or 316 with an anti-seize lubricant. All gate valves shall have a minimum of 6 bonnet bolts.

The ductile iron interior and exterior of all valves shall be protected with 6 to 7 mils (nominal) fusion bonded epoxy. Coating shall conform to AWWA Standard C213 and C550, and shall be certified to NSF 61.

For above ground or vault installation, exterior coating to valves shall be per Section 2-14 for coating on above ground or vault installation.

Resilient wedge type valves with a flanged end may be used as "tapping valves".

All valves shall be provided with an epoxy coated stem extension if depth of valve nut exceeds 4 feet. All valve extensions shall be centered in the valve well by use of a guide and shall operate freely without binding after installation.

Gate valves 12" and below shall conform to the requirements of AWWA Standard C509 Resilient-Seated Gate Valves. Gate valves over 12" in size shall conform to the requirements of AWWA Standard C515 Reduced-Wall, Resilient Seated Gate Valves.

All gate valves shall be ductile-iron body equipped with double O-ring stem seals. All gate valves shall have EPDM O-rings, and stainless-steel bolts.

2-05.01.1 APPROVED GATE VALVE MANUFACTURERS

SIZES 3" TO 12":

Clow	Model 2639
M&H	Style 4067
Mueller	Model A-2362-E381
U.S. Pipe	Model A-USP2-E381

SIZES GREATER THAN 12":

AMERICAN Flow Control	Series 2500
Clow	Model 2638
M&H	Style 7000
Mueller	A-2361-E381
U.S. Pipe	Model A-USP1-E381

2-05.02 BUTTERFLY VALVES

Butterfly valves shall conform to the requirements of AWWA Standard C504. Valves shall have a minimum working differential pressure across the valve disc of 150 psi for class 150B valves and 250 psi for class 250B valves. Valves shall be flanged short-body or restrained mechanical joint as indicated per the construction plans. Flanges for both Valve Class 150B and 250B shall be drilled per ANSI B16.1, 125-pound standard bolt pattern. Valves shall be designed for buried installation.

SECTION 2 MATERIALS

COMPONENT	MATERIAL	SPECIFICATIONS
Body	Ductile Iron	ASTM A-536, Grade 65-45-12
Valve Shaft	Stainless Steel	Type 316 or 17-4 (14" or larger)
Exposed body, cap screws, bolts and nuts including squeeze-pins	Stainless Steel	ASTM A-276, Type 316
Disc	Ductile Iron	ASTM A-536, Grade 65-45-12
Valve Seat	EPDM Rubber	ASTM D-412
O-Rings	EPDM Rubber	ASTM D-2000

Valve seat material shall be peroxide cured EPDM rubber seat and shall be fastened integrally with the valve body. The valve disc shall be furnished with a stainless-steel seating edge to mate with the rubber seat in the valve body. Valves with the seat located on the disc shall not be accepted.

The ductile iron interior and exterior shall be factory coated with NSF 61 approved 16 mils DFT high solids 2-part epoxy of not less than 65% conforming to AWWA standard C550 (Amerlock® 400, Tnemec 141, or approved equal).

Valve operators shall be the manual type. Valve actuator shall be supplied and installed on the valve by the valve manufacturer. Gear actuators shall be for buried service applications and shall come furnished with a standard 2" AWWA operating nut. Operating nut for butterfly valves shall be placed at the north or east side of the water line. The operators shall be of travelling nut type with adjustable stops for valves smaller than 24" in size. The operator for valves 24" and larger shall be worm gear type. The actuator shall be capable of withstanding 300 ft-lb (for worm gear) and 450 ft-lb (for travel nut gear) at the stops. The actuator shall be sized for bi-directional maximum pressures and flow rate per AWWA valve classification 150B (250B when specified). All external bolts on the actuator shall be 316 stainless steel. The operator shall be of the size required for opening and closing the valve in accordance with AWWA C-504. All valve operators shall be factory packed with grease, fully gasketed and sealed for permanent installation and operation.

Factory signed and dated affidavit of compliance shall accompany all submittals. Affidavits shall include "holiday free" paint, actuator stops compliance of 450 foot pounds, proof of design per AWWA C504 latest version for valves and actuator, and bi-directional seat leak test. Signatures of agents or distributors of the factory will not be accepted.

2-05.02.1 APPROVED BUTTERFLY VALVE MANUFACTURERS

- DeZurik BAW (AWWA Butterfly Valves)
- Mueller Lineseal XP11
- Pratt HP 25011

2-05.03 END CONNECTIONS AND GASKET MATERIAL

Valves shall have mechanical joints or flanged ends, or a combination of both.

SECTION 2 MATERIALS

Gaskets shall conform to the requirements of Section 2-08.03 of these specifications. All gasket materials shall have NSF 61 approval.

Unless otherwise shown on plans, all valves installed at fittings shall be flanged by mechanical ends, with the flange abutting the fitting.

2-06 AIR AND VACUUM, AIR RELEASE AND COMBINATION AIR VALVES

Air and Vacuum, Air Release and Combination Air Valves shall conform to the performance criteria of AWWA C512 and be designed for a minimum working pressure of 150 psi, unless otherwise specified. Float, linkage and all internal parts shall be 316 stainless steel. All air valves shall be NSF 61 approved. Valves shall be APCO by DeZurik, Crispin by Multiplex Manufacturing Company, AirPro Max® by Pratt, Cla-Val, A.R.I., or approved equal.

	<u>AIR/VACUUM</u>	<u>AIR RELEASE</u>	<u>COMBINATION AIR</u>
APCO	Series 140	Model 50/200A	Series 140C
Cla-Val	Series 35	Series 34	Series 36
Crispin	AL Series	Series AR/PL	Series UL
Pratt	Series WAV	Series WAR	Series WCV
A.R.I.	D-040-C	S-050-C	D-040-C/D-060-C
A.R.I. (when not exposed to sunlight)	D-040	S-050	D-040/D-060

2-07 FIRE HYDRANTS

2-07.01 GENERAL

Fire hydrants shall be of the wet-barrel type, conforming to AWWA C503, and as supplemented herein.

2-07.02 MATERIALS AND PARTS

Commercial fire hydrants shall have *two* 2½-inch hose outlets and one 4-inch pumper outlet. Residential fire hydrants shall have *one* 2½-inch hose outlet and one 4-inch pumper outlet. Outlet threads shall conform to ANSI-B26 "National Standard Fire-Hose Coupling Screw Threads".

Fire hydrants shall be furnished with a pentagon shaped operating nut 1-1/8 inch per side, and opening shall be counterclockwise. Fire hydrants shall be furnished with holed flanged bolts, flanged bolts, 6" long breakaway spool, and 8" minimum length solid spool.

Fire hydrants shall be equipped with plastic outlet nozzle caps attached to the body of the fire hydrant with non-kinking electro-galvanized steel chains and fitted with appropriate neoprene rubber gaskets.

All fire hydrant burys shall be ductile iron, asphalt coated and cement lined. Fire hydrant burys shall be provided with a Mechanical Joint-end at the shoe.

Wet barrel type fire hydrants shall have a nominal six-inch (6") base flange with

a six-hole bolt pattern. All internal working parts, including stem, shall be bronze containing no more than seven percent (7%) zinc or two percent (2%) aluminum or 316 stainless steel.

2-07.03 APPROVED FIRE HYDRANT MANUFACTURERS

Jones 3700 or 3760

2-08 MAIN LINE PIPE FITTINGS

2-08.01 GENERAL

Main line pipe fittings shall conform to the requirements of AWWA Standard C110, "Ductile-Iron and Gray-Iron Fittings". Compact type fittings conforming to AWWA Standard C153, "Ductile Iron Compact Fittings" may be used for sizes 4-inch through 24-inch.

All fittings shall be made of ductile iron. Fittings up to 24-inch size shall be 350 psi pressure ratings and over 24-inch size shall be 250 psi pressure rating. Fittings shall be cement mortar lined in accordance with AWWA Standard C104, "Cement Mortar Lining for Ductile-Iron Pipe and Fittings for Water".

The exterior of fittings shall be zinc-coated with a topcoat of bituminous material in accordance with Section 2-01.03.

All fittings shall be restrained in accordance with Section 2-12.01 unless otherwise indicated on plans.

2-08.02 END CONNECTIONS

2-08.02.1 MECHANICAL JOINTS

Mechanical Joints shall conform to the requirements of AWWA Standard C111 "Rubber-Gasket Joint for Ductile Iron Pressure Pipe and Fittings". Glands shall be made of ductile iron.

2-08.02.2 FLANGED FITTINGS

Flanged fittings shall conform to the requirements of AWWA Standard C110 or C153. Flanges shall be drilled to ANSI B16.1, 125 lb. standard bolt pattern. The 250 lb., F-Style flanges, when required, shall be drilled to ANSI B16.1, 250 lb. standard bolt pattern.

2-08.03 GASKETS

Gaskets for flanged fittings shall be 1/8-inch thick ring type Non-Asbestos type compressed fiber gaskets and NSF 61 certified. The synthetic fiber content shall be aramid, bonded by nitrile butadiene rubber (NBR) and have a non-stick coating. Allowable gasket is NAM 37C manufactured by Ferolite or approved equal. Gaskets shall meet the pressure ratings, drillings, and dimensional requirements as per Section 2-08.02.2 and shall conform to the requirements of

AWWA C111 and ANSI B16.21.

When project plans require 350 psi rating, gaskets for flanged fittings shall be 1/8-inch thick full faced with a thickened and rounded bulb (torus) located at the inside diameter of the gasket. These gaskets shall conform to the dimensions shown in AWWA C115/A21.15, Table A.1 and shall match standard flange fittings with Class 125 standard flange bolts. Gaskets shall be made of high quality black vulcanized styrene butadiene rubber (SBR) and shall be NSF 61 certified. All joints shall be assembled dry where all joint/gasket compounds are prohibited. Allowable gaskets meeting these criteria are AMERICAN Toruseal Flange Gasket or approved equal.

2-08.04 BOLTS AND NUTS FOR MECHANICAL JOINTS AND FLANGED FITTINGS

All below grade bolts and nuts with the exception of valves shall be stainless steel 316 nuts. Valve nuts and bolts shall be stainless steel 304 or 316 (per manufactured assembly) and shall be coated with Loctite® N-5000™ anti-seize/rust preventer lubricant manufactured by the Henkel Corporation or approved equal.

Stainless Steel nuts and bolts are required for above ground installations and shall be type 316. For all stainless-steel nuts and bolts, the Contractor shall strictly follow the torque limitations and shall use Loctite® N-5000™ anti-seize/rust preventer lubricant manufactured by the Henkel Corporation or approved equal.

All buried nuts and bolts shall be coated after assembly as per Section 2-00.01.

2-08.05 TAPPING SLEEVES

All tapping sleeves for tapping a water main under pressure shall conform to the following requirements. Tapping sleeves are not allowed on pipe sizes greater than 24-inch.

2-08.05.1 TAPPING SLEEVES FOR DUCTILE IRON, CAST IRON, ASBESTOS-CEMENT AND POLYVINYL CHLORIDE PIPES

Tapping sleeves used for ductile iron pipe (DIP), cast iron pipe (CIP), asbestos-cement (AC) pipe, or polyvinyl chloride (PVC or PVCO) pipe shall be of the full circle stainless steel type. All tapping sleeves specified in this Section must withstand a 250 psi minimum working pressure and shall provide a positive seal around the pipe at each end of the sleeve. Tapping sleeves that seal only around the opening in the pipe may not be used. For working pressures above 250 psi, special approval must be obtained from the Water Division.

Stainless steel type tapping sleeves shall be made of 18-8 stainless steel, with a stainless-steel flange piece conforming to the requirements of AWWA Standard C207 "Steel Pipe Flanges for

SECTION 2 MATERIALS

Waterworks Service, Sizes 4 in. through 144 in.” Approved stainless steel type tapping sleeves are listed in Section 2-08.05.1.1. Size on size stainless steel type tapping sleeves are not permitted.

Tapping sleeves and tapping of PVC and PVCO pipe must be done in accordance with AWWA 605-21

2-08.05.1.1 APPROVED FULL CIRCLE STAINLESS STEEL TAPPING SLEEVE MANUFACTURERS

Mueller	Model H-304SS
PowerSeal	Model 3490AS
JCM	Model 432
Romac	Style SST (up to 8" pipe diameter)
Ford	Style
FTSS	
Or approved equal	

2-08.05.2 CONCRETE CYLINDER PIPE

At the sole discretion of the Water Division, tapping sleeves for concrete cylinder pipe (CCP) may be required to be of the weld-on type, provided that pipe wall thickness is greater than 13 gauge and that welding is performed by a State certified pipe welder. Approved material listing is in Section 2-08.05.2.1.

For concrete cylinder pipe with a steel cylinder wall thickness of 13 gauge or thinner, the Water Division may require a full circle, split body, fabricated steel type tapping sleeve, conforming to the provisions of Section 2-08.05.1 of these specifications. Approved material listing for use on CCP is in Section 2-08.05.2.2.

2-08.05.2.1 APPROVED TAPPING SLEEVE MANUFACTURERS FOR CONCRETE CYLINDER PIPE (WALL THICKNESS GREATER THAN 13 GAUGE)

Weld-On (Three-Piece) Type:

Koppl	Model CN-120 (full wrapper plate)
JCM	416 Type 2 (full wrap)
Smith-Blair	627
Type 2	Or approved equal

2-08.05.2.2 APPROVED TAPPING SLEEVE MANUFACTURERS FOR CONCRETE CYLINDER PIPE (WALL THICKNESS LESS THAN 13 GAUGE)

Full Circle Type:

JCM	Model 415
Smith-Blair	Model
625	
Or approved equal	

2-09 MAIN LINE COUPLINGS

2-09.01 SLEEVE TYPE COUPLINGS

Sleeve type couplings shall provide a flexible water tight connection between two plain ends as described when shown on the construction plans. For ductile iron, gray iron, PVC and PVCO pipe, all couplings shall be ductile iron solid sleeve type couplings conforming to AWWA C110 and Section 2-08, with mechanical joint ends and body not less than 12 inches long, and shall be lined and coated as described per Section 2-08.01.

For steel or asbestos cement pipe, all couplings shall be standard steel couplings, with body not less than 7 inches long. Bolts for exposed steel couplings shall be hot-dip galvanized. Bolts for buried steel couplings shall be of type 316 stainless steel. The Contractor shall strictly follow the torque limitations and shall use Loctite® N-5000™ anti-seize/rust preventer lubricant manufactured by the Henkel Corporation, or approved equal. All sleeve type steel couplings shall be fusion bonded epoxy lined and coated with Scotchkote™ 6233, as manufactured by 3M™, or approved equal.

Allowable gap between two pipe ends shall be provided per manufacturer's recommendations.

Buried metal surfaces shall receive additional protective coating and wrapping after they are assembled as per Section 2-00.01.

2-09.01.1 APPROVED SLEEVE TYPE COUPLINGS MANUFACTURERS FOR DUCTILE IRON, GRAY IRON, PVC AND PVCO PIPE

Clow	Mechanical Joint Ductile Iron Long Solid
Sleeves Ford	Ultra-Flex Long Sleeve Wide Range
Couplings	
SIP Industries	Ductile Iron Long MJ Sleeves
RCT	Flex-Tite Couplings (for PVC or PVCO pipe only) Or approved equal

2-09.01.2 APPROVED FLEXIBLE COUPLING MANUFACTURERS FOR STEEL PIPE

Ford	Ultra-Flex Wide Range
Couplings Smith-Blair	411 Steel Couplings
Smith-Blair	461 Quantum Wide Range
Couplings Romac	Style XR501
Or approved equal	

2-09.01.3 APPROVED FLEXIBLE COUPLING MANUFACTURERS FOR TRANSITION TO ASBESTOS CEMENT PIPE AND BELGIAN CAST IRON PIPE

Ford	Ultra-Flex Wide Range
------	-----------------------

Couplings Smith-Blair 441 OMNI Ductile Iron
Couplings Smith-Blair 461 Quantum Wide Range
Couplings Romac Style XR501™
Or approved equal

2-09.02 MECHANICAL GROOVED-TYPE COUPLINGS

Mechanical grooved-type couplings shall provide a positive thrust restraint by locking two grooved or shouldered ends of pipe together. The couplings shall be Style 77 for steel pipe and Style 31 for ductile iron pipe as manufactured by Victaulic Company, or approved equal. These couplings shall have Grade H rubber gaskets and the interior shall be lined with fusion bonded epoxy. Mechanical grooved-type couplings shall be used in above ground or vault installation only. Ductile iron pipe for Style 31 shall be Thickness Class 53.

2-09.03 DISMANTLING JOINTS

Dismantling joints shall be a self-contained flanged restrained joint fitting, including both flanged components and sufficient harness bars to withstand the imposed thrust. The dismantling joint shall be designed to provide no less than 5 inches of longitudinal adjustment and shall be installed with 4 inches of inward adjustment and 1 inch of expansion. The pressure rating will be determined by the flange configuration, and all commonly used flanges shall be available. As standard, flanges conforming to AWWA C207 class D shall be used.

The dismantling joint shall be furnished as a complete assembly consisting of spigot piece, flange adapter, tie bars and gasket.

The spigot piece and the flange adapter shall be steel per AISI C1010-C1015. All exterior fasteners including tie bars shall be 304 or 316 stainless steel. Stainless steel fasteners and tie bars shall not be painted. Gasket material shall be EPDM or Buna-S. The dismantling joint shall be coated inside and out with a fusion bonded Epoxy coating applied to a thickness of 5 -10 mils. The epoxy shall comply with the requirements of NSF 61 and AWWA C550.

The dismantling joint shall comply with AWWA C219 where applicable, and the manufacturer shall operate an accredited Quality Management System to ISO 9001. The design pressure rating shall be equal to or greater than the mating flanges. The gasket seal and compression stud and nut arrangement shall be separate and independent of the tie bar restraint system. Seals between companion flanges and dismantling joint flanges shall be made by full faced or drop in ring-style gaskets. Tie bar diameter shall be equal to the corresponding bolt diameter of the mating flange and shall not extend outside the diameter of the flange diameter.

The dismantling joint shall be Dresser Industries Style 131, Romac Industries, Inc. Style DJ400, Smith Blair 900 Series, or approved equal.

2-09.04 FLANGE ADAPTERS

Flange adapters shall be fully restrained wedge activated type with a minimum

working pressure of 250 psi and a safety factor of two. Outside and inside surfaces of flange adapters shall be epoxy coated.

Flange adapters shall be manufactured from ductile iron per ASTM A536 and shall have bolt circles and bolt holes to meet ANSI B16.1 Class 125 or Class 250 if required and shown on the plans. Flange adapters are approved only for above ground ductile iron pipe installations. Approved flange adapters are listed in Section 2-09.04.1.

2-09.04.1 APPROVED FLANGE ADAPTOR MANUFACTURERS

EBA Iron, Inc.	Series 2100
MEGAFLANGE®	
Ford	RFAD Restrained Flange
Adaptor	
Romac	RFCA Restrained Flange Coupling
Adapter Smith-Blair	Model 911
Or approved equal	

2-10 SERVICE LATERAL INSTALLATION

2-10.01 GENERAL

All valves and fittings for use in the buried service line from the main to the meter setting appurtenance shall conform to the requirements of AWWA standard C800 "Underground Service Line Valves and Fitting" and meet the California Health and Safety Code section 116875. The wetted surfaces of pipes, pipe fittings, and valves shall not contain more than 0.25% lead by average weight. All corporation stops and angle meter valves used for copper installations shall have compression connection of copper tubing. Approved manufacturers, with the exception of corporation stops are Jones, Ford, Mueller, and A.Y. McDonald. Approved manufacturers of corporation stops for metallic pipe are Mueller and Jones. Approved manufacturers of corporation stops for nonmetallic pipe are Ford, Mueller and Jones

2-10.02 FITTINGS

2-10.02.1 I N S U L A T E D CORPORATION STOPS (FOR METAL PIPE)

1-inch and 2-inch corporation stops shall be insulated ball corporation valves. Insulation (dielectric) material shall either be enclosed or fused together as a composite part that has metal threads on one end. Plastic insert threads are not allowed to be screwed to metal threads. Connection at main shall be AWWA tapered CC threads. Outlet shall be a compression connection for copper tube O.D. Approved corporation stops (both 1-inch and 2-inch) are Mueller N-35008N or Jones E-1999SG.

2-10.02.1 C ORPORATION STOPS (NON METAL PIPE)

1-inch and 2-inch corporation stops shall be ball corporation valves. Connection at main shall be AWWA tapered CC threads. Outlet shall

be a compression connection for copper tube O.D. Approved corporation stops (both 1-inch and 2-inch) are Ford FB1002, Mueller N-35008N or Jones E-1999SG.

2-10.02.3 ANGLE METER VALVES – CITY SIDE AND PROPERTY SIDE

All City Side angle meter valves shall be full port “ball” type, include a locking wing on the key operator, and will have full 360-degree rotation of tee head. All valves for 5/8 x 3/4 inch and 1-inch meters shall have a compression connection inlet and a meter swivel nut outlet. All 2-inch valves shall have a compression connection inlet for 2-inch copper tubing and a meter flange outlet slotted to accommodate 1½-inch and 2-inch meters. Slot should not extend to the outside edge - open slot will not be accepted.

All Property Side angle meter valves shall be full port “ball” type, include a handle for property ease of use, will have a 90-degree rotation of tee head, and be the same size as the meter. All valves for 5/8 x 3/4 inch and 1-inch meters shall have a female iron pipe tread connection inlet and a meter swivel nut outlet. All 1½-inch and 2 inch valves shall have a female iron pipe tread connection inlet and a meter flange outlet. Flange bolt should not extend to the outside edge - open slot will not be accepted.

2-10.02.4 COUPLINGS AND SOLDER

Couplings required for 2-inch service laterals shall be made with copper tube fittings in accordance with ANSI B16.22. The annular clearance between the tube and fitting shall be .004 to .010 inches. Solder shall be 95/5 (tin-antimony) or an approved equal. Solder with a lead content of 0.2% or greater will not be accepted.

2-10.02.5 BOLTS AND NUTS FOR METER FLANGE CONNECTIONS

All bolts, nuts and washers for flanged fittings shall be Teflon coated, silicon-bronze per ASTM B98, or of an approved similar metal as the flanges, to resist corrosion and for easy removal after lengthy service.

2-10.03 SERVICE SADDLES

All service saddles shall be bronze conforming to ASTM B-62, double strap and tapped. 1-inch and 2-inch diameter service saddles and tap shall have AWWA tapered CC threads, as specified by AWWA Standard C800 “underground Service Line Valves and Fittings.”

2-10.03.1 SERVICE TAPPING TO CONCRETE CYLINDER PIPES

Service tapping to concrete cylinder pipes shall only be made under special approval by the Water Division. Unless specified otherwise, tapping shall be a minimum of 2-inch NPT with bushing, as needed.

Service saddles shall be Smith-Blair 362, or approved equal.

2-10.03.2 SERVICE TAPPING TO PVC PIPE OR PVCO PIPE

For dry tapping 1" and 2" services on PVC or PVCO pipe, the hole shall be bored into the pipe with a hole saw specifically designed for PVC/O cutting, that retains the coupon and allows the shavings to fall clear of the hole. When multiple taps are required, the taps shall be kept a minimum of 24" apart lengthwise and shall be staggered so that the minimum spacing along the same line is 48". The service saddle shall be centered over the hole, seated, and tightened, and then the corporation stop installed using pipe thread sealant.

2-10.04 METER BOXES

Meter boxes shall be straight wall polymer concrete having a compressive strength of 4000 psi. Meter boxes shall have a polymer concrete cover with a drop-in reading lid. The body of the meter box shall be constructed with a "ring" at the top to prevent settlement.

Where required, meter boxes shall have a traffic load rating. Meter boxes shall be manufactured by Armorcast Products Company or approved equal. Approved equal must have the same dimensions of meter box, cover, and drop-in lids to be interchangeable with Armorcast products and have equal or better polymer concrete compressive strength.

2-10.04.1 APPROVED METER BOXES

<u>METER SIZE</u>	<u>BOX SIZE (W×L×D)</u>	<u>BOX / COVER / DROP-IN LID</u>
5/8" × 3/4" and 1"	13" × 24" × 12"	Pedestrian Load: Armorcast A6001946PCX12 / A6001866DQ / A6000487 Traffic Load: Armorcast A6001946PCX12 / A6001866TDQ / A6000487T
1 1/2" and 2"	17" × 30" × 12"	Pedestrian Load: Armorcast A6001640PCX12 / A6001643DZ / A6000482 Traffic Load: Armorcast A6001640PCX12 / A6001643TDZ / A6000482T

2-11 WATER METERS

The City will supply all water meters; however, under certain circumstances, the City reserves the right to require the Contractor to provide a specific size, brand, and model as deemed necessary by the City.

2-12 THRUST RESTRAINING MATERIALS

All mechanical thrust restraining devices shall be made of ductile iron. All devices shall withstand a working pressure of at least 250 psi with minimum safety factor of two. Deflection of joints with thrust restraining devices shall not exceed 80% of the manufacturer's allowable deflection.

2-12.01 MECHANICAL JOINT RESTRAINT

2-12.01.1 FOLLOWER GLAND TYPE

Restraining devices for mechanical joint fittings shall be incorporated with design of the follower gland and shall include a restraining mechanism which when activated, imparts multiple wedging action against the pipe, increasing its resistance as the pressure increases. The joint shall maintain flexibility after burial. Glands shall be manufactured of ductile iron conforming to ASTM A536. A coating system shall be applied to the body and wedge assembly and related parts to provide corrosion, impact and UV resistance. The coating for restraint body shall be electrostatically applied to ensure complete coverage. The coating system shall be MEGA-BOND by EBAA Iron, Inc., E-Coat by Ford Meter Box, Inc., Flexi-Coat by Smith-Blair, or approved equal. Requests for approved equal must submit coating material and process details for review.

Approved mechanical joint restraints shall be Megalug® Series 1100 as manufactured by EBAA Iron, Inc., Uni-Flange Series 1400 as manufactured by Ford Meter Box, Inc., RomaGrip as manufactured by Romac Industries Inc., Stargrip as manufactured by Star Pipe Products, Inc., Cam-Lock™ 111 as manufactured by Smith-Blair, or approved equal.

For PVC (C900) pipe, approved mechanical joint restraints for 4 inch through 12 inch sizes shall be Megalug® Series 2000PV as manufactured by EBAA Iron, Inc., Cam-Lock™ 120 as manufactured by Smith-Blair, or approved equal.

For PVCO (C909) pipe, approved mechanical joint restraints for 4 inch through 12 inch sizes shall be Megalug® Series 19MJ00 as manufactured by EBAA Iron, Inc. or approved equal.

2-12.01.2 GASKET TYPE

Where gasket type restraints are indicated on the plans, mechanical joint pipe and fittings shall be restrained with the MJ FIELD LOK® Gasket as manufactured by US PIPE, or approved equal. The restraint system shall be completely integral to the gasket, requiring only standard mechanical joint assembly techniques. The gasket type restraint shall fit mechanical joints conforming to ANSI/AWWA C111/A21.11 "Rubber Gasket Joints for Ductile-Iron Pressure Pipe and Fittings".

2-12.02 PUSH-ON PIPE BELL RESTRAINTS

For buried installations, push-on joints for ductile iron pipe shall be restrained with FIELD LOK® 350 or TR FLEX restraint as manufactured by U.S. Pipe, Flex-Ring as manufactured by AMERICAN Pipe, Sure Stop 350 Gasket as manufactured by McWane Pipe, or approved equal. When above-ground applications are approved by the Water Division, push-on joints shall be restrained with TR FLEX® restrained joint pipe as manufactured by U.S. Pipe, Flex-Ring as manufactured by AMERICAN Pipe or approved equal. Restrained push-on joint pipe shall be capable of being deflected after assembly.

PVC and PVCO pipe shall be restrained in accordance with Section 2-02.02. Restraints shall be MegaLug series 2500 4"-48" or approved equal.

2-12.03 CONCRETE

Concrete for thrust blocks shall conform to Concrete Class 420-C-2000. If thrust block is to be disturbed or backfill is to be placed prior to developing its required strength, additional mechanical thrust restraining devices approved by the Water Division shall be installed. Concrete for anchor and Gravity Anchor Blocks shall conform to Class 560-C-3250.

2-13 SHOP DRAWING AND MATERIAL SUBMITTALS

The Contractor shall furnish to the Water Division such working drawings, data on materials, certifications of materials, and equipment and samples as are required for the proper control of the work, including, but not limited to, those working drawings, data and samples specifically required in Subsection 3-8 "Submittals" of the SSPWC and on the construction plans. All working drawings, data and samples shall be subject to review by the Water Division for conformity with the plans and specifications. The shop drawings shall be submitted at least ten (10) working days before such drawings will be required for commencing the work.

2-14 PAINTING - ABOVE GROUND INSTALLATIONS

After all testing and disinfection has passed, but prior to final acceptance by the Water Division, all above ground installations shall be painted in accordance with the following:

Remove all dirt, oil, grease, rust, bituminous coating, and other contaminants from surfaces to be painted by sand-blasting, pickling, or wire brushing as required. Sand blasting can damage ductile iron pipe and therefore only qualified personnel familiar with sand blasting may perform this work. Clean all surfaces with a SCAQMD-compliant, biodegradable surface cleaner as may be necessary. Allow surfaces to dry completely then apply primer to all surfaces to be painted. Allow primer to dry, then apply intermediate coat to all surfaces; allow intermediate coat to dry, then apply finish coat.

The underlined generic terms in the above paragraph shall be considered together as a painting system and shall be supplied by a single manufacturer selected from the list of approved paint manufacturers at the end of this section.

SECTION 2 MATERIALS

The above specified work shall be accomplished per the appropriate sections of Steel Structures Painting Manual, Volumes 1 and 2, published by the SSPC of Pittsburgh, Pennsylvania and strict adherence to the manufacturer's recommendations.

Approved paint manufacturers shall be per the table below.

CITY DEVICE	COLOR	MANUFACTURER		
		CARBOLINE	SHERWIN WILLIAMS	PPG
Fire Hydrants	Carboline Safety Yellow or equivalent	<u>Primer Coat:</u> Carbocrylic 3358 MC (2.0 to 3.0 mils DFT) <u>Finish Coat (Gloss):</u> Carbocrylic 3359 DTMC (2.0 To 5.0 mils DFT)	<u>Primer Coat:</u> Pro-Cryl B66-310 Series (2.0 To 4.0 mils DFT) <u>Finish Coat (Gloss):</u> Acrylic B66-600 Series (2.5 To 4.0 mils DFT)	<u>Primer Coat:</u> Pitt-Tech Plus 90-912 DTM Primer (2.0-4.0 mils DFT) <u>Finish Coat (Gloss):</u> Pitt-Tech Plus 90-1310 Gloss Finish (2.0-4.0 mils DFT)
Above Ground Assemblies: ▪ Backflow Devices ▪ Fire Lines ▪ Large Meters	Carboline Hunter Green or equivalent			
Guard Posts	Carboline Safety Yellow, Hunter Green, or Light Grey; or equivalent			

2-15 ACCESS TO MANUFACTURING AND TEST FACILITIES

The Water Division shall at all times have access to the manufacturing and test facilities, and the right to inspect the work, and materials. The manufacturer shall furnish the Water Division with reasonable facility access for obtaining such information as necessary to assess the progress of the work, and the character and quality of materials used. When requested by the Water Division, the manufacturer shall submit a certificate of compliance that the product meets the requirements of these specifications.

SECTION 3 CONSTRUCTION METHODS AND CONTROL

3-01 INSPECTION

The construction of any water system improvement intended for dedication to the City and used by the Water Division for public water service shall be subject to inspection by the Water Division. Such inspection will assure the Water Division that all phases of the work are in compliance with these specifications. The Water Division Inspector will be the representative of the General Manager, Public Works Director and shall coordinate the various tasks and responses of the Water Division to the Contractor throughout the work.

The Water Division shall have access to the work and shall be furnished with every reasonable facility for ascertaining full knowledge of the progress, material, and workmanship used to complete the work. A minimum of 48-hour notice is required when requesting Water Division inspection. All material shall be inspected by the Water Division Inspector prior to placement and all workmanship shall be visually inspected prior to backfilling. The Contractor is required to verify elevation and alignment by means of a flow line or laser level as required by the Water Division Inspector. The Contractor shall provide reasonable aid to ascertain the exact location of all work.

Inspection of the work, by the Water Division Inspector, shall not relieve the Contractor of any obligation to complete the work as prescribed by these specifications. Defective work shall be made good by the Contractor, and unsuitable materials may be rejected by the Water Division Inspector, notwithstanding the fact that such defective work and unsuitable materials may have been previously accepted by the Water Division.

The Water Division shall have the authority to suspend the work wholly, or in part, for such time as it may deem necessary due to the failure of the Contractor to perform any provisions of the plans or specifications. The work can only continue when the defective material or method is recognized as corrected by the Contractor and accepted by the Water Division.

It is the sole responsibility of the Contractor to prevent the consumption of water for any and all uses from water mains and appurtenances whether by their workmen, subcontractors, or any other person prior to the acceptance of the project by the Water Division.

The Contractor shall agree to indemnify, defend and hold harmless the City, its officials, officers, employees, agents, and representatives from and against any and all claims, losses, damages, defense costs, or liability of any kind or nature, arising out of or in connection with the consumption of water from the new main or appurtenances prior to acceptance by the City.

The Contractor (or Developer) is prohibited from operating any existing water valves in the Water Division water system. The Contractor shall schedule operation of existing water valves through the Water Division Inspector. Should an emergency arise, the Contractor shall contact the Water Division Inspector and the Water Division's Water Services Emergency 24-Hour Dispatch at (626) 705-7276.

SECTION 3 CONSTRUCTION METHODS AND CONTROL

3-02 PRE-CONSTRUCTION DETAILS

3-02.01 LICENSES AND PERMITS

The Contractor shall have a Class "C-34" or Engineering "A" Contractor's License valid in the State of California and shall meet all the applicable requirements of the Monterey Park Municipal Code. The Contractor shall have a current, valid City of Monterey Park business license. The Contractor shall obtain all necessary permits, licenses, or agreements required by any legally constituted agency. The Contractor shall observe all safety procedures as required by Cal/OSHA.

An Encroachment Permit (EP) from the City of Monterey Park Department of Public Works (Public Works) shall be obtained for all work in the public right-of-way within the City of Monterey Park.

When a Developer or Contractor is responsible for water system construction in conjunction with development of property, the Developer or Contractor shall obtain approval of a utilities plan from the City of Monterey Park's Engineering Department in compliance with the City's Standard Specifications and details.

A copy of all licenses and permits required for the project shall be provided to the Water Division prior to starting work.

All provisions of the permits, licenses, or agreements shall be binding upon the Contractor as though stated herein.

3-02.02 TRAFFIC CONTROL

The Contractor shall furnish all materials, labor and traffic controls necessary to safeguard the work and the public safety. Traffic and pedestrian control shall comply with the requirements contained in the EP. All traffic control plans, if required by the EP, shall be reviewed and approved by Public Works. At Public Works' discretion, engineered traffic control plans prepared by a California registered professional traffic engineer may be required as part of the EP.

Public Works requires that "Temporary No Parking" signs shall be posted at the work zone 72 hours in advance and reference C.V.C. 22651L. Dates and times of parking restrictions shall be identified on the front of signs and date of original posting shall be marked on the back of signs.

3-02.03 SURVEYING

The Contractor shall provide equipment, method, and labor to locate accurately all proposed water facilities. The Contractor shall further guarantee the accurate location of all water facilities by constructing curb and gutter prior to the beginning of any water improvements. If, in the opinion of the Water Division, this sequence of construction cannot be followed, the Contractor will sign a "Waiver of Curb and Gutter Requirements" and assume all responsibility and costs for correcting any resulting errors or omissions.

SECTION 3 CONSTRUCTION METHODS AND CONTROL

3-02.04 POLLUTION PREVENTION & BEST MANAGEMENT PRACTICES

Stormwater and non-stormwater discharges resulting from municipal construction activities, as well as some private construction activities, including those to which these Standard Specifications apply, are subject to the requirements of the City's MS4 NPDES Permit, the Los Angeles Regional Water Quality Control Board and the State Water Resources Control Board.

3-03 REMOVALS AND TRENCH EXCAVATION

3-03.01 REMOVAL OF PAVEMENT

Asphalt concrete paving and concrete paving shall be saw cut prior to removal. All edges shall be as straight as possible. Contractor shall dispose the pavement off the work site to a permitted facility.

3-03.02 REMOVAL OF UTILITIES

Utilities shall be protected in place unless otherwise stated on the construction plans. Structures or piping not shown on the construction plan shall be brought to the attention of the Water Division. Disposition of these structures shall be determined by the Water Division prior to proceeding with the work.

The Contractor shall notify and coordinate with representatives of any Water Division which must be removed or relocated.

All abandoned piping, appurtenances, and/or facilities shall be removed and permanently disconnected from the system except where authorized by the Water Division.

3-03.03 TRENCH EXCAVATION

Trench excavation shall include any excavation in which the depth is greater than the width at the bottom of the excavation. Such excavations as required for vaults, thrust blocks, boring pits and service laterals shall be considered as trench excavations. All earthen material and water that will interfere with the placement of the pipe shall be removed. Contractor shall use sufficient means to protect any existing utilities from damage during trench excavation. Contractor shall also use Best Management Practices (BMP) to prevent silt, mud, or other pollutants from entering storm drains or catch basins as a result of trenching or excavating activities.

The maximum length of open trench shall be 500 feet or the length of pipe installed in one day, whichever is less. An open trench of up to 1,000 feet is permissible only in areas not subject to public traffic. The width of the trench at the bottom of the excavation shall not exceed 9 inches on either side of the pipe. Bell and coupling holes shall be used as required to complete a satisfactory pipe joint.

Water main installation will not be permitted until subgrade is established and the storm drain and sewer installation have been completed. Pipe shall be placed to the grade and depth specified on the construction plans. When not specified, pipe shall be placed as follows:

SECTION 3 CONSTRUCTION METHODS AND CONTROL

- a. 48-inch standard cover for pipes 10" and above to finish surface of primary and secondary streets (typically 64 feet right-of-way width and greater).
- b. 36-inch standard cover for pipes 8" and below to finished surface of collector and interior streets (typically less than 64 feet right-of-way width).
- c. 12-inch standard vertical clearance from any crossing Water Division or structure.
- d. 5-foot standard horizontal clearance from any Water Division, including recycled water mains, or structure, except sanitary sewers, which require a minimum horizontal separation of 10 feet (outside wall-to-outside wall).

In all cases pipe shall be installed so that there is a minimum of 24" cover between top of pipe and bottom of pavement structural section. In cases where the standard minimum cannot be achieved, engineered protection plans shall be submitted by Contractor and approved by the City. The minimum cover and clearance herein stated applies to construction where there are existing underground facilities. These minimums are not intended as "design minimums" where all new underground facilities or two or more conflicting facilities are installed at the same relative time. The design shall attempt to maximize clearance between conflicting facilities and provide standard cover as the minimum.

The trench bottom shall be graded to provide a smooth, firm, and stable foundation which is free of rocks and other obstructions. All soft, spongy, and unstable material shall be over-excavated and replaced with backfill material per Section 3-08 of these specifications, and compacted to provide a firm and stable foundation. All rocks or cobbles two inches or greater in any dimension shall be removed and replaced with compacted backfill material per Section 3-08 of these specifications.

Pavement repair for trench excavations shall be per City of Monterey Park Public Works Department Trench Replacement Standard Detail A-1 and Section 3-09 of these specifications.

3-04 CONNECTION TO EXISTING FACILITIES

3-04.01 GENERAL

The Contractor shall make connection to the existing public facilities as shown on the construction plans. All connections must be made under inspection of the Water Division. The Water Division Inspector will consider the means of chlorinating those sections of main, fittings, or valves in contact with the public system. When such connection provides a direct closure of valves between the existing public system and that under construction, such valves shall become the property of the Water Division and shall be operated only by the Water Division.

The connecting joints between existing pipe and existing valves are typically unknown. The Contractor shall expose all joints to confirm the existing piping is restrained prior to tying into existing piping with new piping or abandonment of existing pipe and valves from existing piping. The Contractor shall exercise due caution during tie-ins and abandonment work, including any temporary bracing until the Contractor has installed permanent restraints to all joint(s).

SECTION 3 CONSTRUCTION METHODS AND CONTROL

Permanent restraints shall follow the standard details W-140 , W-142, W-143 and W-144 or as called for by the Water Division after a field determination can be made. No work shall proceed until the Water Division approves the thrust restraint device(s) proposed by the Contractor.

3-04.02 PRESSURE TAPPING

Cast iron, ductile iron, PVC, PVCO, or asbestos cement pipe can be tapped under pressure by the Contractor. The exterior surface of the pipe shall be cleaned to provide a smooth surface for the tapping sleeve. The tapping sleeve shall be secured to the pipe to prevent movement during the tapping process. Prior to tapping operation, the tapping sleeve shall be hydrostatically tested for any leaks. It shall be tested to withstand 1.5 times the local static pressure, or 150 psi, whichever is greater. Concrete cylinder pipes shall be tapped under pressure by the Koppl Company (Montebello, California), International Flow Technologies, Inc. (Monterey Park, California), or approved Contractor. Tapping nozzles shall be bolted or welded on as determined by the Water Division based on steel cylinder thickness.

3-04.03 SHUTDOWN OF MAIN

All work necessary to shut down an existing public water main for the benefit of a Contractor shall be by Water Division personnel and shall require prior approval by the Water Division. Unless at the direct supervision of the Water Division Inspector, under no circumstances shall the Contractor operate valves, hydrants, and other appurtenant equipment on the existing public system. It shall be the Contractor's responsibility to coordinate the necessary shutdown schedules through the Water Division Inspector assigned to the project. Scheduled shutdowns shall require sufficient time to allow operations personnel to review, approve, and develop an appropriate Valve Operation Program.

All requests for shutdowns shall be in writing; verbal requests are not acceptable. Written requests shall be submitted a minimum of (10) ten City business days in advance of the desired date of shutdown. The Contractor shall be responsible for ensuring that all schedules are kept current and shall coordinate all deviations which may occur from time to time with the Water Division Inspector.

The Water Division will make a concerted effort to isolate the system as planned with the Contractor. However, the Contractor shall be prepared to employ pumping equipment to drain the water main trench if valves cannot completely shut down flow. The Water Division will not be responsible for any delays due to system shutdown and isolation.

All emergency situations shall be reported immediately to the Water Division's Water Services 24-hour emergency number (626) 705-7276. When extensive main shutdown is required, the Water Division will determine what temporary service connections may be required. The Contractor shall furnish all necessary hose, piping, valves, pumps, water trucks and associated labor required to provide such temporary service. All piping, hoses and associated equipment used in temporary service connections shall be flushed and disinfected in accordance with Section 3-10.

SECTION 3 CONSTRUCTION METHODS AND CONTROL

3-05 LAYING OF DUCTILE IRON PIPE WATER MAIN

3-05.01 GENERAL

Installations of pipes and fittings shall be in accordance with AWWA Standard C600, "Installation of Ductile-Iron Water Mains and Their Appurtenances" and the pipe manufacturer's installation manual. The DIPRA Publication "Guide for the Installation of Ductile Iron Water Mains" shall be used for details of pipe installation practice except as follows and where noted otherwise on plans. Maximum deflection of joints and/or minimum laying curvature shall not exceed 80% of manufacturer's recommendations.

All joints shall be restrained, unless otherwise indicated on the plans.

Line and grade of all water facility flow lines or center lines shall be installed within 0.1 foot tolerance of approved design and shall have a continuous positive or negative slope corresponding to the approved design slopes on the plans.

Water mains shall be installed to provide a 10-foot minimum horizontal separation between the outside wall of the water main and the outside wall of any sanitary sewer. In addition, installation shall comply with Standard Drawing W-130.

Every precaution shall be taken to prevent foreign material from entering the pipe while it is being placed in the trench. If the pipe-laying crew cannot put the pipe into the trench and in place without getting soil into it, the Water Division may require that before lowering the pipe into the trench, a temporary plug be placed over each end and left there until the connection is to be made to the adjacent pipe. During laying operations, no debris, tools, clothing or other materials shall be left in the pipe.

At times when pipe laying is not in progress, the open ends of pipe shall be closed by watertight plug or other means approved by the Water Division. This provision shall apply during the lunch-hour breaks as well as overnight. If water is in the trench, the plug shall remain in place until the trench is pumped completely dry.

The cutting of pipe for inserting tees, fittings or closure pieces shall be done in a neat workmanlike manner without damage to the pipe or cement lining and so as to leave a smooth end at right angles to the axis of the pipe. No pipe shall be laid in water or when, in the opinion of the Water Division Inspector, trench conditions are unsuitable. Field welding of Ductile Iron Pipe for repair or for joining is prohibited.

3-05.02 THRUST RESTRAINT

The Contractor shall be responsible for anchoring the pipe and fittings against movement due to water pressure. The materials specified in Section 2-12 will be used for restraining any movement of underground piping systems. Concrete thrust blocks shall be poured in place against an undisturbed earth bearing surface. Concrete shall be placed so as not to interfere with the fitting joint. Concrete shall be per Section 2-12.03. Thrust block locations and dimensions shall be per Standard Drawings W-140 through W-144, Section 6 of these specifications.

3-05.03 STANDARD ASSEMBLIES

Fire hydrants shall be constructed per Standard Drawing W-110, Section 6 of these

SECTION 3 CONSTRUCTION METHODS AND CONTROL

specifications.

Fire hydrants shall be placed at a location shown on the construction drawing or as directed by the Water Division Inspector. The determination will be based on specific locations which, in the opinion of the Water Division, could result in potential hazard from the fire hydrant being hit and broken, such as closeness to overhead power lines or water damage to property. Where required by the construction drawing, guard posts shall be installed per Standard Drawing W-115, Section 6 of these specifications.

Water valves shall be installed at locations shown on the construction drawing, or as directed by the Water Division Inspector. Valves shall be set plumb, and shall be stabilized and supported separately from the pipeline. Information regarding size, type, make, and number of turns to close shall be supplied to the Water Division by the Contractor in accordance with Section 2-13. All valves shall be covered with a valve box assembly. Valve boxes shall be plumb, centered over the valve nut, and supported separately from the valve body per Standard Drawings W-150 and W-151. Valve boxes shall be lowered to below paving grade level prior to street paving, and after final grade has been established, the valve boxes will then be raised to match final grade. In any event, Contractor shall ensure that all valve boxes will provide access to the operation of the valve by the Water Division. Valve boxes shall be flagged or barricaded during construction to divert traffic around their location.

3-05.04 PROTECTION AND CLEANING OF PIPE AND FITTINGS

The Contractor shall take extreme care to ensure cleanliness and protection of the inside coatings of all piping and fittings. The interior surfaces of pipes, fittings and other appurtenances shall be kept free of dirt or foreign matter at all times. All lumps, blisters, excess lining and coating materials shall be removed from the flanged end or bell and spigot end of each pipe or fittings. The outside of the spigot and the inside of the bell shall be wire brushed and wiped clean, and free from oil and grease before the pipe is laid.

3-05.05 HANDLING PIPE AND OTHER MATERIALS

Proper implements, tools and facilities satisfactory to the Engineer shall be provided and used by the Contractor for the safe and convenient prosecution of the work. All pipes, fittings and valves shall be carefully lowered into the trench in such a manner as to prevent damage to water main materials and protective coatings and linings. Under no circumstances shall water main materials be dropped or dumped into the trench.

3-05.06 PROTECTION OF METAL SURFACES

All buried metal surfaces shall be protected and coated as specified throughout Section 2. Should the protective coating system to the buried or above ground metal surfaces be damaged or compromised in any way, the Contractor shall repair the damaged coating/wrapping system to the satisfaction of the Water Division.

3-06 LAYING OF PVC AND PVCO PIPE WATER MAIN

Installations of pipe, bends, and fittings shall be in accordance with Section 2-08 for ductile iron bends and fittings, and the latest edition of AWWA C605 "Underground Installation of Polyvinyl

SECTION 3 CONSTRUCTION METHODS AND CONTROL

Chloride (PVC) and Molecular Oriented Polyvinyl Chloride (PVCO) Pressure Pipe and Fittings” and the pipe manufacturer's installation manual. PVC or PVCO bends and fittings are not allowed. The Uni-Bell Handbook of PVC Pipe-Design and Construction shall be used for details of pipe installation practice, except as follows and where noted otherwise on plans. Longitudinal bending of pipe sections is prohibited and deflection of PVC or PVCO pipe shall occur only at couplings per Section 2-02.03.

All joints shall be restrained, unless otherwise indicated on the construction plans.

The tracer wire and warning identification tape shall be installed per Standard Drawing W- 609. Tracer wire shall be secured to the pipe at 10-foot intervals with 10-mil plastic adhesive tape or plastic tie straps. The wire shall run continuously along the top of pipe for the entire length of pipe. Tracer wire, warning tape materials, and installation shall be per Section 2-02.05.

Service saddles are required for all corporation stops 2-inch diameter and less.

Point load set screws in retainer glands and flanges are prohibited, whereas those devices with pads or full circle are acceptable.

Water mains shall be installed to provide a 10-foot minimum separation between the outside wall of the water main and the outside wall of any sanitary sewer. In addition, installation shall comply with Standard Drawing W-130.

Every precaution shall be taken to prevent foreign material from entering the pipe while it is being placed in the trench. If the pipe-laying crew cannot put the pipe into the trench and in place without getting soil into it, the Water Division may require that before lowering the pipe into the trench, a temporary plug be placed over each end and left there until the connection is to be made to the adjacent pipe. During laying operations, no debris, tools, clothing or other materials shall be left in the pipe.

At times when pipe laying is not in progress, the open ends of pipe shall be closed by watertight plug or other means approved by the Water Division. This provision shall apply during the lunch-hour breaks as well as overnight. If water is in the trench, the plug shall remain in place until the trench is pumped completely dry.

The cutting of pipe for inserting tees, fittings or closure pieces shall be done in a neat workmanlike manner without damage to the pipe and so as to leave a smooth end at right angles to the axis of the pipe. The beveled end of any PVC or PVCO pipe shall be cut off before the pipe is inserted into a mechanical joint bend or fitting. No pipe shall be laid in water or when, in the opinion of the Water Division, trench conditions are unsuitable.

3-07 SERVICE LATERALS

3-07.01 GENERAL

One-inch and two-inch diameter service laterals shall be installed per Standard Drawing W-101 and W-102, respectively. The service lateral shall consist of the double strap service saddle with polywrap for ductile pipe per Section 3-11.03, insulated corporation stop, angle meter valve, meter, meter box and lid, and copper tubing. Service laterals shall be installed perpendicular to the centerline of the street and a three inch "plus" symbol will be chiseled into the curb face opposite the location of the corporation stop.

SECTION 3 CONSTRUCTION METHODS AND CONTROL

Meters and meter boxes shall be supplied and installed by the Contractor at such time and place as directed by the Water Division. Meter boxes located in areas subject to traffic loading, or located behind a rolled curb (Type F, Standard Detail No. 120, City of Monterey Park Department of Public Works), shall be installed with an approved traffic bearing lid.

Special consideration shall be given to backfill and compaction in the area adjacent to the copper tubing that is "snaked" in the trench. The area adjacent to the tubing shall be considered to extend not less than 4-inches below and 4- inches above the copper tubing and shall include the entire width of the trench. Bedding and backfill shall conform to Section 3-08 of these specifications. Backfill material shall be compacted under the service lateral so as to create a firm laying bed prior to placing and compacting any material over the top of the lateral. Compaction of backfill material by mechanical means directly over the exposed service tubing shall not be allowed.

Prior to any modification of service laterals 4-inches or larger and within 20-feet from the existing valve, the Contractor shall expose the valve on the service lateral to ensure the lateral including the valve is adequately restrained to the main pipeline. The exposed valve is to be witnessed by the Water Division for verification of restraint. Inadequately restrained valve shall be properly restrained by the Contractor per the City's direction.

The Water Division may require the Contractor to install an approved backflow protection device on all service connections in accordance with Section 5 of these specifications.

3-07.02 ABANDONMENT OF SERVICES

All existing active and inactive services not intended for reuse shall be abandoned or removed at the main as directed by Water Division Inspector. Services 2-inches and smaller shall be cut and plugged at the main and abandoned. For services 3-inch and larger, the existing tee or tapping sleeve shall be removed and replaced with a pipe spool connected to the existing water main with an approved coupling per Section 2-09.01. Capping of tees is allowed as approved by the City.

3-07.03 IRRIGATION SERVICES

Services installed for the primary purpose of providing irrigation of landscapes or commercial crops, and which may have booster pumps downstream of the meter, shall conform to the following requirements:

1. A hydraulically actuated, slow open/close valve shall be provided immediately downstream of the pump or a surge tank, properly sized and approved by the Water Division.
2. A Reduced Pressure Principle (RPP) type backflow preventer will be required immediately downstream of the flow meter. The irrigation service shall not be used until the RPP has been tested and a passing test report has been received by the Water Division Inspector (See Section 5-03).

SECTION 3 CONSTRUCTION METHODS AND CONTROL

3-08 INSTALLATION OF PIPE BEDDING, PIPE ZONE AND TRENCH BACKFILL

The following shall apply to Sections 3-05 and 3-06 above.

Bedding Zone

1. The Contractor shall import sand bedding material for placement in the bedding zone as defined in W-180 and as approved by the Water Division Inspector. All bedding material shall be compacted by hand or approved mechanical methods and as defined in W-180.
2. Unstable soil consisting of loose, soft, spongy, or organic earth encountered, shall be removed from the trench bottom to a depth determined in the field by the Water Division Inspector. The trench shall be refilled to proper grade with imported sand bedding material and tamped in place as defined in W-180. The trench bottom shall be graded flat and prepared to provide a firm and uniform bearing surface for the pipe.
3. Unyielding soil consisting of rock, rocky earth, or cemented earth encountered, shall be removed from the trench bottom to a minimum of 9-inches below grade. The trench shall be refilled to proper grade with imported sand bedding material and tamped in place as defined in W-180. The trench bottom shall be graded flat and prepared to provide a firm and uniform bearing surface for the pipe.
4. Bell holes shall be dug from the bedding such that the pipe barrel, first laid, shall uniformly bear on the bedding material.

Pipe Zone

1. The Contractor shall import sand bedding material for placement in the pipe zone as defined in W-180 and as approved by the Water Division Inspector. All pipe zone material shall be compacted by hand or approved mechanical methods.
2. Initial placement of pipe zone material shall be performed immediately after the pipe has been laid. Loose/moist pipe zone material shall be placed in the trench simultaneously on each side of the pipe to a depth not greater than the pipe centerline or 12-inches (loose measurement), whichever is less, and shall then be tamped beneath the pipe so that all voids are eliminated and the pipe zone material gets compacted as defined in W-180.
3. Subsequent placement of pipe zone material shall be performed immediately following initial pipe zone placement. Loose/moist backfill material shall continue to be placed in the trench simultaneously on each side of the pipe, not exceeding 12-inch thickness (loose measurement), with each placement tamped until the pipe has been covered by a minimum of 12-inches of well compacted material. Alternatively, the pipe zone material may be densified by jetting until the pipe has been covered by at least 12- inches of pipe zone material with compaction results as defined in W-180.

Backfill Zone

1. Backfill material shall be a free draining granular material, as defined in W-180 and be free of debris, organics, and cobbles greater than 2 inches. Native material to be used as backfill shall be allowed upon approval by the Public Works Department or designated representative.

SECTION 3 CONSTRUCTION METHODS AND CONTROL

2. All fittings, valves, Water Division crossings, and assemblies shall be visually inspected by the Water Division Inspector prior to backfilling.
3. The Contractor shall backfill the pipe trench as soon after placement of pipe as practical with due regard of the requirements in this Section.
4. All backfill for pipe or conduit shall be densified to a relative compaction as defined in W-180 by water densification, mechanical tampers or rollers or other mechanical means, as approved by the Water Division Inspector.
5. All buried valves and fittings shall be backfilled with clean sand. The sand shall be installed in such a manner that after compaction no earth or other backfill will be less than 6-inches from any part of the valve, fitting, flanges, bolts, or nuts. The sand shall be compacted as specified for other backfill.
6. Regardless of compaction/densification technique, care in backfilling shall be exercised to avoid any damage to pipe, fittings, appurtenances, persons, or property, and to achieve the minimum relative density compaction of the backfill material as defined in W-180.
7. At the close of the construction day, the pipe end(s) shall be sealed with a water tight, rodent-proof plug. The trench shall be backfilled.
8. Bedding zone, pipe zone, and backfill shall be placed in accordance with the Sections 306-6 of the "Standard Specifications for Public Works Construction" or as specified by the City Engineer and as supplemented herein.

3-09 REPAVING AND FINISHING

The Contractor shall replace all removed or damaged pavement in accordance with the City of Monterey Park Public Works Department Trench Replacement Standard Detail No. A-1. All pavement replacement, temporary or final, shall be hot-mix A.C. and as specified in the Plans or Specifications. The Contractor shall place pavement following final compaction of the backfill in accordance with Section 3-08 of these specifications.

Valve boxes shall be located after final paving and brought to finished grade.

3-10 TESTING, DISINFECTION AND FLUSHING

3-10.01 GENERAL

All required testing shall be performed and certified by a third party agency hired by the Contractor and approved by the Water Division. All tests shall be made in the presence of the Water Division Inspector, except that bacteriological tests shall be performed at laboratories certified by the State. All constructed facilities shall be isolated from the existing public system while being tested by means of a test plate or physical separation, as determined by the Water Division Inspector.

Hydrostatic pressure testing, disinfection, and bacteriological sampling is not permitted until the following conditions have been met:

SECTION 3 CONSTRUCTION METHODS AND CONTROL

For all development construction:

- 1) All curb and gutter on both sides of street must be poured and cured.
- 2) Rough grade of street must be established to within 12" of finished surface.
- 3) All sewer and storm drain improvements must be installed and completed.

For all water construction:

- 1) All services, fire hydrants, blow offs, and other appurtenances must be installed and adjusted to final grade.
- 2) All water valve boxes must be installed per W-150 and permanently accessible.
- 3) As-Built plans must be submitted by the contractor and approved by the Water Division Inspector. All field changes must be marked "As-Built" and documented in red ink on a clean set of plans.

At the discretion of the Water Division inspector, the Contractor may be required to provide a Mandatory Flushing Sign per W-060 during flushing and/or disposal of test water; and Contractor may be required to provide Test Set Up for Newly Installed Improvements per W-126 during testing.

All water used for flushing and testing purposes shall be measured through a Water Division temporary meter connected to a Water Division fire hydrant and paid for by the Contractor. Cross connection protection shall be accomplished by the Contractor by providing a reduced pressure principle backflow prevention device with a passing test report approved by a Water Division Cross Connection Specialist. At the discretion of the Water Division Inspector, the Contractor may be required to dispose of flushing and/or test water in the sewer system.

It is the sole responsibility of the Contractor to install water mains and appurtenances that pass the testing phase. Water Division assistance through inspection, testing, and receipt of laboratory test results does not relieve the Contractor of this responsibility.

3-10.02 HYDROSTATIC PRESSURE TESTING

After all thrust blocks have been placed for at least two days in the particular portion to be tested, a pressure test shall be conducted by a hydrostatic testing agency hired by the Contractor and approved by the Water Division. Each section of main, up to but not exceeding 1,200 feet in length, and all fire hydrants and fittings connected thereto, shall be subjected to a hydrostatic pressure in accordance with AWWA Standard C600 (ductile iron) or C605 (PVC and PVCO) and as modified herein, while all pipe, fittings and joints are inspected for leakage. Test pressure shall not exceed rated working pressure of the gate or butterfly valves. The section of pipe under test shall be allowed to stand at 40 psi minimum pressure for one (1) hour prior to the beginning of the test. The pressure shall then be increased to 1.5 times the local static pressure, or 150 psi, whichever is greater, to a maximum of 300 psi. Pressure shall be measured at, or corrected to, the lowest point in the portion of the line being tested. After the entire section under test has been inspected and if leaks have been found to be within tolerance of allowable leakage per thousand feet of pipe shown in the chart below, the pressure test will be approved by the Water Division Inspector. If leakage exceeds allowable tolerances, the source(s) of leakage shall be identified and repaired and re-subjected to the test pressure. The pressure shall be maintained for four (4) hours, during which time the amount of leakage

SECTION 3 CONSTRUCTION METHODS AND CONTROL

shall be determined by measuring the quantity of water which must be added to maintain the test pressure.

If at any time during the test, leakage exceeds 5 psi below testing pressure, testing shall be paused and pressure shall be brought back up to set testing pressure. Water that is used to return to set testing pressure shall be recorded to be used against allowable leakage.

No leakage shall be allowed for steel pipe.

The following table lists the maximum allowable leakage per 1,000 feet of pipe, in gallons per hour, in conformance with AWWA Standard C600 and C605:

Maximum Allowable Leakage per 1,000 feet of Pipe, Gallons per Hour								
Static Pressure, psi	Test Pressure, psi	Nominal Pipe Diameter, in.						
		4	6	8	10	12	16	18
100 or less	150	0.33	0.50	0.66	0.83	0.99	1.32	1.49
110	165	0.35	0.52	0.69	0.87	1.04	1.39	1.56
120	180	0.36	0.54	0.73	0.91	1.09	1.45	1.63
130	195	0.38	0.57	0.75	0.94	1.13	1.51	1.70
140	210	0.39	0.59	0.78	0.98	1.17	1.57	1.76
150	225	0.41	0.61	0.81	1.01	1.22	1.62	1.82
160	240	0.42	0.63	0.84	1.05	1.26	1.67	1.88
170	255	0.43	0.65	0.86	1.08	1.29	1.73	1.94
180	270	0.44	0.67	0.89	1.11	1.33	1.78	2.00
190	285	0.46	0.68	0.91	1.14	1.37	1.83	2.05
200	300	0.47	0.70	0.94	1.17	1.40	1.87	2.11

If the pipeline under test contains sections of various diameters, the allowable leakage will be the sum of the computed leakage for each size.

The following formula shall be used to determine allowable leakage for other test pressures:

$$L = \frac{SD\sqrt{P}}{148,000}$$

Where:

L = testing allowance (makeup water), in gallons per hour

S = length of pipe tested, in feet

D = nominal diameter of the pipe, in inches

P = average test pressure during the hydrostatic test, in pounds per square inch

SECTION 3 CONSTRUCTION METHODS AND CONTROL

3-10.03 DISINFECTION

3-10.03.1 GENERAL

All water mains, water services, attached appurtenances and connections shall be disinfected in accordance with AWWA Standard C651 "Disinfecting Water Mains", and as modified herein.

Contractor shall furnish all equipment, labor, materials, safety requirements, and water necessary for chlorinating and flushing the pipeline. Disinfection of new mains, including all chlorination, chlorine residual measurements, collection of samples, and certification shall be conducted by a third party testing agency approved by the City. Gauges and apparatus used for chlorine injection shall bear the current State certification. An independent State Certified laboratory or authorized agent shall collect the samples and a State Certified laboratory shall perform the bacteriological tests. All costs for disinfection, including laboratory fees, shall be paid by the Contractor.

At no time shall personnel other than the authorized third party testing agency be in charge of injecting chlorine into the water pipeline, the residual testing of the chlorine, or obtaining bacteriological samples.

Contractor shall ensure that all pipes, fittings, and appurtenances are kept free from dirt and foreign matter at all times. During construction all open pipe ends and fittings shall be fitted with a water tight plug. At the end of the work day the open pipe in the trench shall be plugged in an equally suitable manner.

The Contractor shall swab the interior surfaces of the new valves, pipes and appurtenances as well as interior surfaces of existing main, both upstream and downstream of the new pipe section, with a minimum five percent concentration of hypochlorite disinfection solution before installation. During the chlorination or chlorinating process, all valves shall be operated, and the chlorine solution shall be drawn through all laterals and appurtenances. Disinfection of mains and appurtenances, hydrostatic testing, and chlorine retention may will not run concurrently for the required minimum 24-hour period.

In the event of leakage or where repairs are necessary, added disinfection shall be made only by injecting chlorine into the line whereby adequate mixing is assured. If the test results are not satisfactory, the Contractor shall provide additional disinfection, as required. Such additional disinfection shall be at the Contractor's expense.

Disinfection of pipelines 4-inch or larger and in excess of 18-feet in length shall be accomplished by direct liquid chlorine or chlorine gas as specified herein, unless otherwise approved by the Engineer.

3-10.03.2 CHLORINATION

The new system which is being disinfected shall be thoroughly pre-flushed, utilizing a minimum velocity of 2.5 feet per second throughout the entire system. The chlorinating agent shall be applied at a point not more than ten

SECTION 3 CONSTRUCTION METHODS AND CONTROL

feet from the beginning of the section to be chlorinated and shall be injected through a corporation stop, a hydrant, or other approved connection to ensure treatment of the entire system being disinfected. All required corporation stops and other plumbing materials necessary for chlorination or flushing of all parts of the main being disinfected shall be installed by and at the expense of the Contractor.

3-10.03.2.1 CHLORINE GAS FEED

Chlorine gas shall be fed directly from the chlorine cylinder equipped with a suitable device capable of regulating the rate of flow and diffusion of gas within the pipe. Water shall be concurrently fed into the pipe at a rate which produces a residual of not less than 100 (parts per million) PPM and not to exceed 125 PPM of chlorine in all sections of the pipeline and appurtenances being disinfected. Chlorinated water shall be retained in the system for a minimum duration of 24 hours, and shall produce at the end of the retention period not more than 50% difference from initial dosage of chlorine in all sections of the pipeline being disinfected.

3-10.03.2.2 SODIUM HYPOCHLORITE FEED

Sodium hypochlorite shall conform to the requirements of AWWA B300 and shall be delivered by chemical feed pump at a constant concentration of a minimum of 100 PPM of free chlorine until the new pipe system is completely filled. The chlorinated water shall remain in the new pipe section, full, for a period of 24-hours during which time new valves and fire hydrants shall be exercised to ensure complete coverage of internal parts. At the conclusion of the 24-hour period, the chlorinated water concentration shall have a minimum concentration of more than 50% difference from initial dosage of free chlorine. Source water shall be protected by an approved backflow device approved by the Water Division Inspector.

3-10.03.3 FINAL FLUSHING

Following the chlorination period of 24 hours, the newly laid line shall be thoroughly flushed to remove any foreign material. A suitable connection shall be provided by the Contractor at the end of each new line at the invert large enough to achieve a flushing velocity in the line of at least 5 feet per second.

Water shall be flushed from the line at its extremities and at all outlets until the chlorine residual of the water system being flushed is equal to or less than the distribution system level. Flush water shall be dechlorinated per Section 3-10.6.

3-10.03.4 BACTERIOLOGICAL TESTS

After the system has been flushed, the Contractor shall have tests conducted

SECTION 3 CONSTRUCTION METHODS AND CONTROL

for chlorine residual by a State certified laboratory approved by the Water Division. Should the chlorine residual in any part of the disinfected system be higher than the distribution system level, the Contractor shall repeat the flushing procedure. If the chlorine residual after flushing is equivalent to or less than the distribution system level, the Contractor may proceed with the bacteriological sampling. Samples shall be taken at the direction and in the presence of the Water Division Inspector with at least two sets of samples collected at: (1) 1,200-foot intervals along the new water main, (2) each dead-end main section(s), and (3) all branches 4-inch diameter and larger. Two consecutive bacteriological samples are required for water quality evaluation. The first bacteriological sample shall be taken immediately after final flushing and the second sample shall be taken at least 24 hours later. If bacteriological test results fail to pass the requirements, the Contractor shall take corrective actions and daily bacteriological sampling shall be continued until two (2) consecutive negative samples are demonstrated. All samples shall be collected by certified laboratory personnel and tested for bacteriological quality in accordance with Standard Methods for the Examination of Water and Wastewater, and shall show the absence of coliform organisms.

The following tests are required to provide information for water quality evaluation:

- 1) Presence/Absence of Total Coliform by any of the three methods:
 - a. Multiple Tube Fermentation
 - b. Membrane Filtration
 - c. Coliliter/Colisure
- 2) Heterotrophic Plate Count. Report shall include:
 - a. Presence/Absence of Coliform Bacteria Count per 100 ml.
 - b. Heterotrophic Plate Count per ml.
 - c. Total and Free Chlorine Residual, taken at time of sample collection by certified laboratory personnel.

All coliform test results must be negative. The heterotrophic plate count shall be 500 or less per ml.

The results of these tests must be approved in writing by the Water Division's inspection supervisor prior to activating any new water facilities. Should the test results from the State certified laboratory disclose that the water from the new line does not meet the above standards, the disinfection process shall be repeated until it meets the required standards.

3-10.03.5 MISCELLANEOUS DISINFECTION AND TESTING PROTOCOL

New installations of large services (fire lines or domestic), fire hydrants, and water mains greater than 18-feet in length shall have a physical separation by means of a test plate or end cap with a temporary blow off from the existing city water main. The newly installed portion shall be third party tested, thoroughly flushed, and chlorinated per Section 3-10.

SECTION 3 CONSTRUCTION METHODS AND CONTROL

Large services and fire hydrants require one sample per day on two consecutive days, which shall be taken by a State certified laboratory approved by the Water Division.

Water mains that are greater than 18-feet in length require sampling in accordance with Section 3-10.03.4. A minimum of two samples per day on two consecutive days will be required for: (1) every 1,200 feet of main, (2) each dead end main section(s), and (3) all branches 4 inch diameter and larger.

The physical separation (test plates or end cap with temporary blow off) will not be allowed to be removed and connection to existing City water line shall not occur until the Water Division Inspection Supervisor has approved the certified passing bacteriological sample results that the Contractor has forwarded. The certified results must be received by the Water Division Inspection Supervisor within five calendar days of taking of the sample(s). Draft copies are not acceptable.

Relocation and/or extension of large water services, fire hydrants, or backflow devices, all less than 18-feet in length, shall be accomplished as follows: (1) the work shall be performed under full-time inspection, (2) all parts shall be swabbed and sprayed with an approved disinfectant, (3) the relocation or extension shall be bolted up and completed to grade and (4) the fittings/pipe will be inspected for leaks and where questionable, shall be thoroughly flushed and adjusted to a water tight condition. The Contractor shall immediately schedule one single bacteriological sample to be taken by a State certified laboratory. The certified bacteriological sample report shall be sent to Water Division's water quality supervisor and water inspection supervisor for approval. The certified results must be sent to the Water Division's within five calendar days from when the sample has been taken.

Sampling of small water services (1 inch and 2 inch) is not required, provided that new materials are used, installation is under full-time inspection, and the service is thoroughly flushed.

3-10.04 DISPOSAL OF TEST WATER

All water used for testing and/or disinfecting portions of pipeline or water system components, including that used for retesting, shall be disposed of following such testing, retesting, and disinfecting by the Contractor at his sole expense. The disposal of water shall, in all cases, be carried out in compliance with the water quality objectives and discharge permit restrictions established by State requirements. In no event may the water discharged transport trash, dirt or other debris into the Right of Way, adjacent property, or into the private or public storm drain system.

The contractor shall not discharge any wastewater from the site to the right of way, adjacent property or any storm drain system (private or public) unless it conforms to all applicable requirements, permits and restrictions. This will include complying with at least one or more of the following:

- The discharge is described in an Erosion & Sediment Control Plan approved by the Monterey Park Public Works Department as part of a Encroachment Permit and/or a

SECTION 3 CONSTRUCTION METHODS AND CONTROL

Grading Permit); and

- The discharge is allowed by a valid National Pollutant Discharge Elimination System (NPDES) permit.

If the project is over one acre or meets the linear project requirement, the discharge must be described in a Stormwater Pollution Prevention Plan (SWPPP) approved by the State Water Resources Control Board.

Any discharge (whether or not a SWPPP is required) must conform to applicable Best Management Practices (BMPs) relative to the type of work and phase of construction. Water system discharges shall also comply with the latest edition of the American Water Works Association California-Nevada Section *Best Management Practices (BMP) for Drinking Water System Releases*, available at: <https://www.ca-nv-awwa.org/canv/CNS/Communications/Publications.aspx>.

Contractors conducting municipal water system work for the Water Division shall comply with the *Statewide General NPDES Permit for Drinking Water System Discharges to Waters of the United States*, Order WQ 2014-0194-DWQ, available at https://www.waterboards.ca.gov/water_issues/programs/npdes/drinkingwatersystems.html). The Contractor is responsible for all activities required by the permit, including recordkeeping, sampling, and implementing appropriate BMPs. The Contractor shall notify the Water Division Inspector at least 7 days prior to commencing a discharge in excess of 1 acre-foot, and immediately upon being aware of any non-compliance of any portion of the permit.

For projects not administered by the City (such as developer projects), the Contractor shall obtain coverage under another NPDES permit, such as the General Waste Discharge Requirements for Discharges to Surface Waters that Pose an Insignificant (De Minimis) Threat to Water Quality, Order No. R4-2019-0004, available at: https://www.waterboards.ca.gov/santaana/board_decisions/adopted_orders/orders/2015/R8-2015-0004_Updated_General_WDR_for_Discharges_to_Surface_Waters_that_Pose_an_Insignificant_Deminimis_Threat_to_WQ2.pdf. Other NPDES permits may be applicable.

Disposal of test water or chlorinated water used for disinfection will require the Contractor to apply a reducing agent (i.e. sodium thiosulfate) in order to neutralize residual chlorine or chloramine to meet the discharge limitation. The discharge shall be tested by use of an electronic colorimeter to verify it has been adequately dechlorinated and the results provided to the Water Division Inspector. Additionally, the flow of water from the portions of pipeline shall be controlled to prevent erosion of surrounding soil, damage to vegetation, and altering of ecological conditions in the area and shall not contribute to silt, mud, debris, or other contaminants entering storm drains or surface waters.

The Contractor's attention is directed to that portion of the pipe with a low elevation. All water used in testing and disinfecting in that portion of the pipe shall be pumped out by the Contractor, at his expense, as specified in the paragraph hereinbefore. The Contractor shall furnish and operate all necessary pumps, pipelines, valves, hoses and all other appurtenances needed for pumping out water from the said low portion.

At the discretion of the Water Division Inspector, the Contractor may be required to

SECTION 3 CONSTRUCTION METHODS AND CONTROL

dispose of test water in the sewer system.

3-11 SPECIAL CONDITIONS

3-11.01 SHEETING AND SHORING

All trench excavation shall be adequately protected to provide a safe working condition, and protection to adjacent facilities and structures. The Contractor shall work in such a manner and install such protective devices, shoring, and bracing to comply with all rules, regulations, and orders of CAL-OSHA, Division of Industrial Safety.

Prior to any trench excavation where the depth is more than five feet, the Contractor shall submit a detailed plan to the Water Division showing the design of shoring, bracing, sloping, or other provisions to protect the workers from the hazard of caving ground during the excavation of such trench. If the plan varies from the shoring system standards, the plan shall be prepared by a Civil or Structural Engineer registered in the State of California. No excavation shall start until the Water Division has accepted the plan and the Contractor has obtained a permit from CAL-OSHA, Division of Industrial Safety. A copy of the permit shall be submitted to the Water Division and available at the job site at all times.

Sheeting and shoring shall not place any undue strain on existing utilities or structures, nor on completed sections of construction. Sheeting and shoring may be removed during backfilling, provided adequate protection is provided at all times. The Contractor shall be responsible for any damage to existing utilities or structures due to placement, removal, or failure of any sheeting and/or shoring system. The Contractor shall repair or have repaired any damage as soon as practical.

3-11.02 JACKING OF STEEL CASING

Steel casing shall be placed at the location, elevations, and limits shown on the construction plans. Known existing utilities shall be shown on the construction plans. Any utilities or structures encountered which will interfere with construction shall be brought to the attention of the Water Division. Only new steel casing shall be used for jacking. Jacking shall be at a rate that will not over stress the casing, causing failure. Any damage to the casing during placement of the pipe shall be brought to the attention of the Water Division. The jacking and receiving pit shall be sheeted and shored as required by CAL-OSHA and as provided in Section 3-11.01 of these specifications. The excavated area ahead of the casing shall not be larger than 0.1 foot greater than the outside diameter of the casing. Over excavation beyond the above described limits shall be sanded or pressure grouted as directed by the Water Division. Sluicing or jetting ahead of the jacking casing shall not be permitted.

3-11.03 POLYETHYLENE PROTECTIVE WRAPPING

Unless otherwise noted on the plans, polyethylene protective wrapping (Polywrap) for ductile iron pipe shall be furnished and installed on all buried water lines in accordance with the requirements of AWWA C105, Section 2-01.04 of these specifications, and as specified herein, except where water lines are within a steel casing pipe. Polywrap shall be installed so as to prevent any section of the pipe, fittings, valves, services, or appurtenances from contacting the soil.

SECTION 3 CONSTRUCTION METHODS AND CONTROL

The Polywrap shall be taped to provide a snug fit along the pipe. Minimum tubing size shall allow for an overlap of 12 inches; i.e., flat tube width in inches = $(3.14 \times \text{outside diameter}) + 12$ inches. An additional 3 layer wrap of polyethylene shall be made at all tapping locations a minimum of 12 inches in width. Openings for service taps, blow offs, or similar appurtenances shall be cut in the Polywrap during backfilling of the trench.

Any punctures, tears or other damage shall be patched with polyethylene wrap and tape in accordance with the requirements of AWWA C105 and manufacturer's instructions. Rocks or other material that could damage the wrapping shall not be included in the backfill.

3-12 DEDICATION OF IMPROVEMENTS TO THE CITY

The Water Division may serve temporary construction water through facilities installed by the Contractor. This use shall be permitted following written confirmations from the State certified laboratory conducting bacteriological tests that all samples meet the requirements of the Water Division and from the Water Division. This use does not constitute acceptance of these facilities by the Water Division.

Only after the following items are received will the Water Division accept facilities installed by the Contractor.

1. Written confirmation from the State certified laboratory conducting bacteriological tests that all samples meet the requirements of the Water Division.
2. Confirmation by the Water Division that all water improvements have been constructed per applicable specifications and plans. Contractor shall be responsible to maintain accurate records of any changes made during the course of construction and shall submit such information to the Water Division per section 3-13 below.
3. Public Water Division Easements dedicated to the Water Division, as required to gain access to public water facilities located on private property.
4. Such agreements, fees, or other items as required by the Water Division.
5. All backflow prevention devices have been tested, found to be acceptable through the testing, and passing test reports have been received by the Water Division's cross connection control program.

Prior to serving domestic water through the installed facilities, the Developer shall present all deeds or instruments of conveyance to the Water Division and shall dedicate all water system improvements intended for public use to the City.

The Contractor shall warrant the quality of all material and workmanship for a period of one year from the date of acceptance of these facilities by the City. The Contractor shall make all repairs to facilities due to defect in material or construction method. Such repair shall not be the responsibility of the Water Division. If the Water Division should deem the repair of such defective work an emergency situation, the Contractor shall be held liable for all costs required to correct such defective work.

SECTION 3 CONSTRUCTION METHODS AND CONTROL

3-13 AS-BUILT DRAWINGS

The Contractor shall provide and maintain a complete, legible, and accurate As-Built record set of prints. Such prints shall be kept up to date as work progresses and shall be maintained at the job site during construction. Progress payments for City of Monterey Park projects will not be processed until the As-Built drawings are reviewed and approved by the Water Division.

As-Built drawings shall be prepared and shall show all changes in the work constituting deviations from the original contract drawings. All conceptual or major design changes shall be approved by the Water Division before implementing the change in the construction contract.

Upon completion of the work, all required information, dimensions and adjustments to the original contract drawings shall be submitted to the Water Division to be transferred to the record drawings. Facilities and items to be located and verified on the record drawings shall include the following:

- a. Point of connections.
- b. Actual location of existing Water Division mains (water, sewer, gas, storm drain) and encased electrical conduit banks crossing the water main.
- c. Actual location of existing water, sewer and gas service laterals and communications conduit only when there is a conflict which requires a vertical and/or horizontal alignment change of the water main to be installed.
- d. Water mains: where deviations along installed water mains are more than ½ foot vertically and more than 1 foot horizontally, actual location (line and grade) shall be noted on the plans at intervals of 100 feet.
- e. Services: where service tie-in differs from the plan station by more than 2 feet or when meter box is not perpendicular from the main, corporation stops shall be stationed. For all service lines that have directional changes, such as in the case of cul-de-sacs, the actual installation shall be noted regardless of field changes, and shall be adequately referenced to the satisfaction of the Water Division Inspector.
- f. Any material changes, including additions, deletions and substitutions.
- g. Other related facilities, as required by the Water Division Inspector
- h. Contractor shall write on all sheets where the water improvements were built per plan that the construction was made "Per Plan."

The Water Division's receipt and acceptance of As-Built drawings shall be a condition precedent to the release of the Contractor's retention/final payment. For projects constructed by Developers, the Water Division will not give final acceptance until approved "as-built" plans have been received.

SECTION 4 LARGE SERVICES AND FIRE LINES

4-00 GENERAL

All services larger than 2 inches in diameter installed for the purpose of obtaining water from the public system for domestic, irrigation, commercial or industrial consumption, or for fire protection shall be defined as Large Services. Large services installed for the purpose of providing fire protection only shall be further defined as Fire Lines.

Unless otherwise specified on the plans approved by the Water Division, all materials, construction methods and controls shall conform to the applicable sections of the Water Services Standard Specifications (WSSS), which this section is a part thereof, including, but not limited to, testing, disinfection and flushing.

Developers and Private Engineers responsible for design and construction of Large Services in conjunction with development of property shall refer be per the approved Utilities Plan.

4-01 METERS

Separate water services for domestic water and fire protection shall be installed. In addition, if a non-residential project's landscaping area is 1,000 square feet or larger, a separate irrigation meter shall be required. If a residential project's landscaping area is 2,500 square feet or larger, a separate irrigation meter shall be required. All Large Service installations shall include a meter assembly which may be located outside of the public right of way on private property. Meters shall conform to size, type and manufacturer as shown on the Standard Drawings. The Water Division reserves the right to specify the type of meter if, in its sole opinion, a specific type of meter is best suited for the proposed application. Meters shall be provided with direct reading or electronic registers to provide visual reading capability, a leak indication dial, and shall read in cubic feet. Meters shall be provided with a lid on the registers for protection against sunlight for above ground installations

Minimum registration shall be as follows for the meter sizes stated:

2 to 3 inch meters	CF X 10
4 to 8 inch meters	CF X 100
10 inch and greater	CF X 1,000

All Large Service installations, except Fire Lines, shall include provisions for a spool to be installed prior to any meter maintenance. All valves and fittings on the bypass line shall be flanged and shall conform to Sections 2-05 and 2-08 of these specifications, respectively.

The Water Division at its sole discretion, may require the bypass line to have outside stem and yoke (OS&Y) valves with handwheel operators and a permanent bypass spool. When OS&Y gate valves and spools are required by the Water Division on the bypass line, the hand wheel operators shall be secured in the closed position by a lock and chain.

Theft protection shall be provided for bypass meters on double check detector assemblies (DCDA). Approved anti-theft devices are Sentry Fire Detector Check Bypass Backflow Guard SDC75 or equal. All anti-theft devices shall be submitted to the Water Division for review and approval prior to installation.

SECTION 4 LARGE SERVICES AND FIRE LINES

4-02 VAULT INSTALLATIONS

All Large Services shall be installed in a precast concrete polymer vault with an aluminum cover or as otherwise specified on the construction plans. The dimensions of the vault, location of knock-out sections and the cover details shall be in strict conformance with this section and the application Detail Drawings contained in Section 6 of these specifications or as otherwise specified on the construction plans.

The vault cover shall consist of one or two doors in one channel frame and shall open over the entire length and width of the vault. Door leaf shall be 1/4-inch aluminum diamond pattern plate to withstand a live load of 300 pounds per square foot. Channel frame shall be 1/4-inch aluminum. Door shall be equipped with heavy forged brass hinges, stainless steel pins, spring operators for easy operation, and an automatic hold open arm with release handle. A snap lock with removable handle shall be provided. Unless noted otherwise on the plans, hardware shall be mill finish with bituminous coating applied to the exterior of the frame. Stainless steel hardware may be required for installations in a highly corrosive environment. Manufacturer shall guarantee against defects in material and workmanship for a period of at least five years.

All vaults installed in areas subject to incidental vehicular traffic shall be steel reinforced concrete with an aluminum cover designed to meet a minimum traffic bridge loading of H- 20, as defined by the American Association of State Highway Officials. As to type, materials, and hardware, traffic covers shall conform to the requirements specified in the preceding paragraph. In certain situations, guard posts may be required to prevent vehicular traffic from passing over the vault.

When vaults are installed in areas subject to pedestrian traffic, the cover shall consist of non-skid materials as approved by the Engineer.

4-03 THRUST RESTRAINT - VAULT INSTALLATION

A positive means of thrust restraint shall be provided on the inlet line to a vault installation so that the pipe at the last joint, prior to entering the vault, is physically restrained from movement in the direction of the vault. See Standard Plan W-143.

4-04 PAINTING - ABOVE GROUND INSTALLATIONS

After all testing and disinfection has passed, but prior to final acceptance by the Water Division, all above ground Large Service installations shall be painted in accordance with Section 2-14.

SECTION 5 **BACKFLOW PREVENTION**

5-01 **BACKFLOW PROTECTION**

All water services connected to the public water system may be required to include an approved backflow prevention device of the type designated by the Water Division. The type of device approved shall be based on the existing or potential degree or hazard which exists, in the opinion of the Water Division. All devices shall be approved by the Foundation for Cross-Connection Control and Hydraulic Research, University of Southern California, Los Angeles, CA 90089-2531. All domestic backflow prevention devices shall be lead-free per California Health and Safety Code.

The Developer or his Contractor shall be responsible for the installation, initial test and certification of all new or relocated backflow prevention devices. Thereafter, backflow prevention devices will be maintained and tested annually by the owner or water user.

When an existing backflow prevention device that is located in a vault or in public right-of-way needs to be replaced, the property owner shall be required to install the new device above ground on private property. Unless otherwise approved by the Water Division, the entire section of piping between the water main and the new device shall be replaced with new pipe. In addition, design plans for the new device, and accompanying plan check and inspection fees shall be submitted to the Water Division for review and approval in accordance with Section 4 of these specifications.

Backflow prevention devices shall be located above ground, outside of the ultimate right-of-way and as close as practical to the meter. The ultimate right-of-way shall be determined by Public Works Development Services which is in accordance with the Circulation Element of the General Plan, applicable Specific Plan or Precise Alignments approved by the City Engineer. Location shall be subject to approval by the Water Division and the City of Monterey Park's Planning Department.

The backflow prevention device shall be painted in accordance with Sections 2-14 and 4-05, and shall be installed in conformance with the applicable Standard Drawings of these Specifications.

5-01.01 APPROVED MANUFACTURERS

Any backflow prevention devices approved by the Foundation for Cross-Connection Control and Hydraulic Research, University of Southern California, Los Angeles, CA 90089-2531, as shown on the latest edition of "List of Approved Backflow Prevention Assemblies". The current list is available at the Foundation's website at <https://fccchr.usc.edu/list.html>.

5-02 **FIRE LINE ASSEMBLY**

All fire line assemblies shall require a detector meter and backflow protection as may be determined by the Water Division. All fire lines shall be installed in conformance with Section 6 of these Specifications. Vault installation of fire line assemblies is prohibited.

For assemblies that require a detector meter, the meter shall be 5/8 or 3/4 inch nominal size with bronze case and shall have a straight read magnetic drive register capable of detecting increments of consumptive use in one cubic foot increments

5-03 BACKFLOW PREVENTION DEVICES – TESTING AND MAINTENANCE

Backflow preventers shall be tested immediately after they are installed, relocated or repaired and not placed in service until they are functioning as required. Backflow preventers shall be tested by persons who have demonstrated their competency, are approved by the Water Division's Cross Connection Control Program, and hold a current City of Monterey Park Business License.

Backflow preventers shall be tested at least annually or more frequently, if determined to be necessary by the Los Angeles County Department of Public Health or the Water Division's Cross Connection Control Program. When devices are found to be defective, they shall be repaired or replaced by the owner. Reports of testing and maintenance shall be kept by the owner for a minimum of three years.

5-04 SINGLE CHECK DETECTOR ASSEMBLY

- Single check detector assembly will phase out in 10 years.
- Any repair/modification/maintenance will require the removal of the assembly and the correct protection shall be installed

SECTION 6 STANDARD DRAWINGS

GENERAL DISTRIBUTION SYSTEM CONSTRUCTION

W-050	Standard Project Sign
W-060	Mandatory Flushing Sign
W-101	1 Inch Water Service Installation
W-102	2 Inch Water Service Installation
W-103	3/4 Inch through 2 Inch Double Check Backflow Prevention Assembly
W-104	3/4 Inch through 2 Inch Reduced Pressure Principle Backflow Prevention Assembly
W-105	Typical 3/4 Inch through 2 Inch Domestic/Fire Protection Residential Backflow Installation
W-106	2 1/2" Temporary Water Service
W-110	Standard Fire Hydrant Installation
W-115	Water Facility Guard Posts
W-121	2" Blowoff Assembly (Non-Traffic Bearing)
W-122	2" Blowoff Assembly (Traffic Bearing)
W-124	4" Blowoff
W-126	Test Set Up for Newly Installed Improvements
W-130	Water and Sewer Separation Requirements
W-131	Water Minimum Separation from Other Utilities
W-132	Typical Casing Detail
W-138	Restraint of Joints for DIP and PVC at 90-Degree Vertical or Horizontal Bend
W-139	Restraint of Joints for DIP and PVC at a Dead End or Each Side of Valve
W-140	Typical Thrust Block Details (4" To 16" Dia. Fitting)
W-142	Thrust Block Area Requirements
W-143	Anchor Block Assembly for 6" Through 16" Pipe
W-144	Gravity Anchor Block Detail
W-150	Standard Valve Box Assembly
W-151	Valve Box and Stem Extension
W-152	Valve Box Raising
W-154	Water Main Connection at Intersections and Valve Markers
W-155	Valve Can Cover Code Chart
W-160	1" Air Release / Air-Vacuum / Combination-Air Valve Assembly
W-170	Water Main Offset/Siphon
W-180	Water Pipe Bedding Detail

LARGE SERVICES AND FIRE LINES


W-201	Large Meter and Fire Line Lateral Installation
W-203	Standard Meter Vault Installation
W-204	7-Inch x 14-Inch Hinged Reading Lid
W-205	Typical Manifold 4-10 Services
W-210	Pressure Regulating Vaults
W-220	Double Check Detector Assembly – Fire Line Only
W-221	Reduced Pressure Principle Detector Assembly – Fire Line Only
W-221A	Reduced Pressure Principle Type Assembly for Large Services – Excluding Fire Lines
W-222	Compact Backflow Prevention Assembly – For Fire Line Only
W-222A	Compact Backflow Prevention Assembly for Large Services – Excluding Fire Lines
W-229	Combination Meter and Backflow Prevention Device Above Ground

	Assembly
W-230	3 Inch, 4 Inch and 6 Inch Compound Meter Vault Assembly
W-230A	3 Inch, 4 Inch and 6 Inch Compound Meter Above Ground Assembly
W-250	3", 4" and 6" Irrigation Meter Vault Assembly
W-250A	3", 4" and 6" Irrigation Meter Above Ground Assembly
W-270	Adjustable Pipe Support
W-271	Adjustable Pipe Support w/ U-Bolt

MISCELLANEOUS DETAILS

W-601	Air Vent for U.G. Structures
W-605	Valve Installation on Existing Steel Pipe (CCP)
W-607	Water Sampling Station
W-608	Retaining Wall for Fire Hydrant and Other Water Appurtenances
W-609	Warning Identification Tape and Tracer Wire Installation for PVC and PVC Pipe
W-610	Insulating Blanket
W-630	Destruction of Abandoned Water

LIST OF MATERIAL					
ITEM	DESCRIPTION	FORD	JONES	MUELLER	A.Y. MCDONALD
1	DOUBLE STRAP SERVICE SADDLE	202B	J-979	BR2B SERIES	3825
1a	DOUBLE STRAP SERVICE SADDLE (SEE NOTE 5)	202BS	J-969	BR2S SERIES	3855
2	CORPORATION STOP, 1" (INSULATED)	-	E-1999SG	N-35008N	-
2a	CORPORATION STOP, 1" (REGULAR)	FB1000-4-G-NL	E-1937	P-25008N	74701B-22
3	ANGLE METER STOP, 1"	BA42-444WR-NL	E-1963WLS	P-24258N-3	
4	BUSHING, 1-1/4"x1" (FOR 5/8"x3/4" ONLY)	-	E-128H	-	-
5	PROPERTY SIDE VALVE SHALL BE THE SAME SIZE AS THE METER AND REQUIRE A HANDLE	B13444W-NL	E-1908	B24351-411-N	76101MW
6	POLYMER CONCRETE METER BOX & LID (SEE SECTION 2-10.04)				
7	1/2" CRUSHED ROCK, 4" BASE				
8	1" COPPER TUBE, TYPE K (NO SPLICES ALLOWED), SOFT				
9	WATER METER (SEE SECTION 2-11)				
10	TAPE WRAP MIN. DISTANCE OF 3 FEET TO INCLUDE CORP. STOP W/ POLKEN #900 OR APPROVED EQUAL				

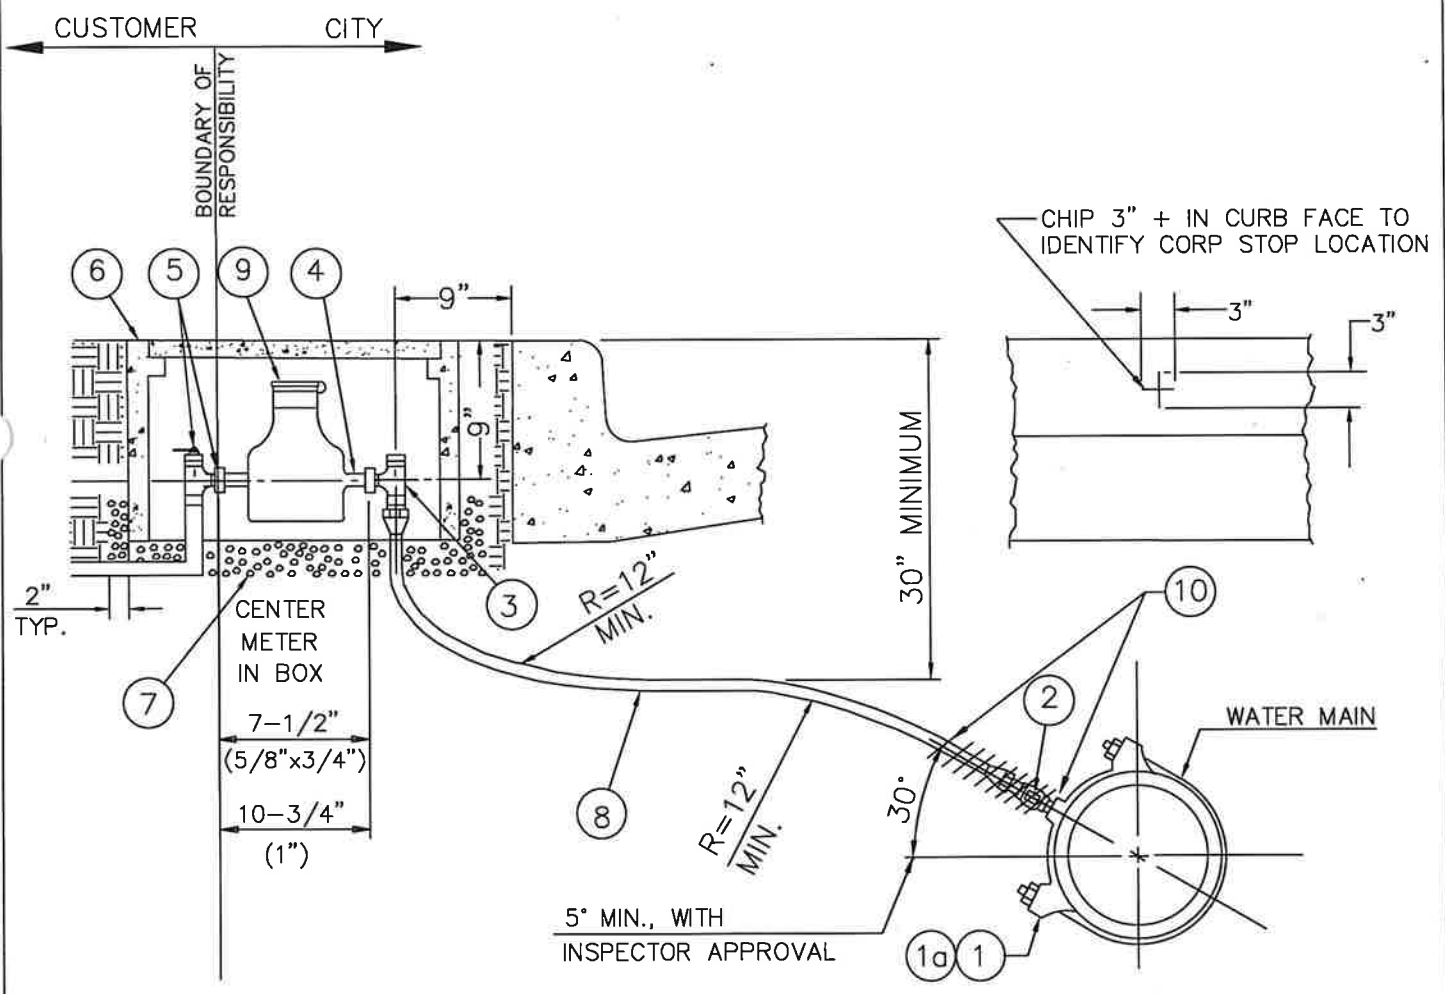

1 INCH WATER SERVICE INSTALLATION

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT-WATER DIVISION

	BY	DATE
DRAWN	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

[Signature]
[Signature]

DATE 12/10/24

APPROVED
CITY ENGINEER

DATE 12/11/24

STANDARD NO.

W-101

SHEET 1 OF 2

NOTES:

1. STANDARD 1" WATER SERVICE IS USED FOR 3/4" AND 1" METERS.
2. INSTALL CORPORATION STOP WITH KEY UP.
3. TAPS SHALL BE MADE 18" FROM ANY OTHER TAP OR COUPLING DEPENDING ON AWWA STANDARDS FOR THAT PIPE TYPE AND SIZE.
4. SERVICE SADDLE AND CORPORATION STOP SHALL BE CC (AWWA) THREAD
5. FOR USE ON PVC OR PVCO WATER MAIN CONSTRUCTION ONLY. PVC OR PVCO WATER MAIN CONSTRUCTION SHALL BE PER SECTION 2-02.
6. COPPER TUBE TO BE ONE CONTINUOUS PIECE. NO SPLICES PERMITTED.
7. ANGLE METER STOPS SHALL BE PROVIDED W/ 360° TEE HEAD ROTATION & LOCK WING
8. A TRAFFIC LOAD RATED COVER SHALL BE USED IN AREAS WITHOUT CURB, IN AREAS WITH ROLLED OR TYPE "F" CURB, OR WHERE THE METER IS LOCATED WITHIN 5- FEET OF THE BCR, ECR OR A DRIVEWAY APPROACH.
REFER TO STD 2-10.04
9. ONLY COPPER TUBING APPROVED WITHIN THE FIRST 10' AFTER THE WATER METER PROPERTY SIDE.
10. PROPERTY SIDE VALVE IS OWNED AND MAINTAINED BY THE PROPERTY OWNER.



1 INCH WATER SERVICE INSTALLATION

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION


STANDARD NO.

W-101

DRAWN	BY AM	DATE 10/02/24	APPROVED WATER UTILITY MANAGER		DATE 12/10/24
REVISED	DZ	10/02/24	APPROVED CITY ENGINEER		DATE 12/11/24
CHANGED	XX	XX/XX/XX			

SHEET 2 OF 2

ITEM	DESCRIPTION	FORD	JONES	MUELLER	A.Y. McDONALD
1	DOUBLE STRAP SERVICE SADDLE	202B	J-979	BR2B SERIES	3825
1a	DOUBLE STRAP SERVICE SADDLE (SEE NOTE 5)	202BS	J-969	BR2S SERIES	3855
2	CORPORATION STOP, 2" (INSULATED)	-	E-1999SG	N-35008N	-
2a	CORPORATION STOP, 2" (REGULAR)	FB1000-7-G-NL	E-1937	P-25008N	74701B-22
3	ANGLE METER STOP, 2"	BFA43-777WRQ-NL	E-1975W	B-24276-1-3-N	74612B-22
4	PROPERTY SIDE VALVE SHALL BE THE SAME SIZE AS THE METER AND REQUIRE A HANDLE	BFD13-777W-NL	E-1913WJ	B-24337-41-N	76101MW2
5	POLYMER CONCRETE METER BOX & LID (SEE SECTION 2-10.04)				
6	2" COPPER TUBE, TYPE K, SOFT				
7	1/2" CRUSHED ROCK, 4" BASE				
8	WATER METER (SEE SECTION 2-11)				
9	2" COMPRESSION COUPLING (USE WHEN L>20')				
10	2" BRASS ELL (LEAD FREE FOR DOMESTIC SERVICE). COMPRESSION TYPE				
11	TAPE WRAP MIN. DISTANCE OF 3 FEET TO INCLUDE CORP. STOP W/ POLKEN #900 OR APPROVED EQUAL				

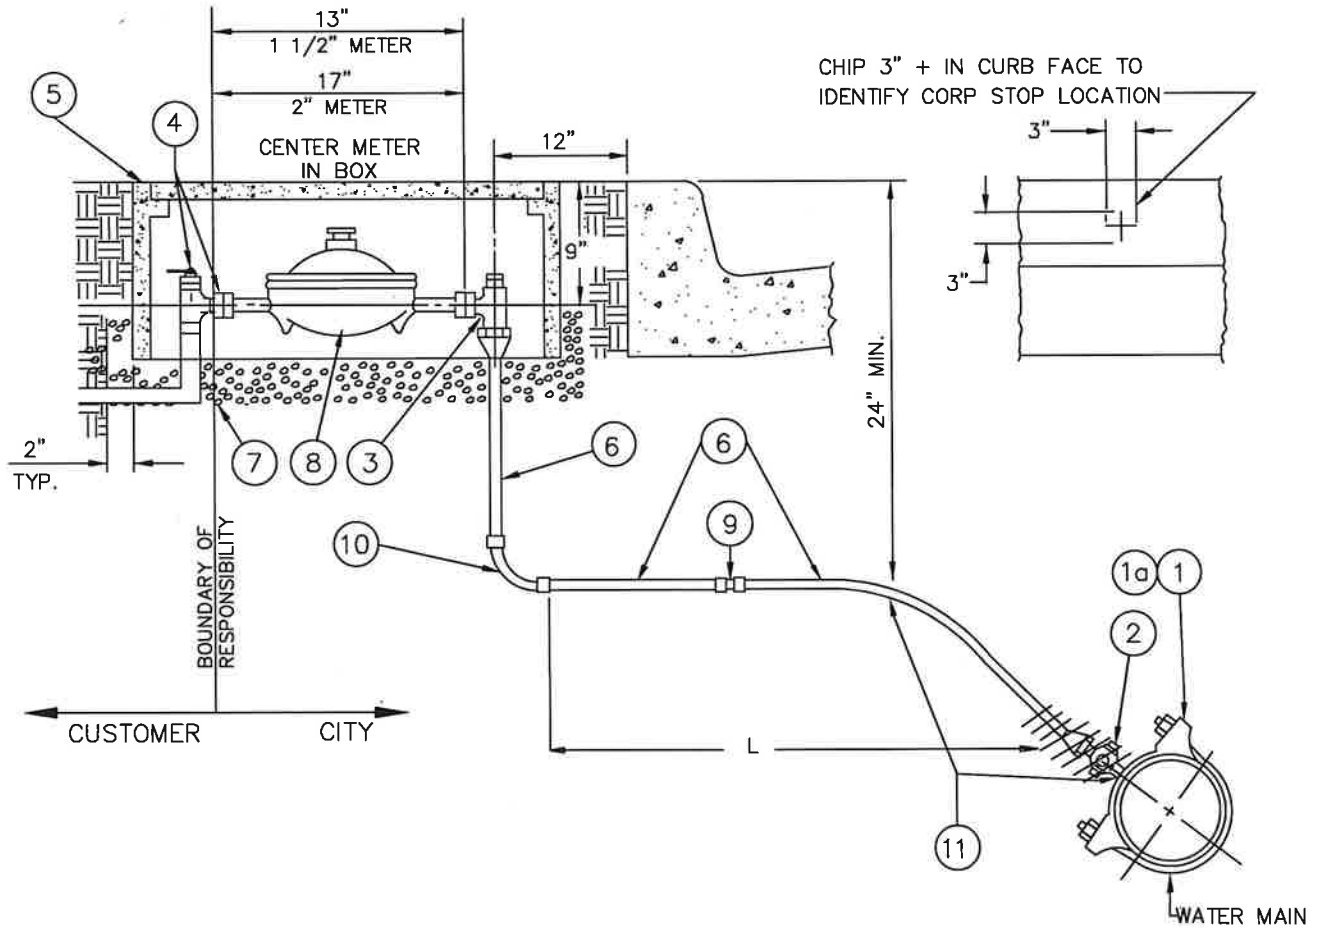

2 INCH WATER SERVICE INSTALLATION

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT—WATER DIVISION

STANDARD NO.

W-102

DRAWN	BY	DATE
	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

DATE 12/10/24

APPROVED
CITY ENGINEER

DATE 12/11/24

SHEET 1 OF 2

NOTES:

1. STANDARD 2" SERVICE IS USED FOR 1-1/2" METER AND 2" METER.
2. INSTALL CORPORATION STOP WITH KEY UP.
3. TAPS SHALL BE MADE AT LEAST 24" FROM ANY OTHER TAP OR COUPLING PER AWWA STANDARDS FOR THAT PIPE TYPE AND SIZE.
4. SERVICE SADDLE AND CORPORATION STOP SHALL BE CC (AWWA) THREAD.
5. FOR USE ON PVC OR PVCO WATER MAIN CONSTRUCTION ONLY. PVC OR PVCO WATER MAIN CONSTRUCTION SHALL BE PER SECTION 2-02.
6. A TRAFFIC LOAD RATING COVER SHALL BE USED IN AREAS WITHOUT CURB, IN AREAS WITH ROLLED OR TYPE "F" CURB, OR WHERE THE METER IS LOCATED WITHIN 5-FEET OF THE BCR, ECR OR A DRIVEWAY APPROACH PER DRAWING 2-10.04.
7. ANGLE METER STOPS SHALL BE PROVIDED WITH 360° TEE HEAD ROTATION & LOCK WING.
8. ONLY COPPER TUBING APPROVED WITHIN THE FIRST 10' AFTER THE WATER METER PROPERTY SIDE.
9. PROPERTY SIDE VALVE IS OWNED AND MAINTAINED BY THE PROPERTY OWNER.

2 INCH WATER SERVICE INSTALLATION

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.


W-102

DRAWN	BY AM	DATE 10/02/24	APPROVED WATER UTILITY MANAGER		DATE 12/10/24
REVISED	DZ	10/02/24			
CHANGED	XX	XX/XX/XX	APPROVED CITY ENGINEER		DATE 12/11/24

SHEET 2 OF 2

LIST OF MATERIAL

ITEM	DESCRIPTION
1	DOUBLE CHECK BACKFLOW PREVENTION DEVICE, USC APPROVED TYPE (SEE SECTION 5-01)
2	BRASS UNION
3	RISER, NIPPLES, ELBOW - BRASS OR COPPER
4	90° ELBOW - BRASS OR COPPER
5	PIPE/FITTING IN CONTACT WITH CONCRETE WILL BE WRAPPED TO PREVENT DETERIORATION

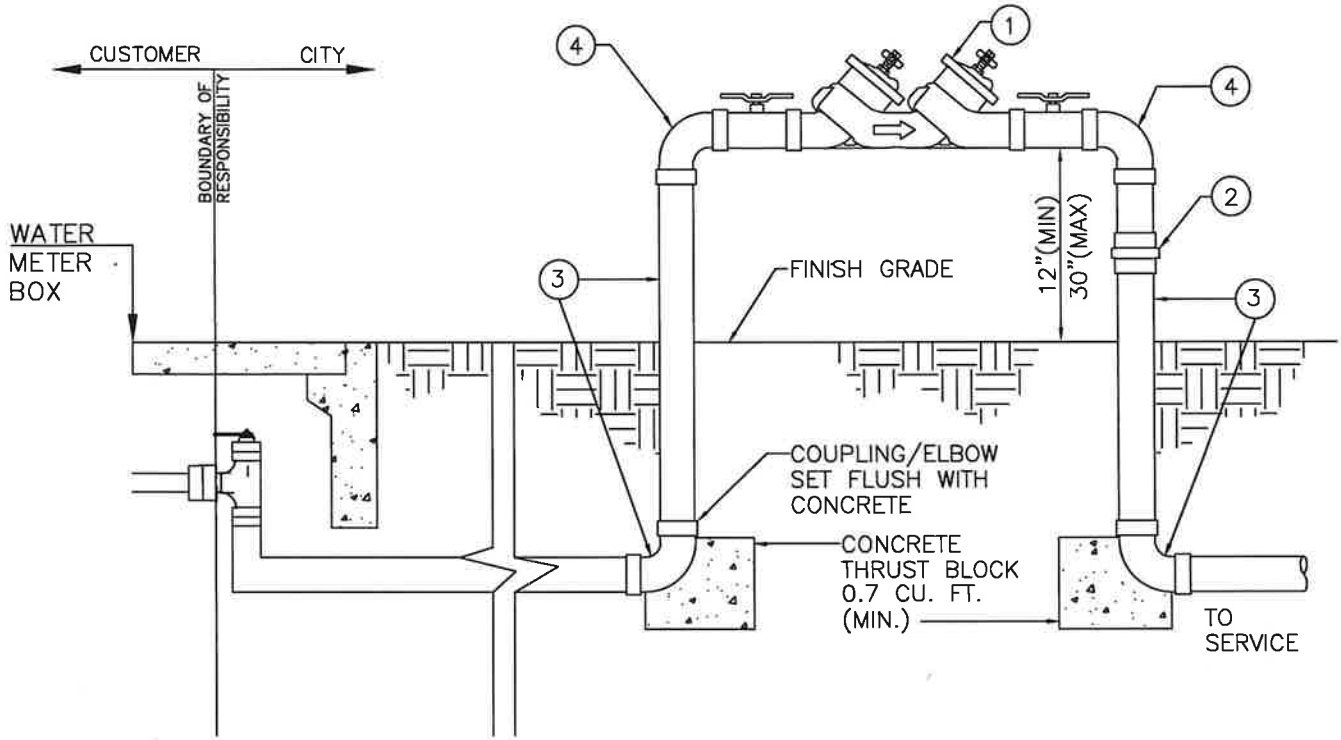

NOTES:

1. THE BACKFLOW PREVENTION ASSEMBLY SHALL CONSIST OF AN APPROVED DOUBLE CHECK ASSEMBLY. THE DEVICE SHALL BE LEAD FREE FOR DOMESTIC SERVICE.
2. LOCATION AND INSTALLATION SHALL BE PER PLAN AS SUBMITTED TO AND APPROVED BY THE UTILITY.
3. NO CONNECTIONS TO BE MADE BETWEEN METER AND BACKFLOW PREVENTER.
4. BACKFLOW DEVICE SHALL NOT BE LOCATED WITHIN THE PUBLIC RIGHT OF WAY (ROW) AND SHALL BE OUTSIDE OF THE SETBACK AREA (TYPICALLY 5-FT MIN. FROM ROW). UNLESS OTHERWISE APPROVED BY PLANNING DEPT.
5. SECURITY ENCLOSURE (OPTIONAL) SHALL BE AS SPECIFIED PER PROJECT PLAN OR AS DIRECTED BY THE UTILITY. ENCLOSURE WITH HEIGHT GREATER THAN 36" SHALL BE SUBMITTED FOR APPROVAL BY THE PLANNING DEPARTMENT.

3/4 INCH THROUGH 2 INCH DOUBLE CHECK BACKFLOW PREVENTION ASSEMBLY

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.


W-103

DRAWN	BY AM	DATE 09/26/24	APPROVED WATER UTILITY MANAGER	DATE 12/10/24
REVISED			APPROVED CITY ENGINEER	DATE 12/11/24
CHANGED				

SHEET 1 OF 1

LIST OF MATERIAL

ITEM	DESCRIPTION
1	REDUCED PRESSURE PRINCIPLE BACKFLOW PREVENTION DEVICE, USC APPROVED TYPE (SEE SECTION 5-01)
2	WYE STRAINER, BRONZE
3	BRASS UNION
4	RISER, NIPPLES, AND ELBOWS - BRASS OR COPPER
5	90° ELBOW - BRASS OR COPPER
6	PIPE/FITTINGS IN CONTACT WITH CONCRETE WILL BE WRAPPED TO PREVENT DETERIORATION

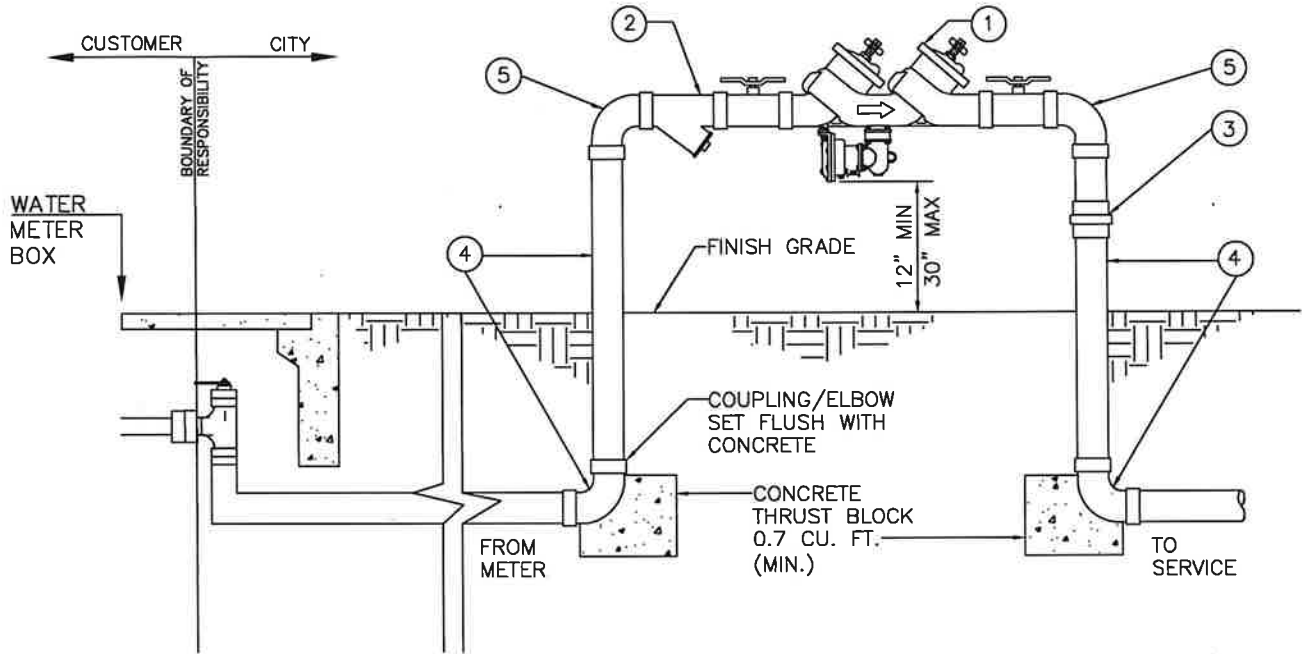


NOTES:

1. THE BACKFLOW PREVENTION ASSEMBLY SHALL CONSIST OF AN APPROVED DOUBLE CHECK ASSEMBLY. THE DEVICE SHALL BE LEAD FREE FOR DOMESTIC SERVICE.
2. LOCATION AND INSTALLATION SHALL BE PER PLAN AS SUBMITTED TO AND APPROVED BY THE UTILITY.
3. NO CONNECTIONS TO BE MADE BETWEEN METER AND BACKFLOW PREVENTER.
4. INSTALL BRASS PLUGS IN ALL TEST COCKS AFTER DEVICE HAS PASSED TESTING.
5. BACKFLOW DEVICE SHALL NOT BE LOCATED WITHIN THE PUBLIC RIGHT OF WAY (ROW) AND SHALL BE OUTSIDE OF THE SETBACK AREA (TYPICALLY 5-FT MIN. FROM ROW). UNLESS OTHERWISE APPROVED BY PLANNING DEPT.
6. SECURITY ENCLOSURE (OPTIONAL) SHALL BE AS SPECIFIED PER PROJECT PLAN OR AS DIRECTED BY THE UTILITY. ENCLOSURE WITH HEIGHT GREATER THAN 36" SHALL BE SUBMITTED FOR APPROVAL BY THE PLANNING DEPARTMENT.

3/4 INCH THROUGH 3 INCH REDUCED PRESSURE PRINCIPLE BACKFLOW PREVENTION ASSEMBLY

CITY OF MONTEREY PARK			STANDARD NO. W-104
PUBLIC WORKS DEPARTMENT—WATER DIVISION			
DRAWN	BY AM	DATE 09/26/24	APPROVED WATER UTILITY MANAGER
REVISED			DATE 12/10/24
CHANGED			APPROVED CITY ENGINEER
			DATE 12/14/24
			SHEET 1 OF 1

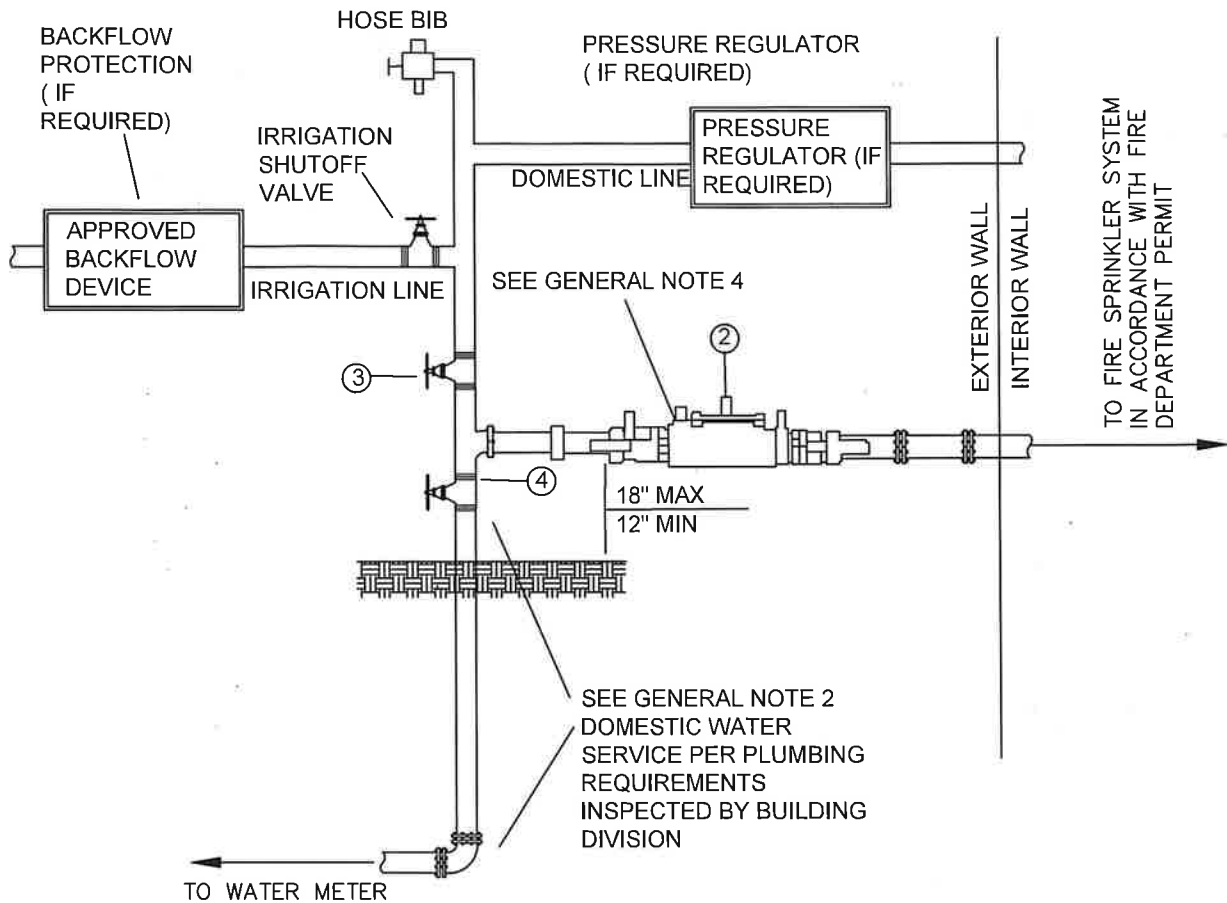

NOTE:

1. IMMEDIATE AFTER INSTALLATION, ALL BACK FLOW DEVICES SHALL BE TESTED BY A CERTIFIED TESTER APPROVED BY THE CITY. NO SERVICE SHALL BE DEEMED ACCEPTABLE UNTIL THE DEVICE IS TESTED AND CERTIFIED AFTER INSTALLATION.
2. TEES OR OTHER APPURTENANCES ARE PROHIBITED BETWEEN THE METER AND THE MAIN CONTROL VALVE THESE SHALL BE CONSTRUCTED DOWNSTREAM OF THE PROPERTY SHUTOFF VALVE.
3. DOUBLE CHECK VALVE BACK FLOW ASSEMBLY SIZE PER F.D. PERMIT REQUIREMENT AND AS APPROVED BY WATER CCC SPECIALIST.
4. THE BACK FLOW DEVICE IS A PART OF THE PUBLIC WORKS ENCROACHMENT PERMIT AND THE PW INSPECTOR AND CROSS-CONNECTION CONTROL SPECIALIST WILL BE RESPONSIBLE FOR INSPECTING AND APPROVING THE FINAL LOCATION OF THE DCV.
5. D.C.V HANDLES TO BE REMOVED AFTER FINAL INSPECTION.
6. PRESSURE REGULATOR REQUIRED IF STATIC PRESSURE IS 80PSI+.

ITEM	DESCRIPTION
1	MINIMUM 1 1/4" WATER LINE FROM METER TO RISER
2	DOUBLE CHECK VALVE BACKFLOW PREVENTION ASSEMBLY (LEAD FREE) SIZE PER FIRE PLAN
3	PROPERTY SHUT OFF VALVE
4	MAIN CONTROL VALVE

3/4 INCH THROUGH 2 INCH DOMESTIC/FIRE PROTECTION RESIDENTIAL BACKFLOW INSTALLATION


CITY OF MONTEREY PARK
PUBLIC WORKS DEPARTMENT—WATER DIVISION

STANDARD NO.

W-105

DRAWN	BY AM	DATE 10/02/24	APPROVED WATER UTILITY MANAGER	<i>[Signature]</i>	DATE	12/10/24
REVISED	DZ	10/02/24	APPROVED CITY ENGINEER	<i>[Signature]</i>	DATE	12/11/24
CHANGED	XX	XX/XX/XX				

SHEET 1 OF 1

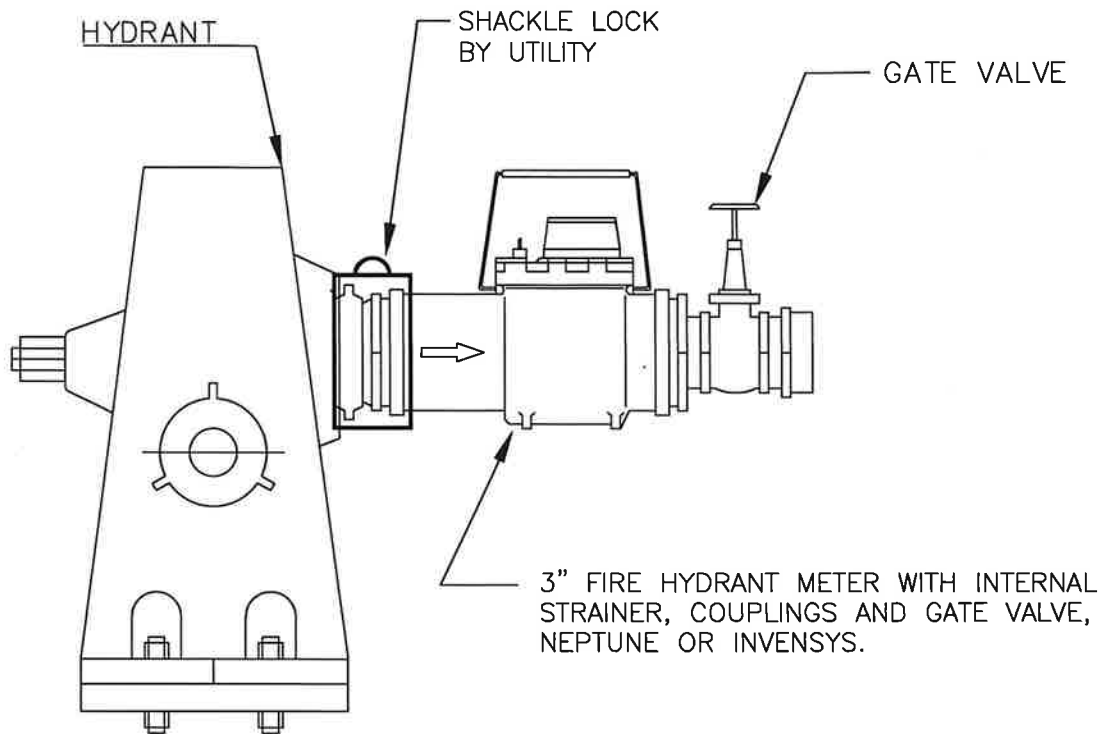

NOTES:



1. OPENING AND CLOSING OF HYDRANT IS PERMITTED ONLY WITH A HYDRANT WRENCH. GATE VALVE WILL BE USED TO CONTROL WATER FLOW.
2. SERVICE MAY BE MOVED FROM ONE LOCATION TO ANOTHER ONLY BY THE WATER DIVISION.
3. BACKFLOW DEVICES MAY BE REQUIRED FOR CERTAIN USES.
4. SERVICE CONNECTION MAY BE TERMINATED AT ANY TIME AT THE DISCRETION OF THE WATER DIVISION.
5. CHARGES FOR LOSS OR DAMAGE TO ANY SERVICE MATERIAL WILL BE BASED UPON CURRENT PRICES.

2-1/2" TEMPORARY WATER SERVICE

CITY OF MONTEREY PARK
PUBLIC WORKS DEPARTMENT—WATER DIVISION

STANDARD NO.


W-106

DRAWN	BY XX	DATE XX/XX/XX	APPROVED WATER UTILITY MANAGER		DATE	12/10/24
REVISED	XX	XX/XX/XX	APPROVED CITY ENGINEER		DATE	12/11/24
CHANGED	XX	XX/XX/XX				

SHEET 1 OF 1

LIST OF MATERIAL

ITEM	DESCRIPTION
1	TEE (MAIN SIZE X 6" FLG OUTLET)
2	GATE VALVE (6" FLG X MJ)
3	PIPE SHALL BE AWWA C900 PVC OR AWWA C909 PVCO PIPE (6"), PRESSURE CLASS 305, PE X PE (SEE NOTES 9 AND 10 ON SHEET 2)
4	COMMERCIAL FIRE HYDRANT (WET BARREL), 2-2 1/2" & 1-4"
4A	RESIDENTIAL FIRE HYDRANT (WET BARREL), 2-2 1/2" & 1-4"
5	6" X REQ. LENGTH FIRE HYDRANT BURY
6	MECHANICAL JOINT RESTRAINT PER SECTION 2-12.01.1
7	SOLID SPOOL THAT ENDS WITH FLANGE SITTING 2-1/2" ABOVE FINISHED GRADE
8	6" L HYDRANT BREAK-OFF EXTENSION

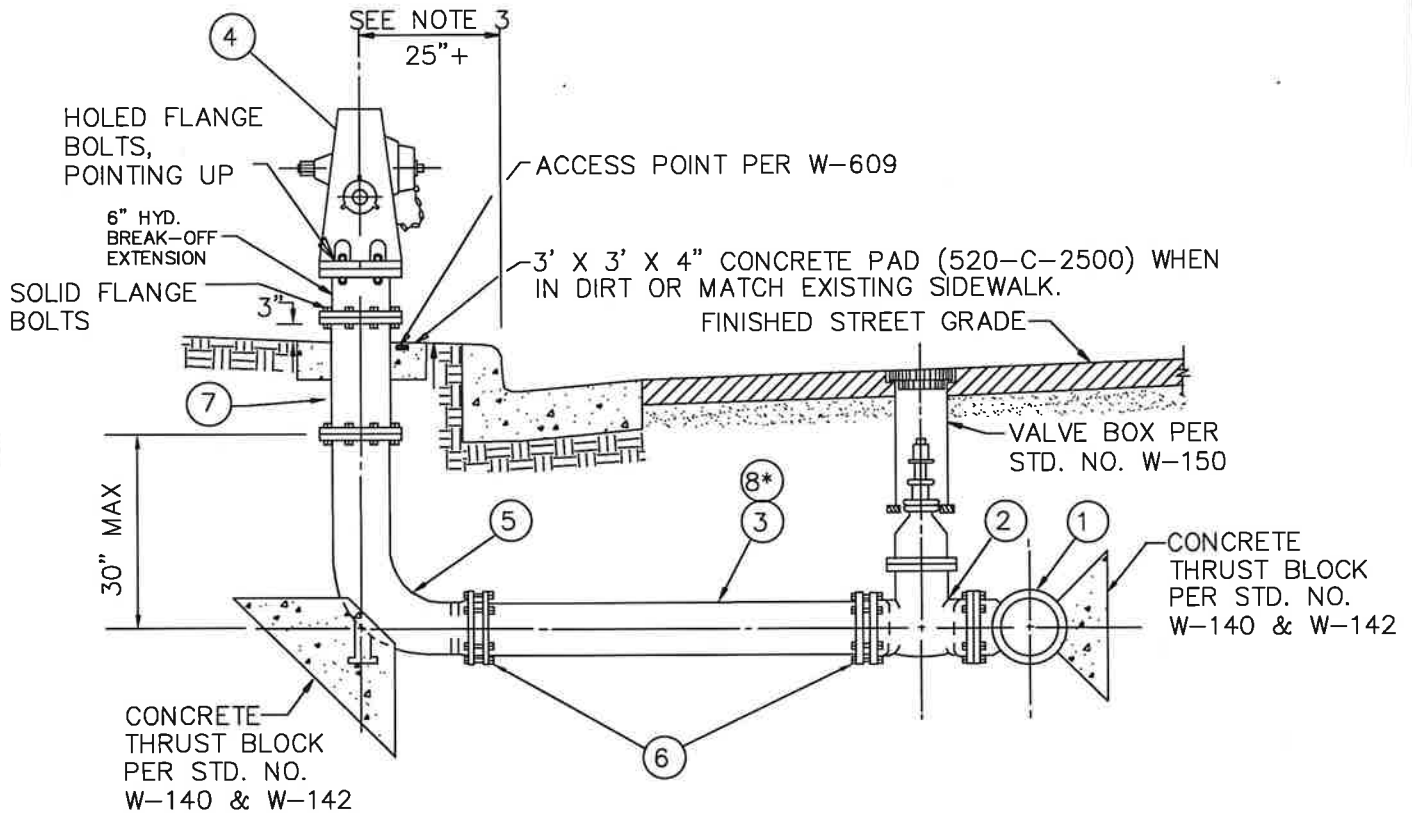

* FOR PVC OR PVCO WATER MAIN CONSTRUCTION ONLY - SEE NOTES 9 AND 10 ON SHEET 2

STANDARD FIRE HYDRANT INSTALLATION

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT-WATER DIVISION

STANDARD NO.

W-110

	BY	DATE
DRAWN	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

DATE

12/10/24

APPROVED
CITY ENGINEER


DATE

12/11/24

SHEET 1 OF 3

NOTES:

1. FIRE HYDRANTS SHALL BE PAINTED IN ACCORDANCE WITH SECTION 2-14.
2. DISTANCE FROM CURB FACE TO BE 5'-3" WHEN 4' WIDE SIDEWALK IS ADJACENT CURB. A MINIMUM 4' SIDEWALK CLEARANCE SHALL BE MAINTAINED.
3. UTILITY WILL DETERMINE NUMBER OF OUTLETS TYPED REQUIRED FROM THE FOLLOWING APPROVED FIRE HYDRANTS. JONES J-3700, J-3765, OR APPROVED EQUAL.
4. CONTRACTOR SHALL USE ADDITIONAL RESTRAINT BENDS NECESSARY TO AVOID OTHER EXISTING OR PROPOSED UTILITIES WHEN REQUIRED.
5. FOR ALL CASES, THE LOCATION OF FIRE HYDRANT SHALL MEET ADA REQUIREMENT THAT A MINIMUM 48-INCH CLEARANCE BE MAINTAINED FROM ANY OBSTRUCTION IN THE WALK.
6. FIRE HYDRANT SHALL BE LOCATED A MINIMUM OF 5 FEET FROM BCR, ECR OR DRIVEWAY APPROACH.
7. FOR ROLLED CURBS, THE DISTANCE FROM THE EDGE OF THE PAVEMENT TO THE FIRE HYDRANT SHALL BE AS DIRECTED BY THE ENGINEER.
8. PVC OR PVCO WATER MAIN CONSTRUCTION SHALL BE PER SECTION 2-02
9. MECHANICAL JOINT RESTRAINT FOR PVC OR PVCO PIPE SHALL BE PROVIDED PER SECTION 2-12.01
10. TAPPING SLEEVES, WHEN INDICATED PER PLAN OR AS DIRECTED BY UTILITY, SHALL BE PER SECTION 2-8.05. TAPPING VALVES 12" AND SMALLER SHALL BE RESILIENT WEDGE GATE VALVES.
11. INSTALL TRACER WIRE PER GUIDELINES FOR THE INSTALLATION OF TRACER WIRE FOR NON-METALLIC PIPE ADDENDUM AND DRAWING W-609.

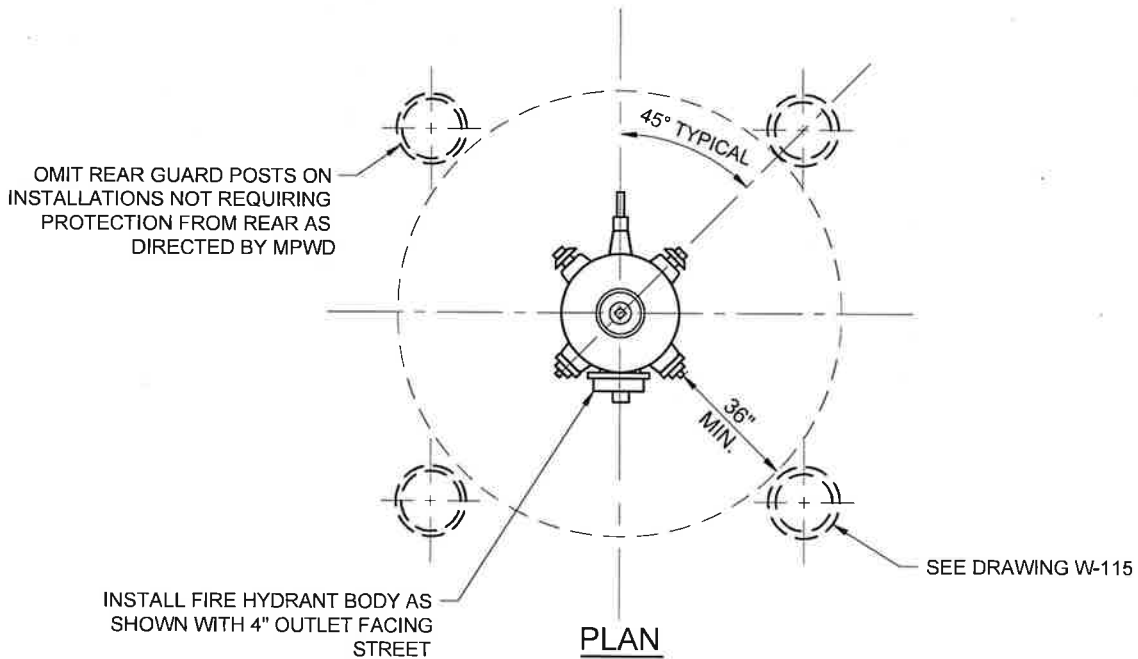

STANDARD FIRE HYDRANT INSTALLATION

CITY OF MONTEREY PARK


PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.


W-110

DRAWN	BY AM	DATE 10/02/24	APPROVED WATER UTILITY MANAGER	<i>[Signature]</i>	DATE 12/10/24
REVISED	DZ	10/02/24			
CHANGED	XX	XX/XX/XX	APPROVED CITY ENGINEER	<i>[Signature]</i>	DATE 10/11/24


SHEET 2 OF 3

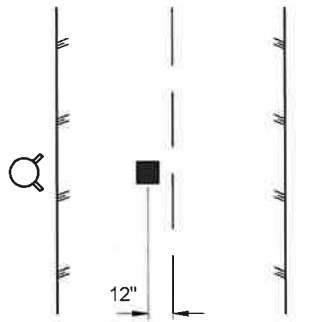


TWO LANE STREET

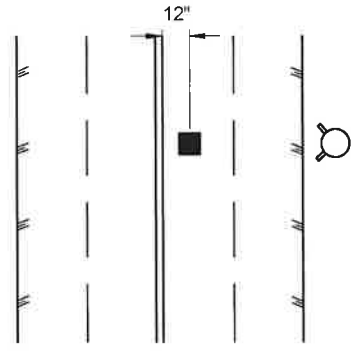


MULTI-LANE STREET

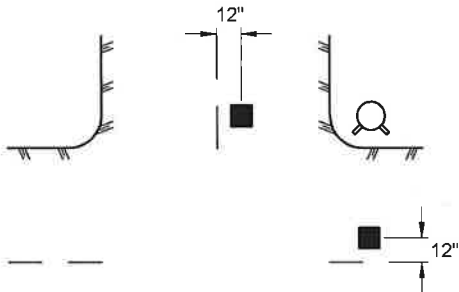

INTERSECTION

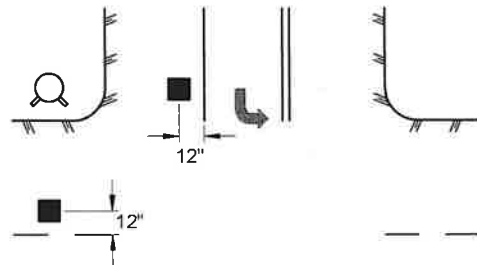

INTERSECTION WITH
TURN LANES

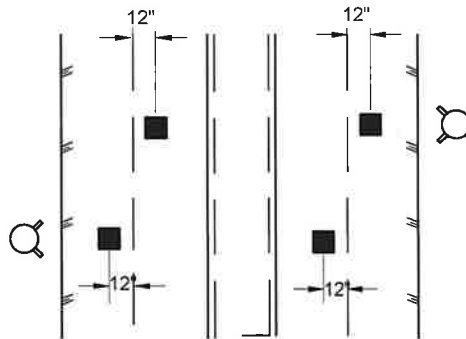

MULTI-LANE STREET
WITH TURN LANE

FIRE HYDRANT MARKERS SHALL BE TYPE-1 TWO-WAY BLUE REFLECTIVE MARKERS.

■ DENOTES FIRE HYDRANT MARKERS

○ DENOTES FIRE HYDRANT

STANDARD FIRE HYDRANT INSTALLATION

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT—WATER DIVISION

STANDARD NO.

W-110

	BY	DATE
DRAWN	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

[Signature]


DATE 12/10/24

APPROVED
CITY ENGINEER

[Signature]

DATE 12/11/24

SHEET 3 OF 3

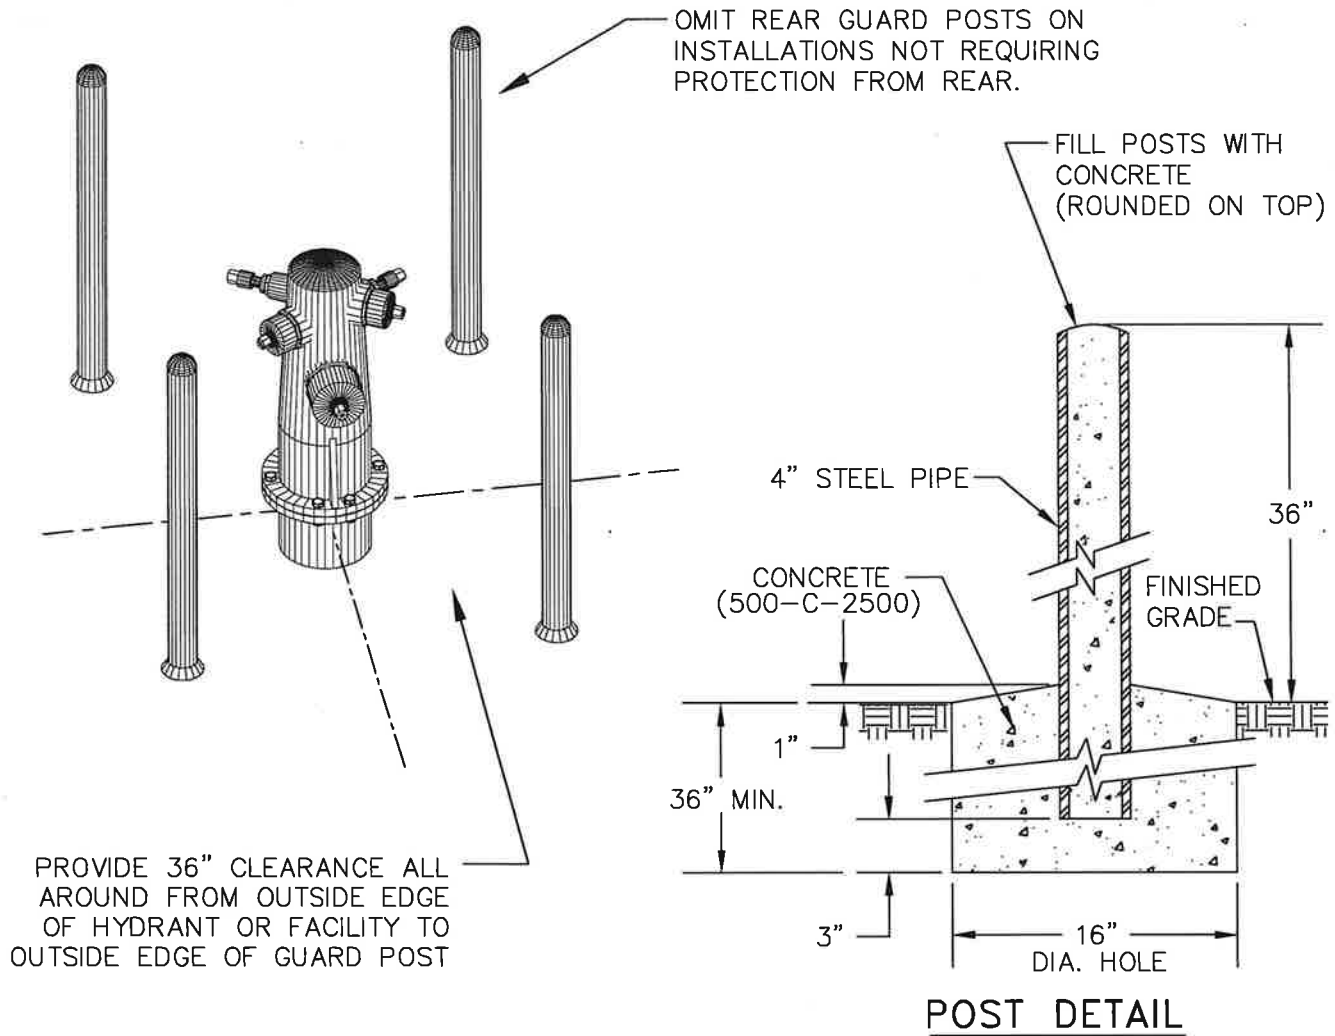

NOTES:

1. WHEN REQUIRED BY THE UTILITY, GUARD POSTS SHALL BE INSTALLED FOR HYDRANTS OR OTHER CITY WATER FACILITIES ADJACENT TO STREETS WITHOUT CURBS, WITH ROLLED OR TYPE 'F' CURB, OR WITHIN 4 FEET OF PARKING LOT CURB OR CURB STOPS.
2. GUARD POSTS SHALL BE PAINTED IN ACCORDANCE WITH SECTION 2-14.
3. REFLECTIVE TAPE REQUIRED FOR COLORS OTHER THAN SAFETY YELLOW.
4. FOR ALL CASES, THE LOCATION OF GUARD POSTS SHALL MEET ADA REQUIREMENT THAT A MINIMUM 48-INCH CLEARANCE BE MAINTAINED FROM ANY OBSTRUCTION IN THE WALK.
5. GUARD POSTS SHALL BE LOCATED A MINIMUM OF 5 FEET FROM BCR, ECR OR DRIVEWAY APPROACH.
6. IN AREAS WITH ROLLED CURBS OR NO CURBS, THE DISTANCE FROM THE EDGE OF PAVEMENT TO THE GUARD POSTS SHALL BE AS DIRECTED BY THE UTILITY.

WATER FACILITY GUARD POST

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT—WATER DIVISION

STANDARD NO.

W-115

DRAWN	BY XX	DATE XX/XX/XX
REVISED	XX	XX/XX/XX
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

DATE *12/10/24*


APPROVED
CITY ENGINEER

DATE *12/11/24*

SHEET 1 OF 1

LIST OF MATERIAL

ITEM	DESCRIPTION	FORD	JONES	MUELLER	A.Y. MCDONALD
1	DOUBLE STRAP SERVICE SADDLE W/ CC (AWWA) THREAD	202B	J-979	BR2B SERIES	3825
1a	DOUBLE STRAP SERVICE SADDLE W/ CC (AWWA) THREAD PVC C900 & C909	202BS	J-969	BR2S SERIES	3855
2	CORPORATION STOP 2", KEY UP W/ CC (AWWA) THREAD (INSULATED)	-	E-1999SG	N-35008N	-
2a	CORPORATION STOP 2", KEY UP W/ CC (AWWA) THREAD (REGULAR)	FB1000- 7-G-NL	E-1937	P-25008N	74701B-22
3	2" COPPER TUBE, TYPE K, 20' LENGTHS				
4	COUPLING, COMPRESSION TYPE, USE WHEN L>20'				
5	SHORT RADIUS ELL, COMPRESSION TYPE				
6	COUPLING, COMPRESSION X FIP				
7	METER BOX FOR 2" SERVICE PER SECTION 2-10.04 WITH ARMORCAST, A6001643 COVER FOR PEDESTRIAN LOAD AND A6001947T FOR TRAFFIC LOAD, PLUS "BLOW-OFF" MARKING				
8	1/2" CRUSHED ROCK, 4" BASE				
9	CORPORATION STOP, 2"				
10	2" PLUG THREAD				

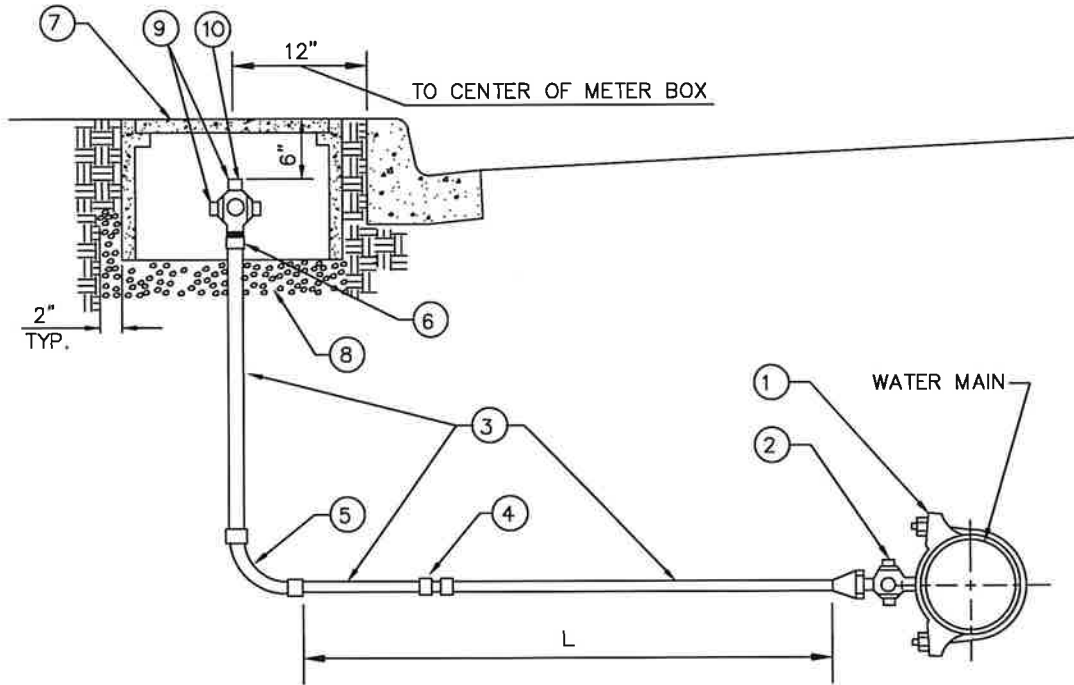

NOTES:

1. TAPS SHALL BE MADE AT LEAST 24" FROM ANY OTHER TAP, COUPLING, OR END OF MAIN.
2. IN AREAS WITHOUT CURB OR WITH ROLLED OR TYPE "F" CURB, USE TRAFFIC LOAD RATED COVER.

2" BLOWOFF ASSEMBLY - NON TRAFFIC BEARING

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT-WATER DIVISION

STANDARD NO.

W-121

	BY	DATE
DRAWN	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

DATE

[Signature]
12/10/24

APPROVED
CITY ENGINEER


DATE

[Signature]
12/11/24

SHEET 1 OF 1

LIST OF MATERIAL

ITEM	DESCRIPTION	FORD	JONES	MUELLER	A.Y. MCDONALD
1	DOUBLE STRAP SERVICE SADDLE W/ CC (AWWA) THREAD	202B	J-979	BR2B SERIES	3825
1a	DOUBLE STRAP SERVICE SADDLE W/ CC (AWWA) THREAD PVC C900 & C909	202BS	J-969	BR2S SERIES	3855
2	CORPORATION STOP 2", KEY UP W/ CC (AWWA) THREAD (INSULATED)	-	E-1999SG	N-35008N	-
2a	CORPORATION STOP 2", KEY UP W/ CC (AWWA) THREAD (REGULAR)	FB1000-7-G-NL	E-1937	P-25008N	74701B-22
3	2" COPPER TUBE, TYPE K				
4	SHORT RADIUS ELL, COMPRESSION TYPE				
5	COUPLING, COMPRESSION X FIP				
6	BROOKS 4TT BOX				
7	8" DIA PVC PIPE, C900 LENGTH AS REQUIRED				
8	2" X 4" X 8" REDWOOD, 2 PLACES				
9	BLOW-OFF VALVE, BRASS, 2", TRUFLO MODEL TF550 BY THE KUPFERLE FOUNDRY CO.				

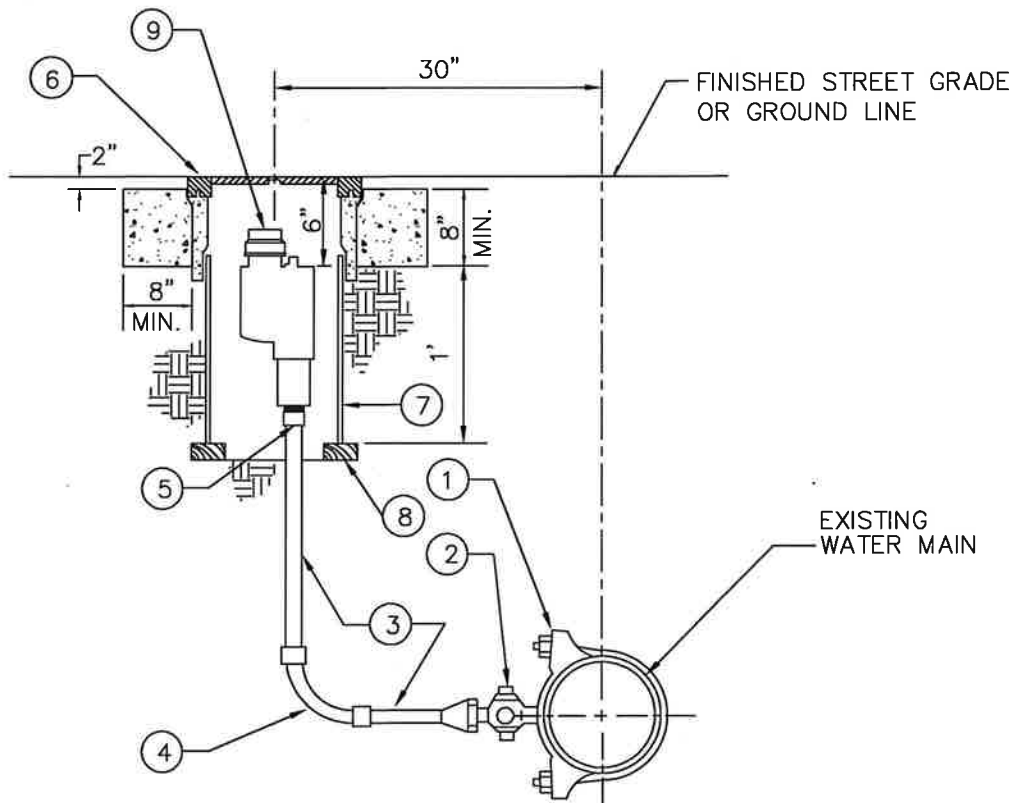

NOTES:

1. TAPS SHALL BE MADE AT LEAST 24" FROM ANY OTHER TAP, COUPLING, OR END OF MAIN.

2" BLOWOFF ASSEMBLY - TRAFFIC BEARING

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-122

	BY	DATE
DRAWN	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

DATE

[Signature]
12/10/24

APPROVED
CITY ENGINEER

DATE

[Signature]
12/11/24


SHEET 1 OF 1

LIST OF MATERIAL

ITEM	DESCRIPTION
1	MAIN SIZE X 4" TEE, FLG X MJ, RESTRAINED, D.I. OR MAIN SIZE X 4" REDUCER, FLG X FLG
2	4" GATE VALVE, RESILIENT WEDGE, AWWA C509, FLG X MJ, RESTRAINED
3	4" D.I. 90° BEND, MJ, RESTRAINED X FLG
4	VARIABLE LENGTH 4" C900 PVC OR C909 PVC0, CLASS 305, RESTRAINED PER STD. NO W-139
5	METER BOX FOR 2" SERVICE PER SEC. 2-10.04 WITH ARMORCOAST, A6001643 COVER FOR PEDESTRIAN LOAD AND A6001947T FOR TRAFFIC LOAD, PLUS "BLOW-OFF" MARKING
6	4" FLG X 4" NST FIRE HOSE CONNECTION ADAPTER WITH 4" THREADED CAP
7	VARIABLE LENGTH 4" D.I. FLANGED SPOOL
*8	4" D.I. FLANGED SPOOL X LENGTH DESIGNATED ON PLAN. 8-5/8"φ X 2 3/4" LONG HEX. HEAD BOLTS W/ NUTS. 1-4" GASKET RUBBER RING.
9	CONCRETE THRUST BLOCK PER STD. NO. W-140 & W-142.

*IF DESIGNATED ON PLAN

NOTE: INSTALL TRACER WIRE PER STD. NO W-609

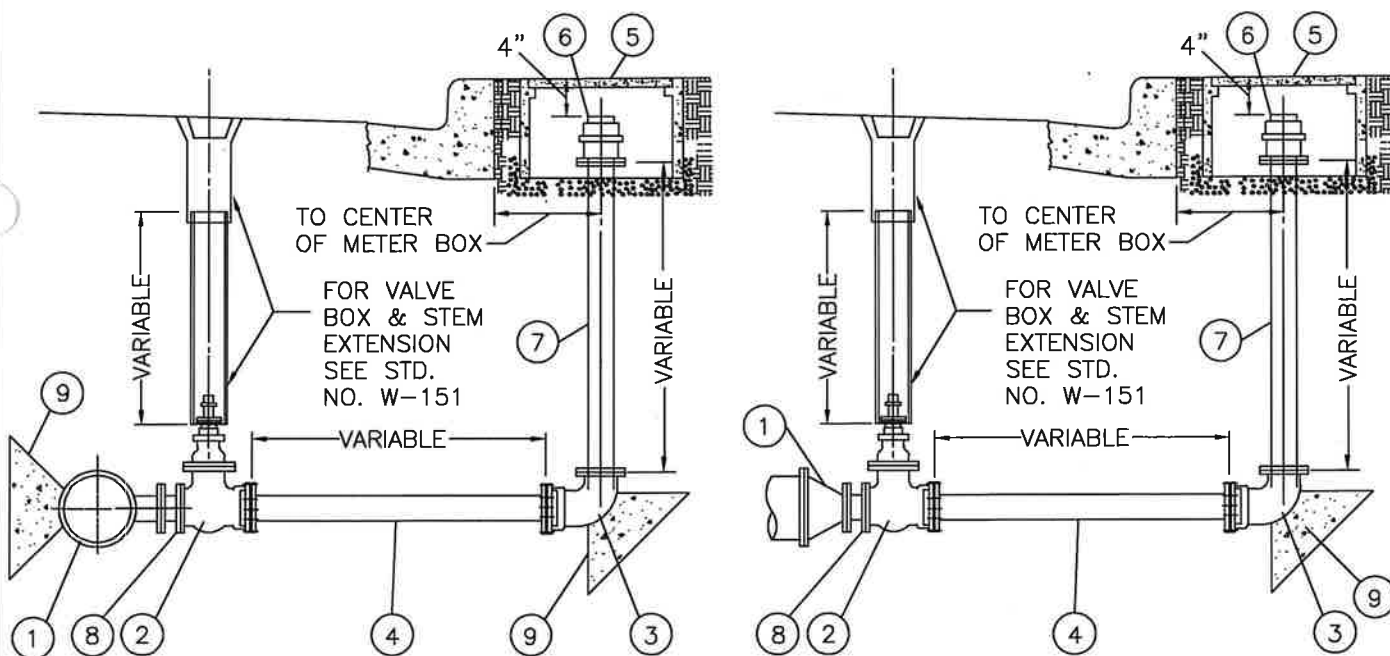

IN-LINE BLOWOFF

END-OF-LINE BLOWOFF

4" BLOWOFF

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-124

	BY	DATE
DRAWN	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER


[Signature]
[Signature]

DATE 12/10/24

APPROVED
CITY ENGINEER

DATE 12/11/24

SHEET 1 OF 1

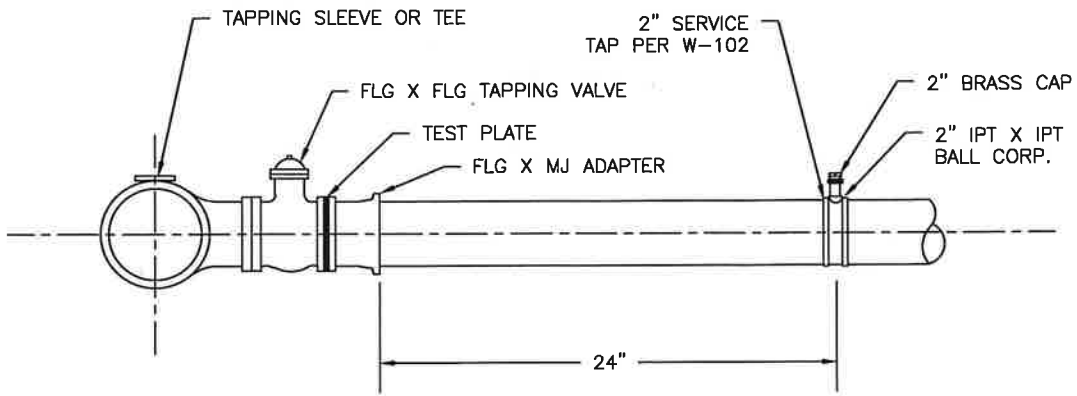


CASE 1 - TEST PLATE DETAIL

BILL OF MATERIALS

ITEM	QUANTITY
① WATER MAIN, SERVICE OR FIRE HYDRANT	PER PLAN
② MJ END CAP W/ 2" ECCENTRIC TAP	1
③ 2" - 12" LONG GALV STEEL PIPE (IPT)	2
④ 2" GALV STEEL PIPE (IPT)	6 LF ±
⑤ 2" VALVE (FIPT) PER SPECIFICATIONS	1
⑥ 2" - 90° GALV STEEL ELL, (FIPT)	2
⑦ 2" GALV END CAP (FIPT)	1
⑧ MAIN SIZE RESTRAINED MJ	1
⑨ METER BOX (TRAFFIC RATE LID AND BOX)	1

NOTE:
1- CONTRACTOR SHALL LEAVE END CAP IN PLACE UNTIL FINAL CONNECTION IS APPROVED

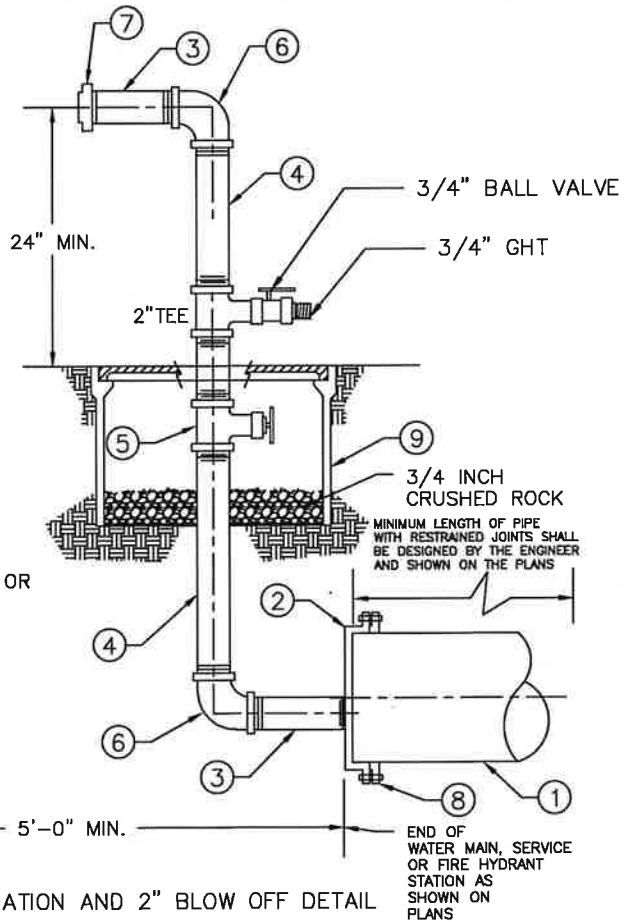

CASE 2 - PHYSICAL SEPARATION AND 2" BLOW OFF DETAIL

TEST SET UP REQUIREMENTS FOR NEWLY INSTALLED WATER MAINS, LARGE METER SERVICES > 2 INCH, AND FIRE HYDRANTS-ALL EXCEEDING 18FT IN LENGTH

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT-WATER DIVISION

STANDARD NO.

W-126

DRAWN	BY	DATE
	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

APPROVED
CITY ENGINEER


DATE

DATE


12/10/24
12/11/24

SHEET 1 OF 1

ZONE	NEW SEWER CONSTRUCTION	NEW WATER MAIN CONSTRUCTION
B	SEWER PIPE SHALL BE EXTRA STRENGTH V.C.P. WITH COMPRESSION JOINTS OR ALTERNATE MATERIAL AS APPROVED BY PUBLIC WORKS AND PUBLIC UTILITIES DEPARTMENT	WATER PIPE SHALL BE DIP, CLASS 52, WITH HOT DIP BITUMINOUS COATING PER SECT. 2-01 OR, UPON APPROVAL, PVC PIPE, CLASS 305 (DR 14 AWWA C900), SEE NOTE 4 ON W-130 SHEET 2 OF 4
A	NO CONSTRUCTION WITHOUT APPROVAL OF WATER UTILITY AND STATE WATER RESOURCES CONTROL BOARD, DIVISION OF DRINKING WATER (SWRCB-DDW)	
P	PROHIBITED ZONE PER SECTION 64572 CALIFORNIA CODE OF REGULATION, TITLE 22	

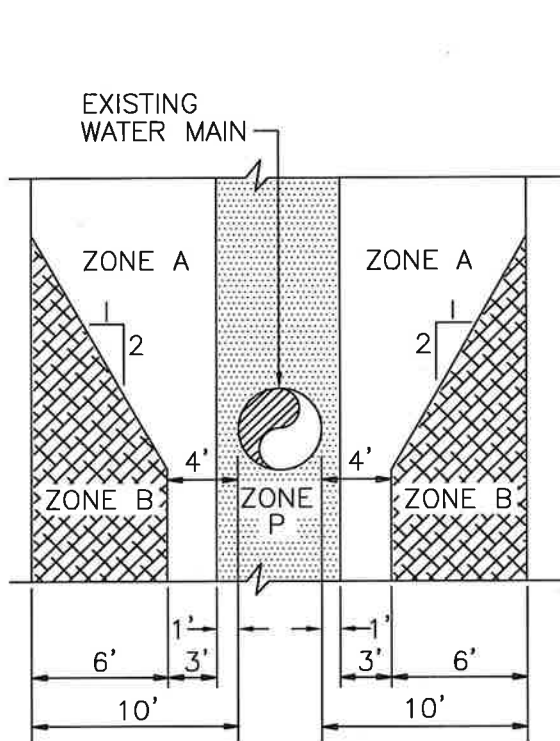

ZONES INDICATING LOCATIONS
OF NEW SEWER

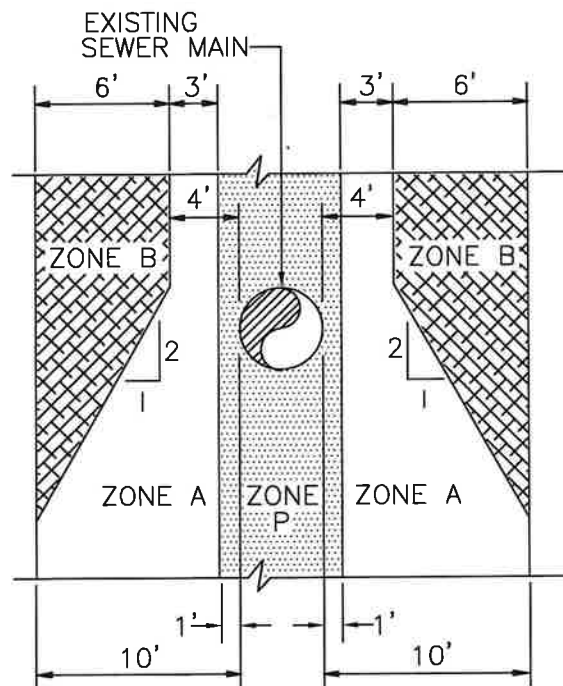

ZONES INDICATING LOCATIONS
OF NEW WATER MAIN

PARALLEL CONSTRUCTION

NOTE: SPECIAL CONSTRUCTION SHOWN ABOVE ARE FOR GUIDELINES ONLY
SEE NOTES ON FOLLOWING SHEETS FOR ADDITIONAL REQUIREMENTS

WATER AND SEWER SEPARATION REQUIREMENTS

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT—WATER DIVISION

STANDARD NO.

W-130

	BY	DATE
DRAWN	XX	XX/XX/XX
REVISED	XX	XX/XX/XX
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

DATE

[Signature]
12/10/24

APPROVED
CITY ENGINEER

DATE

[Signature]
12/11/24

SHEET 1 OF 4

NOTES:

1. SWRCB-DDW REGULATIONS REQUIRE THAT THE HORIZONTAL DISTANCE BETWEEN THE WATER MAIN AND THE SANITARY SEWER MAIN SHALL BE A MINIMUM OF 10-FT FROM OUTSIDE WALL-TO-OUTSIDE WALL.
2. FOR SITUATIONS IN WHICH THERE IS NO ALTERNATIVE BUT TO INSTALL WATER MAINS, SANITARY SEWER MAINS OR OTHER NON-POTABLE PIPELINES AT A DISTANCE LESS THAN THAT REQUIRED BY SWRCB-DDW REGULATIONS, THEN SPECIAL CONSTRUCTION AS SHOWN ON SHEET 1 OF 4 OF W-130, CAN BE USED AFTER REVIEW AND APPROVAL IN WRITING BY SWRCB-DDW
3. FORCE SEWER MAINS ARE NOT PERMITTED IN ZONES A OR B.
4. PVC WATER MAIN CONSTRUCTION SHALL BE PRE-APPROVED BY THE UTILITY PER SECTION 2-02. PVC PIPE LARGER THAN 12-INCH IN DIAMETER IS NOT ALLOWED.
5. INSTALLATION OF WATER MAINS, SANITARY SEWER MAINS, OR OTHER NON-POTABLE PIPELINES THAT DO NOT MEET THE MINIMUM SWRCB-DDW SEPARATION CRITERIA SHALL BE REVIEWED AND APPROVED IN WRITING BY SWRCB-DDW ON A CASE-BY-CASE BASIS PRIOR TO CONSTRUCTION.



WATER AND SEWER SEPARATION REQUIREMENTS

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION



STANDARD NO.

W-130

DRAWN	BY XX	DATE XX/XX/XX	APPROVED WATER UTILITY MANAGER		DATE	12/10/24
REVISD	XX	XX/XX/XX	APPROVED CITY ENGINEER		DATE	12/11/24
CHANGED	XX	XX/XX/XX				

SHEET 2 OF 4

ZONE	NEW SEWER CONSTRUCTION	NEW WATER MAIN CONSTRUCTION
C	NEW SEWER PIPE SHALL BE CENTERED OVER THE EXISTING WATER PIPE BEING CROSSED; SEWER PIPE SHALL BE A CONTINUOUS FULL LENGTH OF DIP WITH CERAMIC EPOXY LINING (PROTECTO 401 OR APPROVED EQUAL), OR, ALTERNATIVELY, ANY APPROVED SEWER PIPE MATERIAL WITHIN A CONTINUOUS CASING AS APPROVED BY PUBLIC WORKS	NEW WATER PIPE SHALL BE CENTERED UNDER THE EXISTING SEWER PIPE BEING CROSSED; WATER PIPE SHALL BE A CONTINUOUS FULL LENGTH OF DIP, CLASS 52, OR, UPON APPROVAL, A CONTINUOUS FULL LENGTH OF PVC PIPE, CLASS 305 (DR 14 AWWA C900), SEE NOTE 5 ON W-130, SHEET 4 OF 4
D	SEWER PIPE SHALL NOT HAVE JOINTS WITHIN 4-FT FROM EITHER SIDE OF WATER PIPE BEING CROSSED; SEWER PIPE SHALL BE A CONTINUOUS SECTION OF DIP WITH CERAMIC EPOXY LINING (PROTECTO 401 OR APPROVED EQUAL), OR, ALTERNATIVELY, ANY APPROVED SEWER PIPE MATERIAL WITHIN A CONTINUOUS CASING AS APPROVED BY PUBLIC WORKS	WATER PIPE SHALL HAVE NO JOINTS WITHIN 4-FT FROM EITHER SIDE OF SEWER PIPE BEING CROSSED; WATER PIPE SHALL BE A CONTINUOUS FULL LENGTH OF DIP, CLASS 52, OR UPON APPROVAL, A CONTINUOUS FULL LENGTH OF PVC PIPE, CLASS 305 (DR 14 AWWA C900), SEE NOTE 5 ON W-130, SHEET 4 OF 4
P	PROHIBITED ZONE PER SECTION 64572, CALIFORNIA CODE OF REGULATION, TITLE 22.	

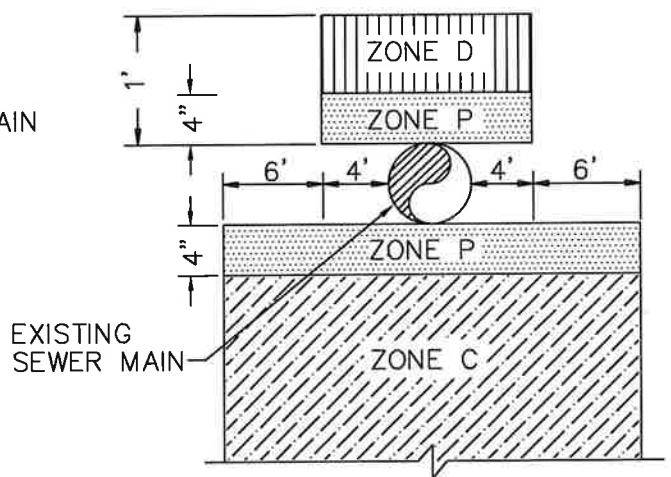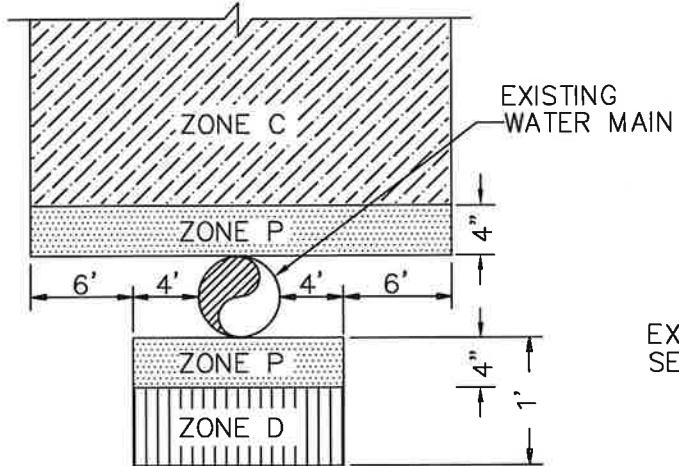

ZONES INDICATING LOCATIONS OF NEW SEWER

ZONES INDICATING LOCATIONS OF NEW WATER MAIN

PERPENDICULAR CONSTRUCTION (CROSSING)

NOTE: SPECIAL CONSTRUCTION SHOWN ARE FOR GUIDELINES ONLY.
SEE NOTES ON FOLLOWING SHEET FOR ADDITIONAL REQUIREMENTS

WATER AND SEWER SEPARATION REQUIREMENTS

CITY OF MONTEREY PARK
PUBLIC WORKS DEPARTMENT—WATER DIVISION

STANDARD NO.
W-130

DRAWN	BY XX	DATE XX/XX/XX	APPROVED WATER UTILITY MANAGER	DATE 12/10/24
REVISD	XX	XX/XX/XX		
CHANGED	XX	XX/XX/XX	APPROVED CITY ENGINEER	DATE 12/11/24

SHEET 3 OF 4

NOTES:

1. SWRCB-DDW REGULATIONS REQUIRE THAT WATER MAINS BE INSTALLED A MINIMUM OF ONE (1) FOOT VERTICALLY ABOVE THE SANITARY SEWER MAINS.
2. FOR SITUATIONS IN WHICH THERE IS NO ALTERNATIVE BUT TO INSTALL WATER MAINS, SANITARY SEWER MAINS OR OTHER NON-POTABLE PIPELINES AT A DISTANCE LESS THAN THAT REQUIRED BY SWRCB-DDW REGULATIONS, THEN SPECIAL CONSTRUCTION SHOWN ON SHEET 3 OF 4 W-130, CAN BE USED AFTER REVIEW AND APPROVAL IN WRITING BY SWRCB-DDW.
3. FORCE SEWER MAINS ARE NOT PERMITTED IN ZONE C, AND IN ZONE D ONLY WITH SPECIAL CONSTRUCTION AS DETERMINED BY SWRCB-DDW
4. ALL WATER MAIN PIPE SHALL BE D.I.P. PER SECTION 2-01 AND SHALL RECEIVE A HOT DIP BITUMINOUS COATING.
5. PVC WATER MAIN CONSTRUCTION SHALL BE PRE-APPROVED BY THE UTILITY PER SECTION 2-02. PVC PIPE LARGER THAN 12-INCH DIAMETER IS NOT ALLOWED.
6. SEWER HOUSE LATERAL REPAIR CROSSING ABOVE A WATER MAIN SHALL BE CONTINUOUS 5-FT LENGTH VCP PIPE WITH FERNCO COUPLING OR APPROVED EQUAL.
7. WATER MAIN CROSSING BELOW AN EXISTING SEWER HOUSE LATERAL SHALL BE A CONTINUOUS FULL LENGTH PIPE CENTERED BELOW THE LATERAL.
8. INSTALLATION OF WATER MAINS, SANITARY SEWER MAINS, OR OTHER NON-POTABLE PIPELINES THAT DO NOT MEET THE MINIMUM SWRCB-DDW SEPARATION CRITERIA SHALL BE REVIEWED AND APPROVED IN WRITING BY SWRCB-DDW ON A CASE-BY-CASE BASIS PRIOR TO CONSTRUCTION.

WATER AND SEWER SEPARATION REQUIREMENTS

CITY OF MONTEREY PARK


PUBLIC WORKS DEPARTMENT-WATER DIVISION

STANDARD NO.

W-130

	BY	DATE		DATE
DRAWN	XX	XX/XX/XX	APPROVED WATER UTILITY MANAGER	<i>[Signature]</i> 12/10/24
REVISED	XX	XX/XX/XX		
CHANGED	XX	XX/XX/XX	APPROVED CITY ENGINEER	<i>[Signature]</i> 12/11/24

SHEET 4 OF 4

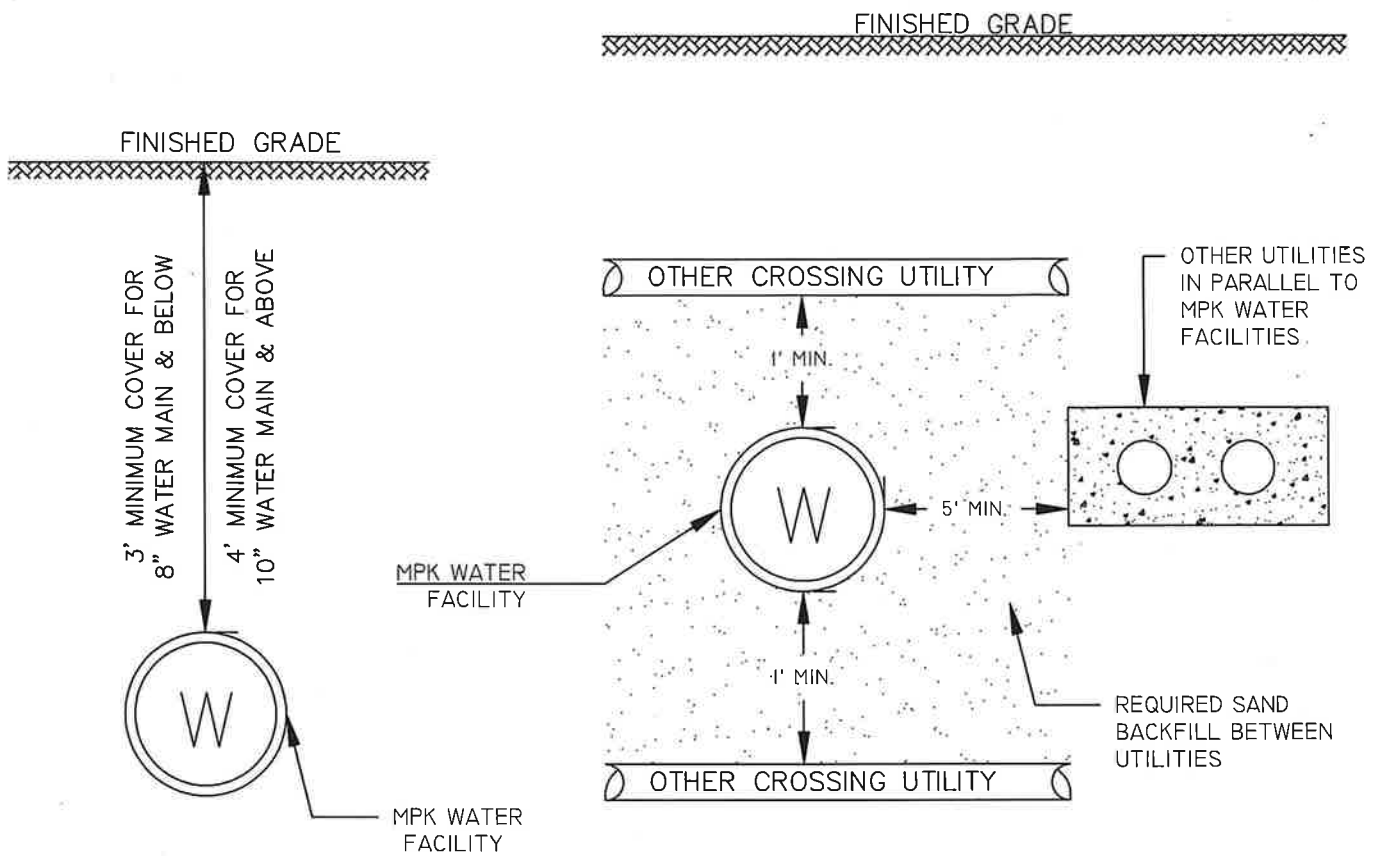

REQUIREMENTS:

1. ONE (1) FOOT MINIMUM VERTICAL SEPARATION OUTSIDE DIAMETER (O.D.) TO O.D. FROM ALL OTHER UTILITIES AND/OR ENCASEMENT.
2. FIVE (5) FEET MINIMUM HORIZONTAL CLEARANCE O.D. TO O.D. FOR PARALLEL UTILITIES AND/OR ENCASEMENT.
3. FOR STORM DRAIN FACILITIES, FIVE (5) FEET HORIZONTAL SEPARATION REQUIRED.
4. BACKFILL 12-INCHES OF SAND (NOT LESS THAN 30) OVER THE TOP AND BOTTOM OF MPW WATER FACILITY. THE SAND BACKFILL SHALL BE BETWEEN THE CROSSING & SHALL BE COMPACTED TO 90% RELATIVE DENSITY BY WATER DENSIFICATION METHODS. NO FLOODING ALLOWED.
5. FOR SEWER FACILITIES SEE STD. NO. W-130. TEN (10) FEET HORIZONTAL FOR SEWER FACILITIES REQUIRED.
6. VERIFY OTHER UTILITY OWNERS SEPARATION REQUIREMENT. THE MOST STRINGENT SHALL APPLY.
7. WHERE MINIMUM SEPARATION/CLEARANCES CANNOT BE MET, UTILITY OWNER MUST SUBMIT A WRITTEN REQUEST TO MPK, WITH PROPOSED DESIGN FOR REVIEW AND APPROVAL BY MPK.
8. IF MPK EXISTING WATERLINE IS IN CONFLICT WITH PROPOSED UTILITY, THE PROPOSED UTILITY OWNER SHALL TAKE SOLE RESPONSIBILITY FOR COSTS INCURRED DUE TO ANY MODIFICATION, RELOCATION, OR ALTERATION OF MPK EXISTING FACILITIES CAUSED BY PROPOSED PROJECT TO THE SATISFACTION OF CITY OF MONTEREY PARK – WATER DIVISION.

WATER MINIMUM SEPARATION FROM OTHER UTILITIES

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT – WATER DIVISION

STANDARD NO.

W-131

	BY	DATE
DRAWN	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

[Signature]

DATE 12/10/24

APPROVED
CITY ENGINEER


[Signature]

DATE 12/11/24


SHEET 1 OF 1

STEEL CASING AS SPECIFIED
 MIN. YEILD STRENGTH 35,000 PSI
 SLOPE CASING TO ONE END

CARRIER PIPE AS SPECIFIED

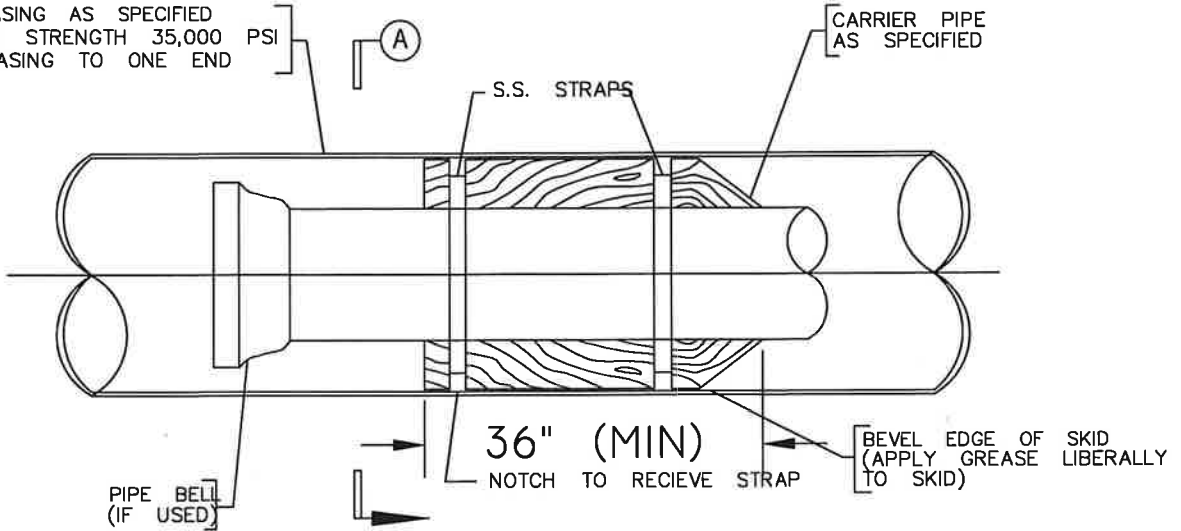

SIDE ELEVATION
 NO SCALE

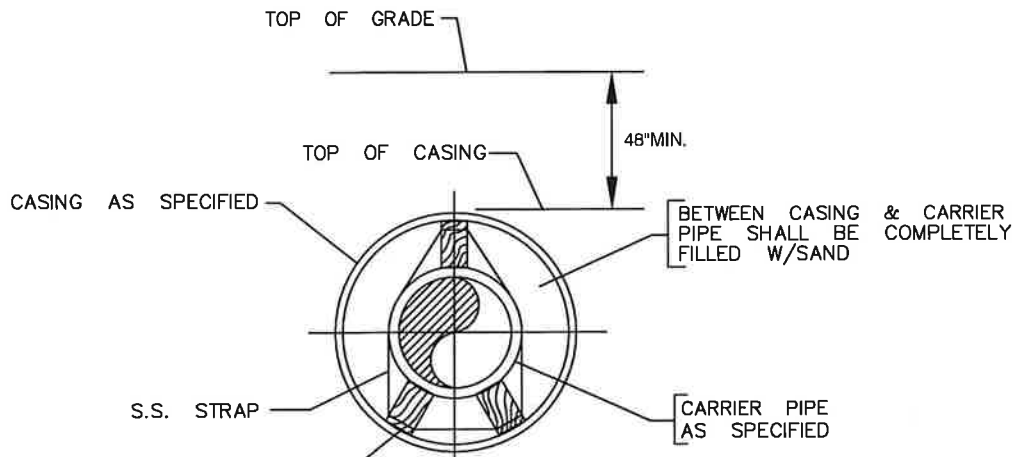

2" X 3" X 36" REDWOOD SKID (S4S)
 MIN. 2 SETS PER JOINT (MIN 10' SEP.)
 (DO NOT WEDGE SKID AGAINST CASING)

SECTION 'A'
 NO SCALE

NOTES:

1. IF BORE HOLE IS GREATER THAN 1" LARGER THAN CASING O.D. OR IF VOIDS ARE CREATED THE SPACE SHALL BE FILLED BY GROUTING OR OTHER REMEDIAL MEASURES.
2. CASING ENDS SHALL BE SEALED WITH A 1 SACK SLURRY MIX AT ENDS ONLY OR BRICK & MORTAR.
3. CASING SHALL BE ELECTRICALLY ISOLATED FROM CARRIER PIPE.

TYPICAL CASING DETAIL

CITY OF MONTEREY PARK
 PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-132

DRAWN	BY	DATE
	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
 WATER UTILITY MANAGER

DATE


12/10/24

APPROVED
 CITY ENGINEER

DATE

12/11/24


SHEET 1 OF 1

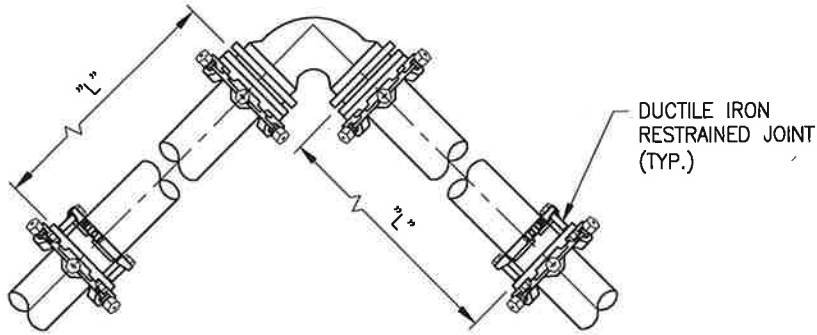

		PIPE SIZE							
		4	6	8	12	16	18	20	24
BEND ANGLE	11.25°	3	5	6	7	9	10	11	13
	22.5°	7	9	12	15	19	21	23	26
	45°	14	19	25	31	39	49	47	54
	90°	33	45	59	74	94	104	113	131

RESTRAINED LENGTH "L" IN FEET

HORIZONTAL BEND

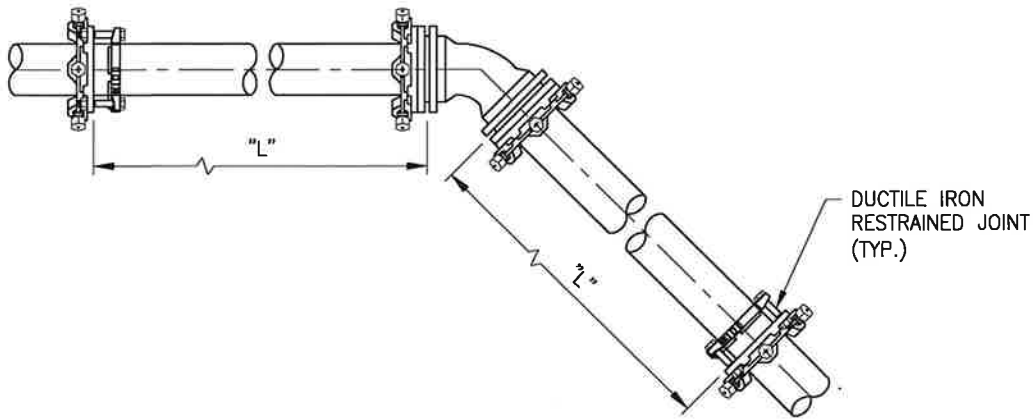

		PIPE SIZE							
		4	6	8	12	16	18	20	24
BEND ANGLE	11.25°	10	15	19	24	30	34	37	43
	22.5°	21	29	38	48	61	66	74	87
	45°	43	61	79	100	128	142	155	181

RESTRAINED LENGTH "L" IN FEET

VERTICAL BEND

NOTES:

1. IF ACTUAL CONDITIONS DIFFER FROM THOSE LISTED ABOVE OR THE REQUIRED RESTRAINED LENGTH CANNOT BE MET, THE RESTRAINED LENGTH SHALL BE DETERMINED BY THE DESIGN ENGINEER AND CONCURRED WITH THE CITY ENGINEER.
2. RESTRAINTS INSTALLED PER SECTION 2-02.03 OR 2-12.

RESTRAINT OF JOINTS FOR DUCTILE IRON & PVC PIPE AT 90-DEGREE VERTICAL OR HORIZONTAL BEND

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-138

	BY	DATE
DRAWN	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER


APPROVED
CITY ENGINEER

[Signature]
[Signature]

DATE 12/10/24
DATE 10/11/24

SHEET 1 OF 1

DUCTILE IRON
RESTRAINED JOINT
(TYP.)

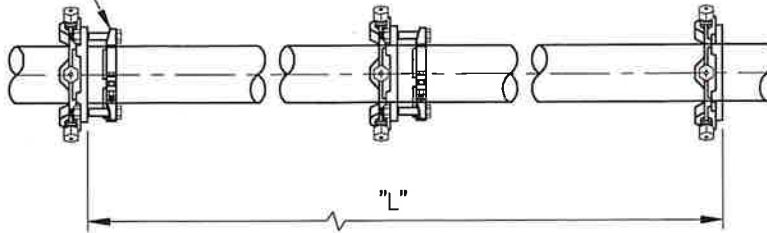

PIPE SIZE IN INCHES	4	6	8	12	16	18	20	24
RESTRAINED LENGTH "L" IN FEET	104	148	191	240	309	342	374	438

DEAD END

NOTES:

1. ALL JOINT WITHIN LENGTH "L" SHALL BE RESTRAINED.
2. ASSUMED DEPTH OF COVER FOR 8" PIPE OR LESS TO BE 3.5' MIN. (42"); 16" PIPE OR GREATER TO BE 4.0'MIN. (48").
3. ASSUMPTIONS FOR DETERMINING LENGTH SHOWN:
 - TEST PRESSURE: 225PSI
 - TYPE 4 LAYING CONDITIONS
 - A SAFETY FACTOR OF 2
 - SAND/SILT SOIL CONDITIONS
 - POLYETHYLENE WRAP
4. LENGTH CALCULATED USING DIPRA RESTRAINT JOINT PROGRAM
5. IF ACTUAL CONDITIONS DIFFER FROM THOSE LISTED ABOVE OR THE REQUIRED RESTRAIN LENGTH CANNOT BE MET, THE RESTRAINED LENGTH SHALL BE DETERMINED BY THE DESIGN ENGINEER AND CONCURRED WITH THE CITY ENGINEER
6. RESTRAINS INSTALLED PER SECTION 2-02.03 OR 2-12.

RESTRAINT OF JOINTS FOR DUCTILE IRON AND PVC PIPE AT A DEAD END OR EACH SIDE OF VALVE

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT-WATER DIVISION

STANDARD NO.

W-139

DRAWN	BY	DATE
	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX


APPROVED
WATER UTILITY MANAGER

DATE 12/10/24


APPROVED
CITY ENGINEER

DATE 12/11/24


SHEET 1 OF 1

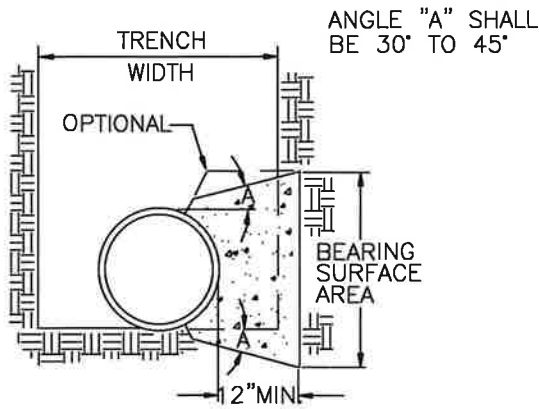


TYPICAL SECTION

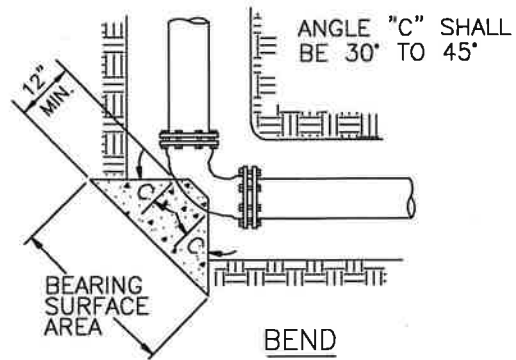


BEND

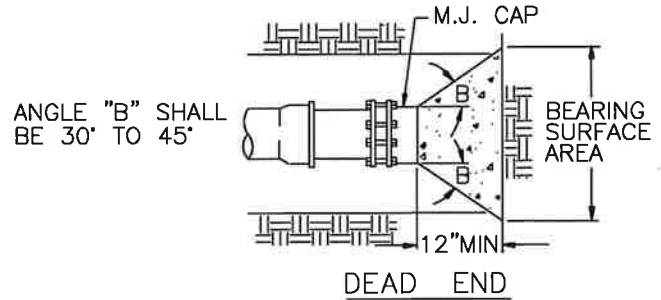

DEAD END

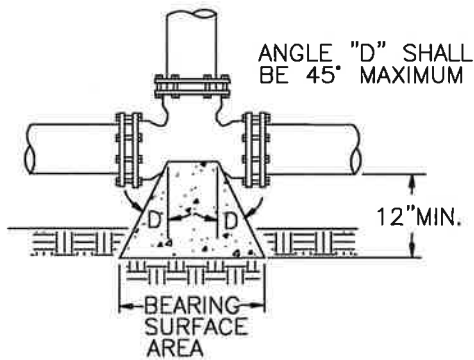

TEE AND TAPPING SLEEVES

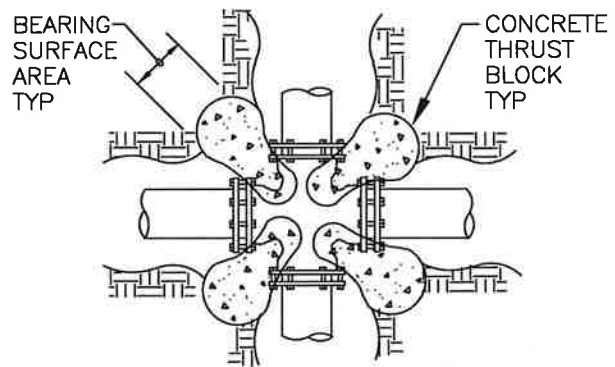

CROSS

NOTES:

1. CONCRETE FOR THRUST BLOCK SHALL CONFORM TO SECTION XXX
2. CONCRETE SHALL BE POURED AGAINST UNDISTURBED SOIL.
3. CONCRETE SHALL HAVE 3" MINIMUM CLEARANCE AROUND ALL JOINTS.
4. BEARING SURFACE AREA REQUIREMENTS SHALL BE PER STD. NO. W-142 OR AS INDICATED ON CONSTRUCTION DRAWINGS.
5. THRUST BLOCKS FOR CROSS SHALL BE USED WHEREVER PIPE SIZES DIFFER OR WHEN ONE OR MORE OPENINGS ARE PLUGGED. SIZE WILL BE BASED ON THE LARGER MAIN.

TYPICAL THRUST BLOCK DETAILS (4" TO 16" DIA. FITTING)

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-140

	BY	DATE
DRAWN	XX	XX/XX/XX
REVISED	XX	XX/XX/XX
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

DATE

[Signature]
12/10/24

APPROVED
CITY ENGINEER

DATE

[Signature]
12/11/24

SHEET 1 OF 1

DEAD END, TEE OUTLET, CROSS, & TAPPING SLEEVE

PIPE DIA.	STATIC WATER PRESSURE—P.S.I.										
	100	110	120	130	140	150	160	170	180	190	200
4"&6"	2.5	2.5	3.0	3.0	3.0	3.5	3.5	4.0	4.0	4.0	4.5
8"	4.0	4.5	4.5	5.0	5.5	6.0	6.0	6.5	7.0	7.5	7.5
10"	6.0	6.5	7.5	8.0	8.5	9.0	9.5	10.0	11.0	11.5	12.0
12"	8.5	9.5	10.5	11.0	12.0	13.0	14.0	14.5	15.5	16.5	17.0
16"	15.5	17.0	18.5	20.0	21.5	23.0	24.5	26.0	27.5	29.0	30.5

BENDS

PIPE DIA.	BEND	STATIC WATER PRESSURE—P.S.I.										
		100	110	120	130	140	150	160	170	180	190	200
4" & 6"	90°	3.0	3.5	4.0	4.0	4.5	4.5	5.0	5.5	5.5	6.0	6.0
	45°	2.0	2.0	2.0	2.5	2.5	2.5	3.0	3.0	3.0	3.5	3.5
	22½°	1.0	1.0	1.0	1.5	1.5	1.5	1.5	1.5	1.5	2.0	2.0
	11¼°	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
8"	90°	5.5	6.0	6.5	7.0	7.5	8.0	8.5	9.5	10.0	10.5	11.0
	45°	3.0	3.5	3.5	4.0	4.0	4.5	5.0	5.0	5.5	5.5	6.0
	22½°	1.5	2.0	2.0	2.0	2.5	2.5	2.5	2.5	3.0	3.0	3.0
	11¼°	1.0	1.0	1.0	1.0	1.0	1.5	1.5	1.5	1.5	1.5	1.5
10"	90°	8.5	9.5	10.0	11.0	12.0	12.5	13.5	14.5	15.0	16.0	17.0
	45°	4.5	5.0	5.5	6.0	6.5	7.0	7.5	8.0	8.5	9.0	9.0
	22½°	2.5	2.5	3.0	3.0	3.5	3.5	4.0	4.0	4.5	4.5	5.0
	11¼°	1.5	1.5	1.5	1.5	2.0	2.0	2.0	2.0	2.5	2.5	2.5
12"	90°	12.0	13.5	14.5	16.0	17.0	18.0	19.5	20.5	22.0	23.0	24.0
	45°	6.5	7.5	8.0	8.5	9.5	10.0	10.5	11.0	12.0	12.5	13.0
	22½°	3.5	4.0	4.0	4.5	5.0	5.0	5.5	6.0	6.0	6.5	7.0
	11¼°	2.0	2.0	2.0	2.5	2.5	2.5	3.0	3.0	3.0	3.5	3.5
16"	90°	21.5	23.5	26.0	28.0	30.0	32.0	34.5	36.5	38.5	40.5	43.0
	45°	11.5	13.0	14.0	15.0	16.5	17.5	18.5	20.0	21.0	22.0	23.5
	22½°	6.0	6.5	7.5	8.0	8.5	9.0	9.5	10.0	11.0	11.5	12.0
	11¼°	3.0	3.5	3.5	4.0	4.5	4.5	5.0	5.0	5.5	6.0	6.0

NOTES:

1. AREA REQUIREMENTS ARE BASED UPON 1 ½ TIMES STATIC WATER PRESSURE, AND SOIL BEARING PRESSURE OF 2000 LBS/SQ FT. DESIGN ENGINEER SHALL DETERMINE SIZES FOR OTHER SOIL BEARING VALUES.
2. UNITS OF AREA REQUIREMENTS ARE "SQUARE FEET."
3. SEE STD. NO. W-140 FOR TYPICAL THRUST BLOCK DETAILS.
4. THRUST BLOCK WIDTH SHALL BE BETWEEN ONE AND TWO TIMES ITS HEIGHT.
5. DESIGN ENGINEER SHALL DETERMINE SIZES FOR PIPE LARGER THAN 12" AND SUBMIT TO UTILITIES FOR APPROVAL.

THRUST BLOCK AREA REQUIREMENTS

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT—WATER DIVISION

STANDARD NO.

W-142

	BY	DATE
DRAWN	XX	XX/XX/XX
REVISED	XX	XX/XX/XX
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

[Signature]

DATE

12/10/24

APPROVED
CITY ENGINEER


DATE

12/11/24


SHEET 1 OF 1

ANCHOR BLOCK DIMENSIONS

D	VARIABLE	STATIC WATER PRESSURE - PSI										
		100	110	120	130	140	150	160	170	180	190	200
30"	AREA SF	2.1	2.3	2.5	2.8	3.0	3.2	3.4	3.6	3.8	4.0	4.2
	W (INCHES)	14	14	16	18	18	13	14	15	15	16	17
	X (INCHES)	0	0	0	0	0	6	6	6	6	6	6
30"	AREA SF	3.8	4.1	4.5	4.9	5.3	5.7	6.0	6.4	6.8	7.2	7.5
	W (INCHES)	10	12	12	14	16	16	14	16	16	18	18
	X (INCHES)	6	6	6	6	6	6	9	9	9	9	9
30"	AREA SF	5.9	6.5	7.1	7.7	8.2	8.8	9.4	10.0	10.6	11.2	11.8
	W (INCHES)	16	18	16	18	16	18	18	20	22	24	24
	X (INCHES)	6	6	9	9	12	12	12	12	12	12	12
36"	AREA SF	8.5	9.3	10.2	11.0	11.9	12.7	13.6	14.4	15.3	16.1	17.0
	W (INCHES)	18	16	18	20	22	24	20	20	22	24	26
	X (INCHES)	9	12	12	12	12	12	18	18	18	18	18
36"	AREA SF	15.1	16.6	18.1	19.6	21.1	22.6	24.1	25.6	27.1	28.7	30.2
	W (INCHES)	18	18	18	18	18	18	20	20	22	22	24
	X (INCHES)	15	15	18	21	25	30	30	30	30	30	30

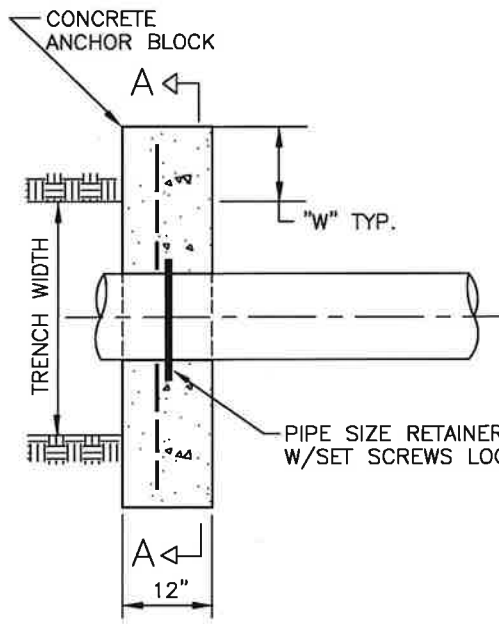

PLAN

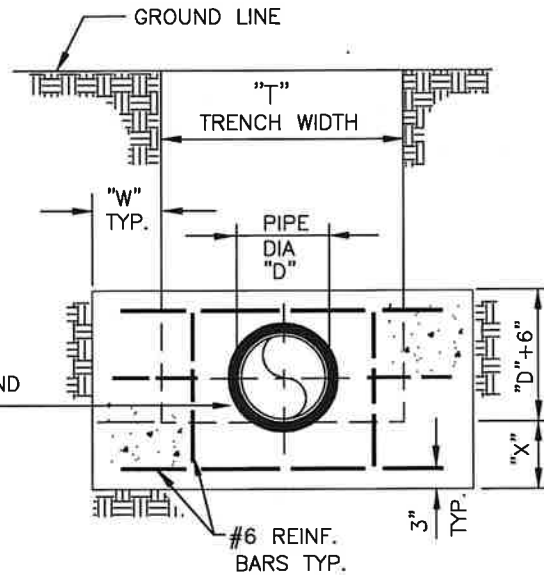

SECTION A-A

NOTES:

1. ANCHOR BLOCK SHALL BE 560-C-3250 (3250 P.S.I. AT 28 DAYS).
2. CONCRETE SHALL BE POURED AGAINST UNDISTURBED EARTH.
3. DIMENSIONS ARE BASED ON 1.5 TIMES STATIC WATER PRESSURE, 2000 P.S.F. SOIL BEARING CAPACITY PRESSURE & 60,000 LB. REINF. BAR TENSILE STRENGTH.

ANCHOR BLOCK ASSEMBLY FOR 6" THROUGH 16" PIPE

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-143

DRAWN	BY	DATE	
	XX	XX/XX/XX	
REVISED	XX	XX/XX/XX	
CHANGED	XX	XX/XX/XX	

APPROVED
WATER UTILITY MANAGER

[Signature]

DATE

12/10/24


APPROVED
CITY ENGINEER

[Signature]

DATE

12/11/24

SHEET 1 OF 1

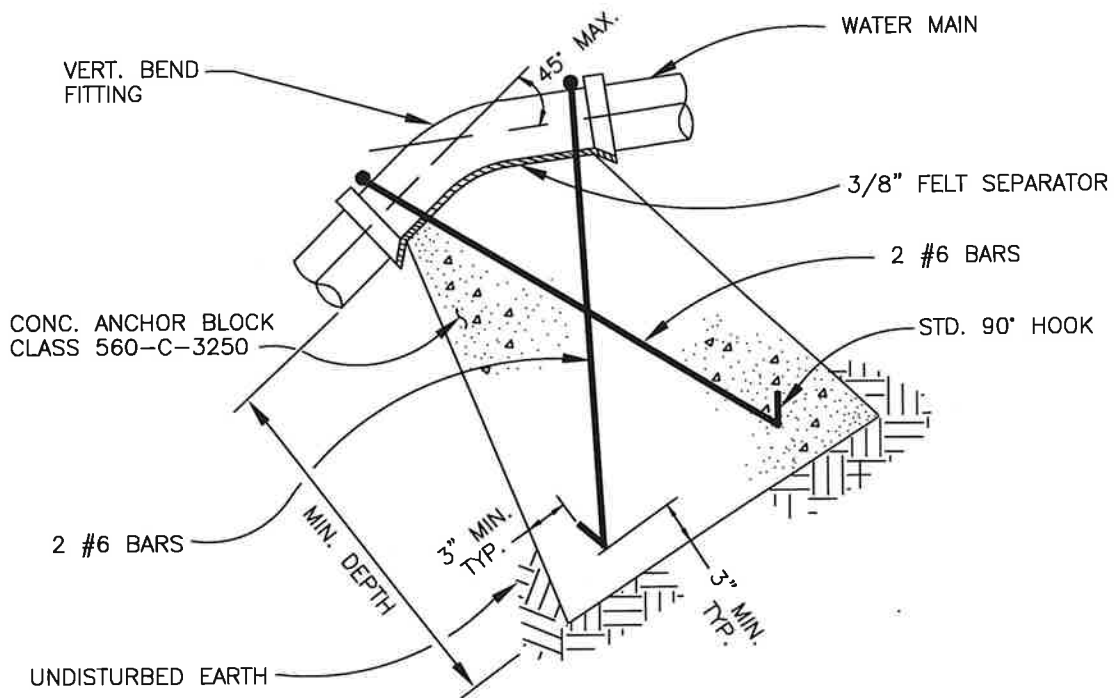

VERTICAL DOWN BEND

NOTES:

1. CONCRETE FOR GRAVITY ANCHOR BLOCK SHALL CONFORM TO SECTION XXX.
2. CONCRETE SHALL BE POURED AGAINST UNDISTURBED SOIL. IF THERE IS A POSSIBILITY OF THE ANCHOR BLOCK BEING DISTURBED AFTER CONSTRUCTION, ADDITIONAL MECHANICAL THRUST RESTRAINING DEVICES APPROVED BY UTILITY SHALL BE INSTALLED.
3. CONCRETE SHALL HAVE 3" MINIMUM CLEARANCE AROUND ALL JOINTS.
4. ALL REINFORCES STEEL SHALL BE #6 BAR.
5. FOR VERTICAL UP BEND, SEE THRUST BLOCK REQUIREMENTS PER STD. NO. W-140 & W-142.
6. FOR PIPED LARGER THAN 12 INCH DIAMETER, RESTRAINED JOINTS APPROVED BY UTILITY SHALL BE INSTALLED IN LIEU OF ANCHOR BLOCKS.
7. SIZING REQUIREMENTS ARE BASED UPON $1 \frac{1}{2}$ TIMES STATIC WATER PRESSURE, AND SOIL BEARING PRESSURE OF 2000PSI. DESIGN ENGINEER SHALL DETERMINE SIZES FOR OTHER SOIL BEARING VALUES.

GRAVITY ANCHOR BLOCK DETAIL

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-144

DRAWN	XX	DATE	XX/XX/XX	APPROVED WATER UTILITY MANAGER	DATE		12/10/24
REVISION	XX	DATE	XX/XX/XX				
CHANGED	XX	DATE	XX/XX/XX	APPROVED CITY ENGINEER			10/11/24

SHEET 1 OF 2

Static Pressure – P.S.I.		60	70	80	90	100	110	120	130	140	150	160	170	180	190	200	
VERTICAL DOWN BENDS – Minimum Dimensions in feet																	
Pipe Dia.	Change in Slope																
6	1.5:1	Volume (C.F.)	16.8	17.6	20.2	22.7	25.2	27.7	30.2	32.8	35.3	37.8	40.3	42.9	45.4	47.9	50
	1.5:1	Depth (Ft.)	2.7	2.8	3.2	3.6	4.0	3.1	3.4	3.6	3.9	4.2	4.5	3.5	3.7	3.9	4.
	2:1	Volume (C.F.)	13.5	14.2	16.3	18.3	20.3	22.4	24.4	26.4	28.5	30.5	32.5	34.5	36.6	38.6	40.6
	2:1	Depth (Ft.)	3.4	3.6	2.6	2.9	3.3	3.6	3.9	4.2	3.2	3.4	3.6	3.8	4.1	4.3	4.5
8	1.5:1	Volume (C.F.)	29.9	31.4	35.8	40.3	44.8	49.3	53.8	58.3	62.7	67.2	71.7	76.2	80.7	85.1	89.6
	1.5:1	Depth (Ft.)	3.3	3.5	4.0	4.5	3.7	4.0	4.4	4.8	5.1	4.2	4.5	4.8	5.0	5.3	5.6
	2:1	Volume (C.F.)	24.1	25.3	28.9	32.5	36.1	39.7	43.4	47.0	50.6	54.2	57.8	61.4	65.0	68.6	72.3
	2:1	Depth (Ft.)	3.9	4.0	3.2	3.6	4.0	4.4	4.8	3.8	4.1	4.4	4.7	5.0	4.1	4.3	4.5
10	1.5:1	Volume (C.F.)	46.7	49.0	56.0	63.0	70.0	77.0	84.0	91.0	98.0	105.0	112.0	119.0	126.0	133.0	140.0
	1.5:1	Depth (Ft.)	3.8	4.0	4.6	5.1	4.4	4.8	5.3	5.7	4.8	5.2	5.5	5.9	5.0	5.3	5.6
	2:1	Volume (C.F.)	37.6	39.5	45.2	50.8	56.4	62.1	67.7	73.4	79.0	84.7	90.3	96.0	101.6	107.3	112.9
	2:1	Depth (Ft.)	4.2	4.4	3.7	4.1	4.6	5.1	4.2	4.6	4.9	5.3	5.6	4.7	5.0	5.3	5.6
12	1.5:1	Volume (C.F.)	67.2	70.6	80.7	90.7	100.8	110.9	121.0	131.1	141.2	151.2	161.3	171.4	181.5	191.6	201.6
	1.5:1	Depth (Ft.)	4.2	4.4	5.0	4.5	5.0	5.5	6.0	5.2	5.6	6.0	6.5	5.7	6.0	6.3	6.7
	2:1	Volume (C.F.)	54.2	56.9	65.0	73.2	81.3	89.4	97.5	105.7	113.8	121.9	130.1	138.2	146.3	154.4	162.6
	2:1	Depth (Ft.)	4.4	4.6	4.1	4.6	5.1	5.6	4.8	5.2	5.6	6.0	5.2	5.5	5.9	6.2	6.5



GRAVITY ANCHOR BLOCK DETAIL

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT – WATER DIVISION


STANDARD NO.

W-144

DRAWN	BY	DATE	APPROVED WATER UTILITY MANAGER		DATE	12/10/24
	XX	XX/XX/XX				
REVISED	XX	XX/XX/XX	APPROVED CITY ENGINEER		DATE	12/11/24
CHANGED	XX	XX/XX/XX				

SHEET 2 OF 2

MINIMUM BACKFILL COMPACTION SHALL BE 90%

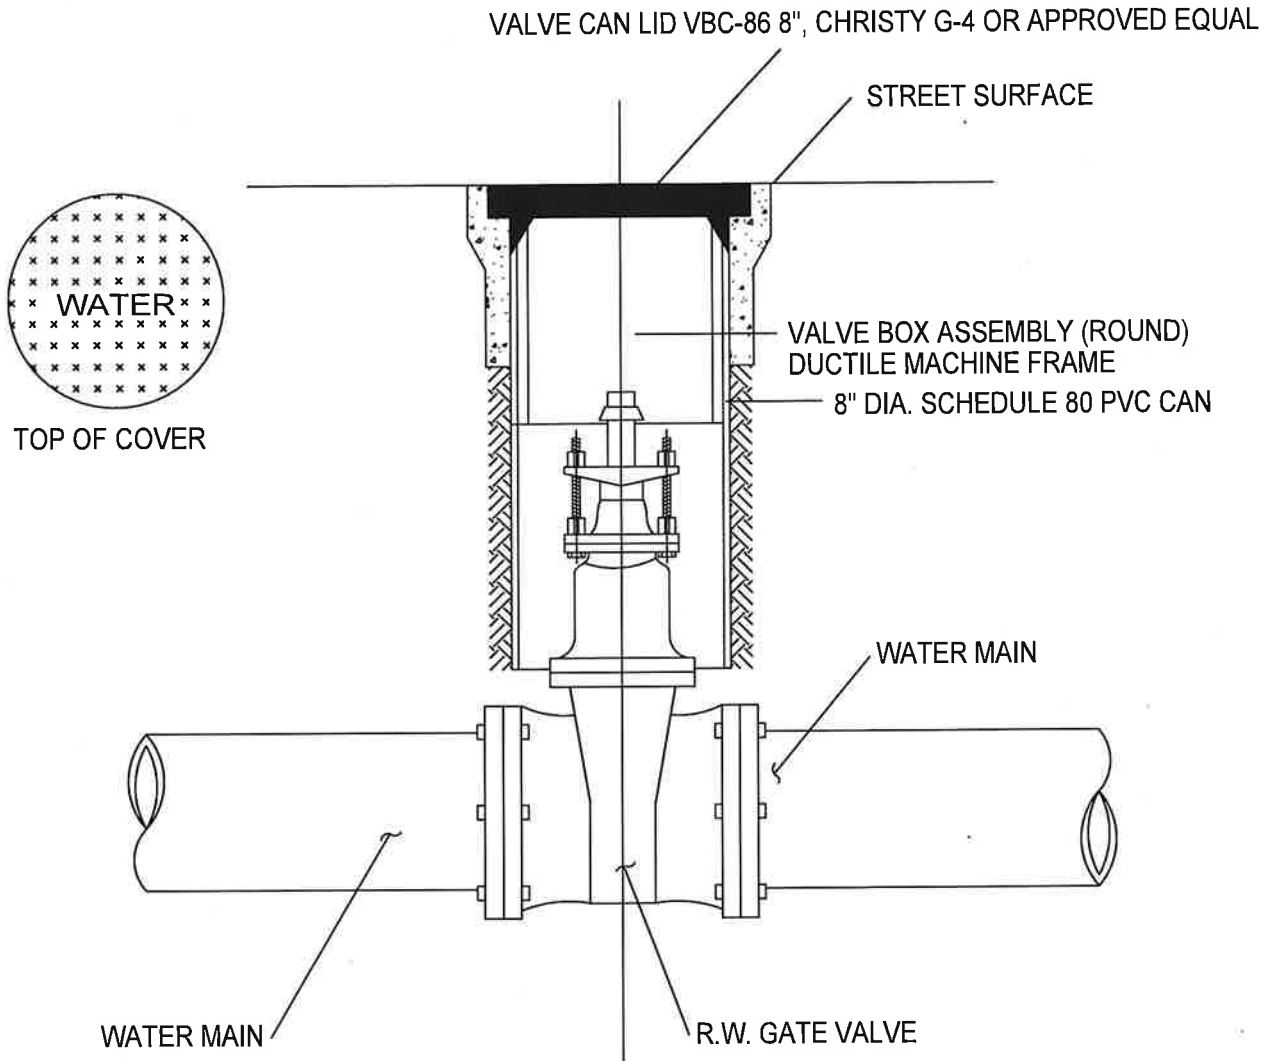

SIDE ELEVATION

NO SCALE

NOTES:

1. 3" ASPHALT CAP SHALL BE HOT MIX TYPE PER PUBLIC WORKS
2. OPERATING NUT FOR BUTTERFLY VALVE SHALL BE PLACED NORTH OR EAST OF THE WATER MAIN

STANDARD VALVE BOX ASSEMBLY

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT—WATER DIVISION


STANDARD NO.

W-150

	BY	DATE		
DRAWN	XX	XX/XX/XX	APPROVED WATER UTILITY MANAGER	<i>[Signature]</i> DATE 12/10/24
REVISED	XX	XX/XX/XX		
CHANGED	XX	XX/XX/XX	APPROVED CITY ENGINEER	<i>[Signature]</i> DATE 12/11/24

SHEET 1 OF 1

*SEE DRAWING W-150,
"STANDARD VALVE BOX
ASSEMBLY", FOR VALVE DETAILS

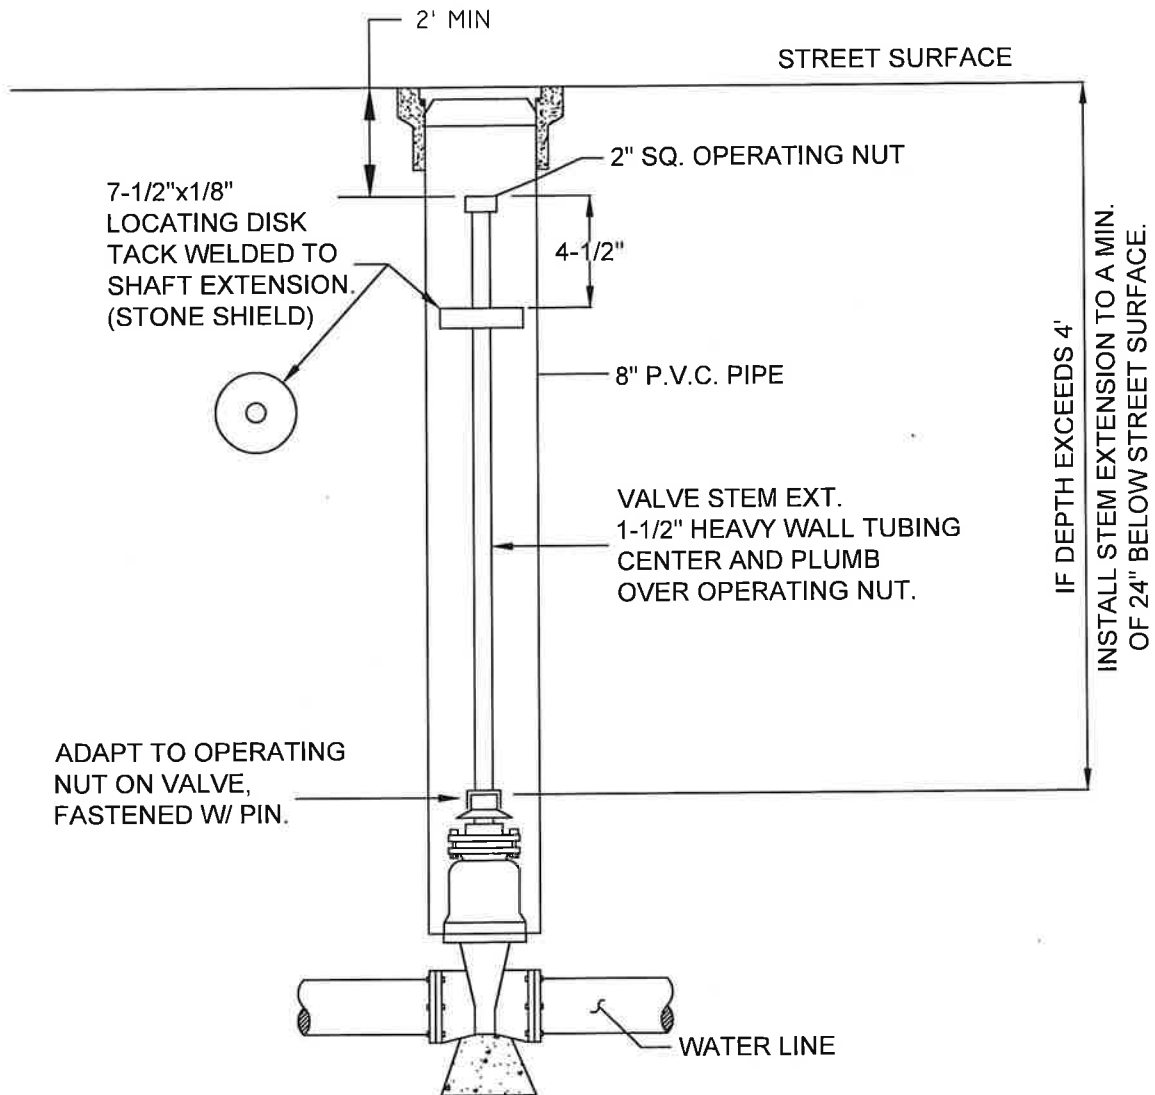

SIDE ELEVATION
NO SCALE

VALVE BOX AND STEM EXTENSION

CITY OF MONTEREY PARK
PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-151

	BY	DATE
DRAWN	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

[Signature]

DATE

12/10/24


APPROVED
CITY ENGINEER

[Signature]

DATE

12/11/24

SHEET 1 OF 1

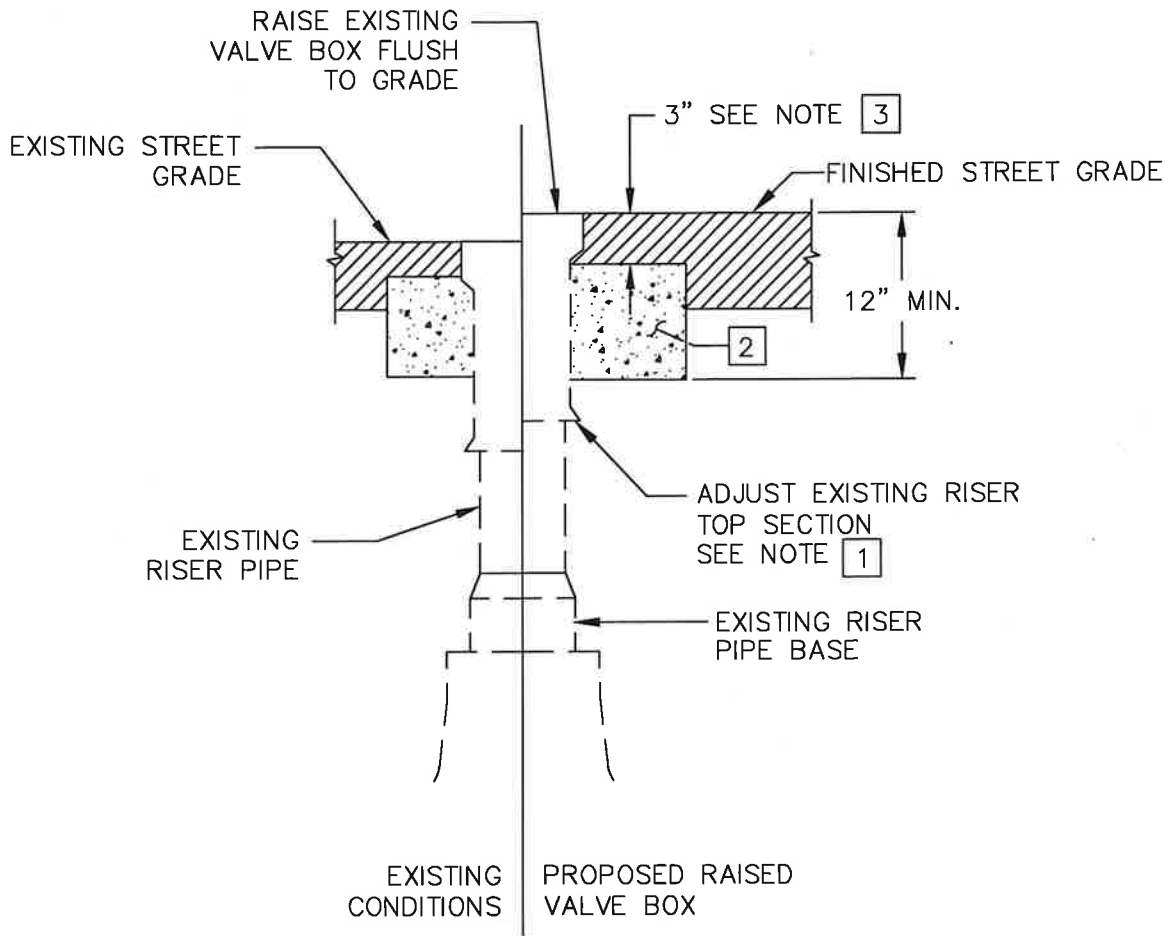

CASE 1

NOTES:

1. CONTRACTOR TO EXPOSE THE EXISTING VALVE BOX FOR THE WATER UTILITY INSPECTOR TO DETERMINE CONDITION OF EXISTING BOX. INSPECTOR SHALL DIRECT CONTRACTOR TO ADJUST EXISTING VALVE BOX FLUSH TO GRADE AS SHOWN ABOVE, OR REPLACE THE TOP SECTION OF VALVE BOX AS SHOWN IN DETAIL W-152 SHEET 2 OR DIRECT CONTRACTOR TO REMOVE AND REPLACE ENTIRE EXISTING VALVE BOX WITH NEW AS PER W-150 & W-151.
2. INSTALL CONCRETE COLLAR AROUND VALVE BOX, 8" WIDTH PER STD. NO. W-150. CONCRETE SHALL BE CLASS 520-A-2500 WITH A MAXIMUM 3" SLUMP.
3. 3" ASPHALT CAP SHALL BE HOT MIX TYPE PER PUBLIC WORKS STANDARD DETAIL 132.

VALVE BOX RAISING

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-152

DRAWN	BY	DATE
	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

[Signature]

DATE

12/10/24

APPROVED
CITY ENGINEER

[Signature]


DATE

12/11/24

SHEET 1 OF 2

LIST OF MATERIAL

ITEM	DESCRIPTION
1	SCREW TYPE CAST IRON VALVE BOX, TYLER UNION 6860 OR BINGHAM & TAYLOR NO. 4906 (OR APPROVED EQUAL) WITH HEAVY DUTY TOP SECTION
2	BINGHAM & TAYLOR, MARK V ROUND 10" RIM WITH FLANGE AND ROUND 10" LID WITH 4" SKIRT

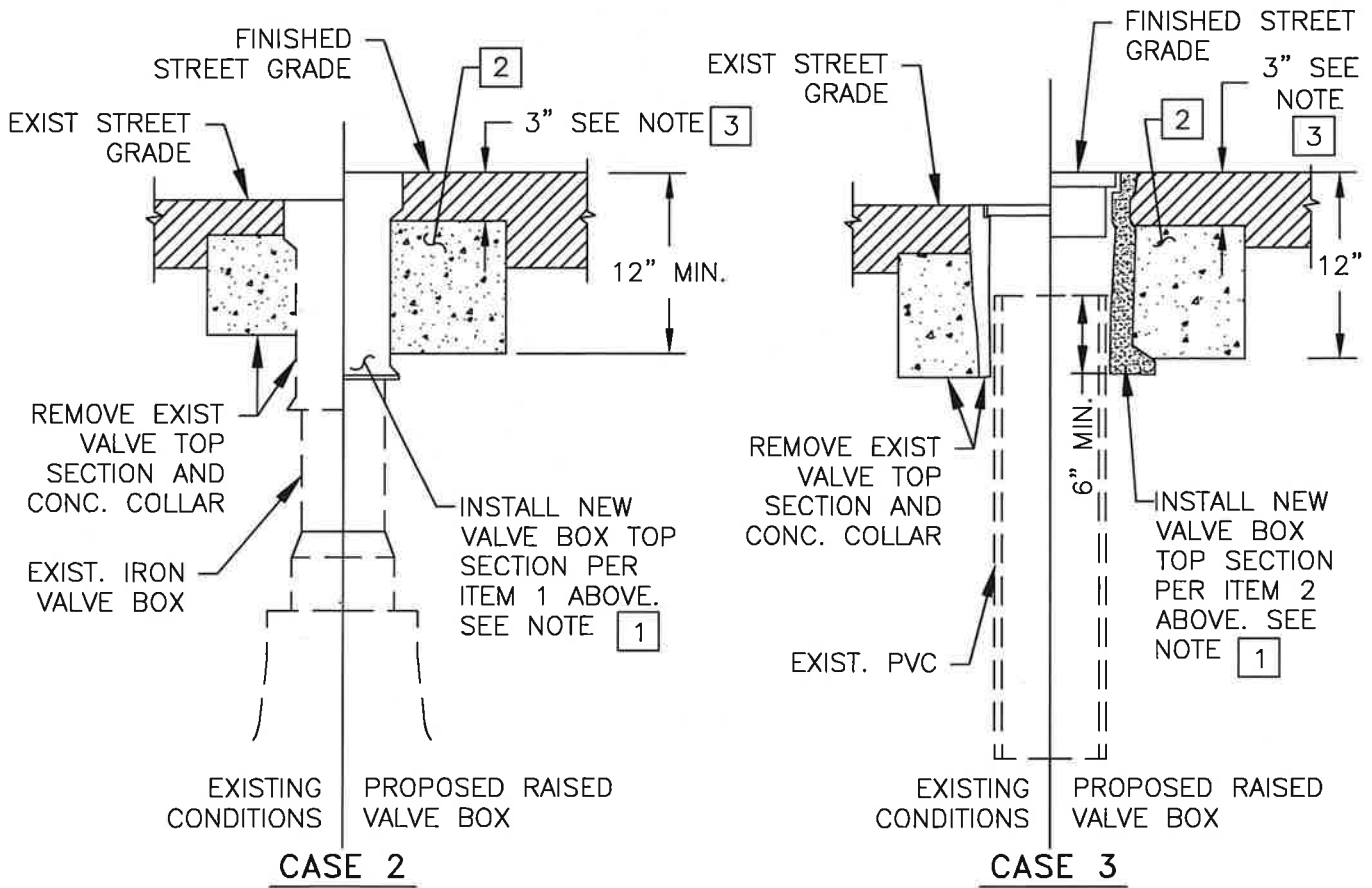

NOTES:

1. CONTRACTOR TO EXPOSE THE EXISTING VALVE BOX FOR THE WATER UTILITY INSPECTOR TO DETERMINE CONDITION OF EXISTING BOX. INSPECTOR SHALL DIRECT CONTRACTOR TO REPLACE THE TOP SECTION OF VALVE BOX AS SHOWN OR DIRECT CONTRACTOR TO REMOVE AND REPLACE ENTIRE EXISTING VALVE BOX WITH NEW AS PER W-150 & W-151.
2. INSTALL CONCRETE COLLAR AROUND VALVE BOX, 8" WIDTH PER STD. NO. W-150. CONCRETE SHALL BE CLASS 520-A-2500 WITH A MAXIMUM 3" SLUMP.
3. 3" ASPHALT CAP SHALL BE HOT MIX TYPE PER PUBLIC WORKS STANDARD DETAIL 132.

VALVE BOX RAISING

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION


STANDARD NO.

W-152


DRAWN	BY	DATE
AM	10/02/24	APPROVED
DZ	10/02/24	WATER UTILITY MANAGER
XX	XX/XX/XX	APPROVED
XX	XX/XX/XX	CITY ENGINEER

APPROVED WATER UTILITY MANAGER *[Signature]* DATE 12/10/24
 APPROVED CITY ENGINEER *[Signature]* DATE 12/17/24


SHEET 2 OF 2

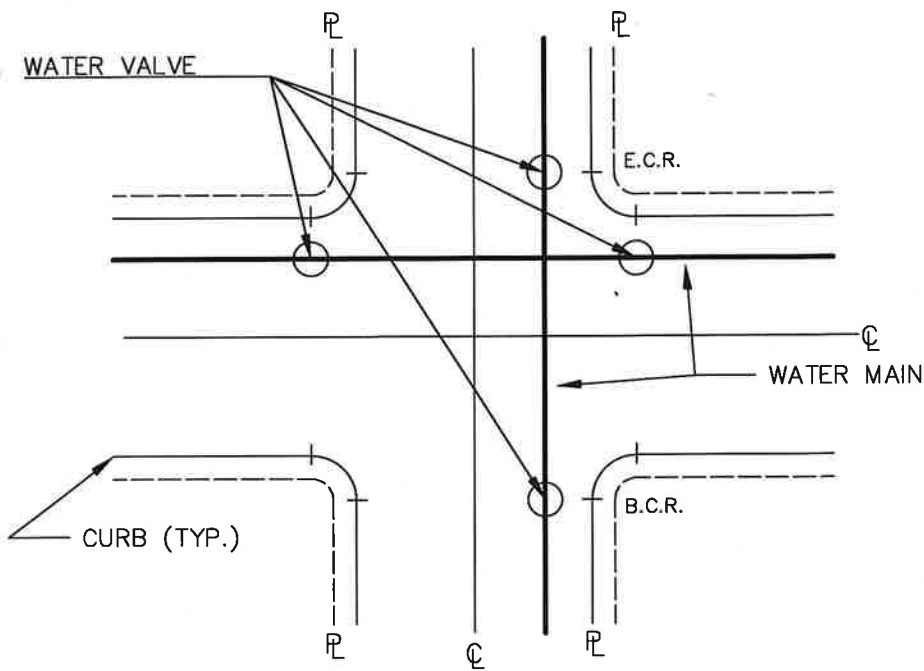

ARTERIAL HIGHWAYS

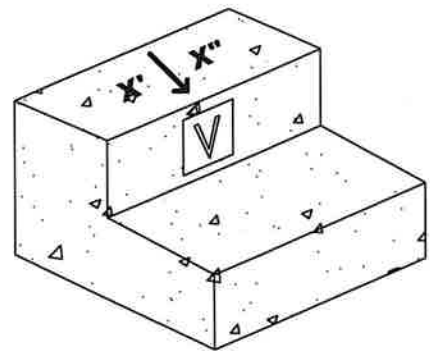

DETAIL A

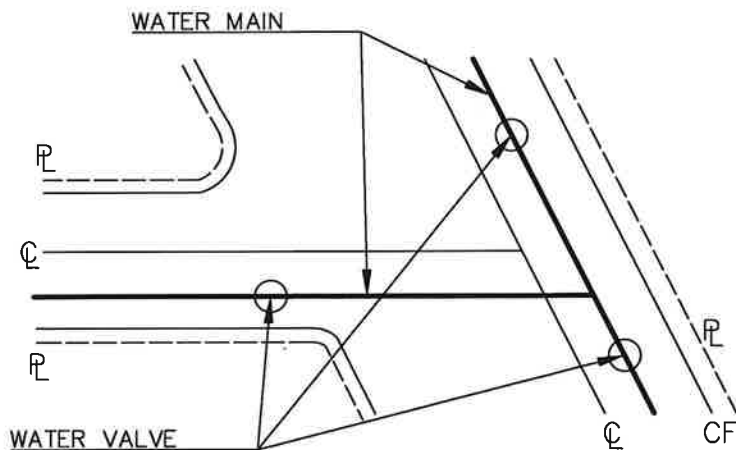

LOCAL STREETS/
ALLEYS

WATER MAIN CONNECTIONS AT INTERSECTIONS

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-154

DRAWN	BY	DATE
	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

[Signature] DATE 12/10/24
[Signature] DATE 12/11/24

APPROVED
CITY ENGINEER

SHEET 1 OF 2

NOTES:

1. WATER VALVES SHALL BE INSTALLED AT EACH STREET INTERSECTION AND ON EACH PIPE RUN. THE VALVE SHALL BE LOCATED ON THE PROPERTY LINE EXTENDED FOR STREETS AND ALLEYS OR OPPOSITE CURB RETURNS ON ARTERIAL HIGHWAYS, SEE FIGURES SHEET 1.
2. THE MAXIMUM DISTANCE BETWEEN VALVES SHALL BE 600' (FEET). VALVES SHALL BE EQUALLY SPACED BETWEEN INTERSECTIONS OR CONNECTIONS.
3. WHERE WATER MAIN IS IN AN EASEMENT, THE MAIN SHALL HAVE A WATER VALVE AT EACH END OF THE EASEMENT.
4. REFLECTIVE "V" TILE SHALL BE PLACED ON CURB AS DIRECTED BY WATER UTILITY SEE DETAIL A.
 - 4.1. REFLECTIVE RED FOR FIRE HYDRANTS/FIRE LINE
 - 4.2. REFLECTIVE AMBER FOR ALL OTHERS
5. ALL WATER VALVES SHALL BE RESILIENT SEATED GATE VALVES, MANUFACTURES PER AWWA C509. VALVES SHALL BE NON-RINSING STEM, OPEN COUNTERCLOCKWISE, WITH MEGALUG JOINTS. VALVES SHALL BE EPOXY LINED AND COATED AND HAVE 316 STAINLESS STEEL HARDWARE.
6. BUTTERFLY VALVES, IN LIEU OF GATE VALVES, WILL BE DETERMINED BY DESIGN ENGINEER & SPECIFIED IN CONSTRUCTION PLANS WILL BE INSTALLED PER SECTION 2-05.02.
7. A VALVE BOX AND COVER SHALL BE INSTALLED AT EACH VALVE AND SHALL BE BROUGHT TO FINISH GRADE AT COMPLETION OF PAVING, PER STD W-150.
8. THRUST BLOCKS OR RESTRAINT SHALL BE CONSTRUCTED IN ACCORDANCE WITH STD W-140 THRU W-144.



WATER MAIN CONNECTIONS AT INTERSECTIONS

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.


W-154

DRAWN	BY AM	DATE 10/02/24	APPROVED WATER UTILITY MANAGER		DATE 12/10/24
REVISD	DZ	10/02/24	APPROVED CITY ENGINEER		DATE 12/11/24
CHANGED	XX	XX/XX/XX			


SHEET 2 OF 2

MAIN LINE VALVE.....	SAFETY BLUE
FIRE HYDRANT VALVE.....	SAFETY RED
METER VALVE.....	SAFETY BLUE
FIRE SERVICE VALVE.....	SAFETY RED
TRANSMISSION MAIN VALVE.....	1/2 SAFETY BLUE & 1/2 GLOSS WHITE
ZONE VALVE.....	HUNTER GREEN

NOTE: ALL PAINT SHALL BE PER SECTION 2-14.

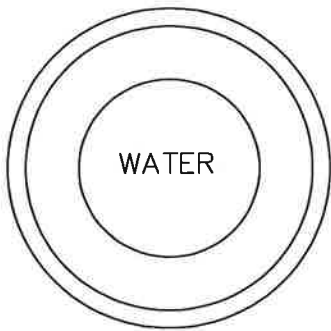

SOLID COLOR

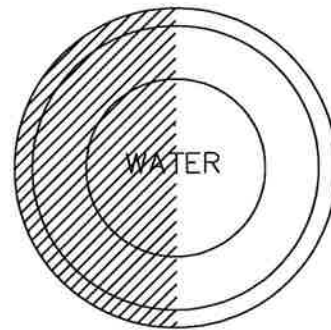

HALF COLOR

VALVE CAN COVER COLOR CODE CHART

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-155

DRAWN	BY AM	DATE 10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

[Signature]

DATE

12/10/24


APPROVED
CITY ENGINEER

DATE

12/11/24


SHEET 1 OF 1

Ⓞ CONSULT WATER DIVISION FOR CURRENT PIPE LINE PRODUCTS NUMBER FOR COVER

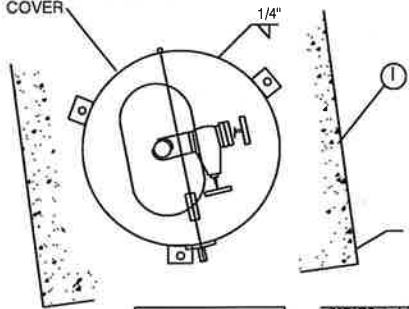


PLAN

NO SCALE

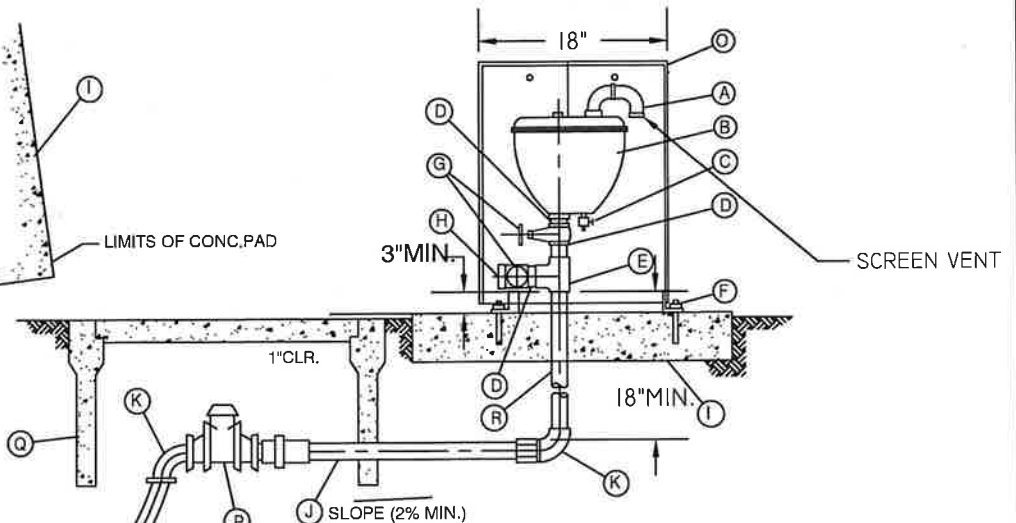

SIDE ELEVATION

NO SCALE

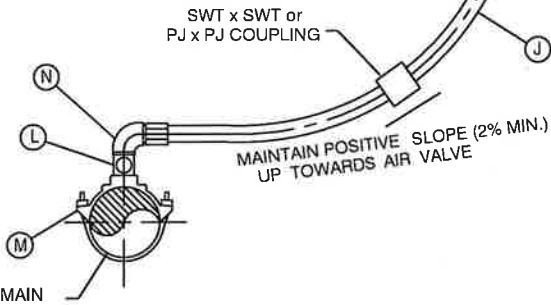

LEGEND:

DESCRIPTION	
(A) 2 EA. 90° STREET ELLS	(I) 6" THICK x 30" x 30" P.C.C. CONCRETE PAD
(B) COMB. AIR RELEASE & AIR VAC. VALVE, APCO HEAVY DUTY MODEL 145C OR APPROVED EQUAL.	(J) 2" BRASS NIPPLE OR 1" BRASS NIPPLE
(C) 1/2" HOSE BIB - 1/2" I.P.T. x 3/4" H.T.	(K) 2" BRASS ELBOW F.I.P. x F.I.P. OR 1"
(D) 2" x 3" BRASS NIPPLES OR 1" x 3" BRASS NIPPLES	(L) 2" CORPORATION STOP OR 1" CC X F.I.P.
(E) 2" x 2" BRASS TEE	(M) BRONZE DOUBLE STRAP SERVICE CLAMP WITH CC THREAD (OR WELDED COUPLING)
(F) 3/8" x 4" ANCHOR BOLTS - 3 REQUIRED	(N) 2" BRASS STREET 90° OR 1" BRASS STREET 90°
(G) 2" F.I.P. BRASS BALL VALVE OR 1" F.I.P. x F.I.P. BRASS BALL VALVE	(O) CONSULT WATER DIVISION FOR CURRENT PIPE LINE PRODUCTS # FOR COVER
(H) 2" x 2 1/2" INCREASER & 2 1/2" I.P.T. x 2 1/2" FIRE HOSE THREAD ADAPTER	(P) FORD BALL VALVE FIPT x PJ (B41-444)
	(Q) ARMORCAST PRODUCTS #66 METER VAULT OR CITY APPROVED EQUAL
	(R) 1" OR 2" COPPER TYPE K SOFT

1" AIR RELEASE/AIR-VACUUM/COMBINATION-AIR VALVE ASSEMBLY

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-160

DRAWN	BY AM	DATE 10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

APPROVED
CITY ENGINEER

[Handwritten Signature]
DATE 12/10/24

[Handwritten Signature]
DATE 12/11/24

SHEET 1 OF 2

NOTES:

1. ASSEMBLIES INSTALLED AT EASEMENTS, ROADS AND STREETS WITHOUT CURBS SHALL BE PROTECTED WITH GUARD POSTS. POST CONSISTS OF 6" LENGTH OF 4" DIAM. STD. WET PIPE FILLED WITH GROUT. TOP OF POST SHALL BE 36" ABOVE FINISH SURFACE WITH 16" DIAM. CONCRETE FOOTING. POSITION POSTS 2' IN FRONT OF AND 2.5' EACH SIDE OF ASSEMBLIES.
2. ALL STEEL ENCLOSURE PARTS SHALL BE GALVANIZED AFTER FABRICATION.

1" AIR RELEASE/AIR-VACUUM/COMBINATION-AIR VALVE ASSEMBLY

CITY OF MONTEREY PARK


PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-160

DRAWN	BY AM	DATE 10/02/24	APPROVED WATER UTILITY MANAGER		DATE 12/10/24
REVISED	DZ	10/02/24			
CHANGED	XX	XX/XX/XX	APPROVED CITY ENGINEER		DATE 12/11/24

SHEET 2 OF 2

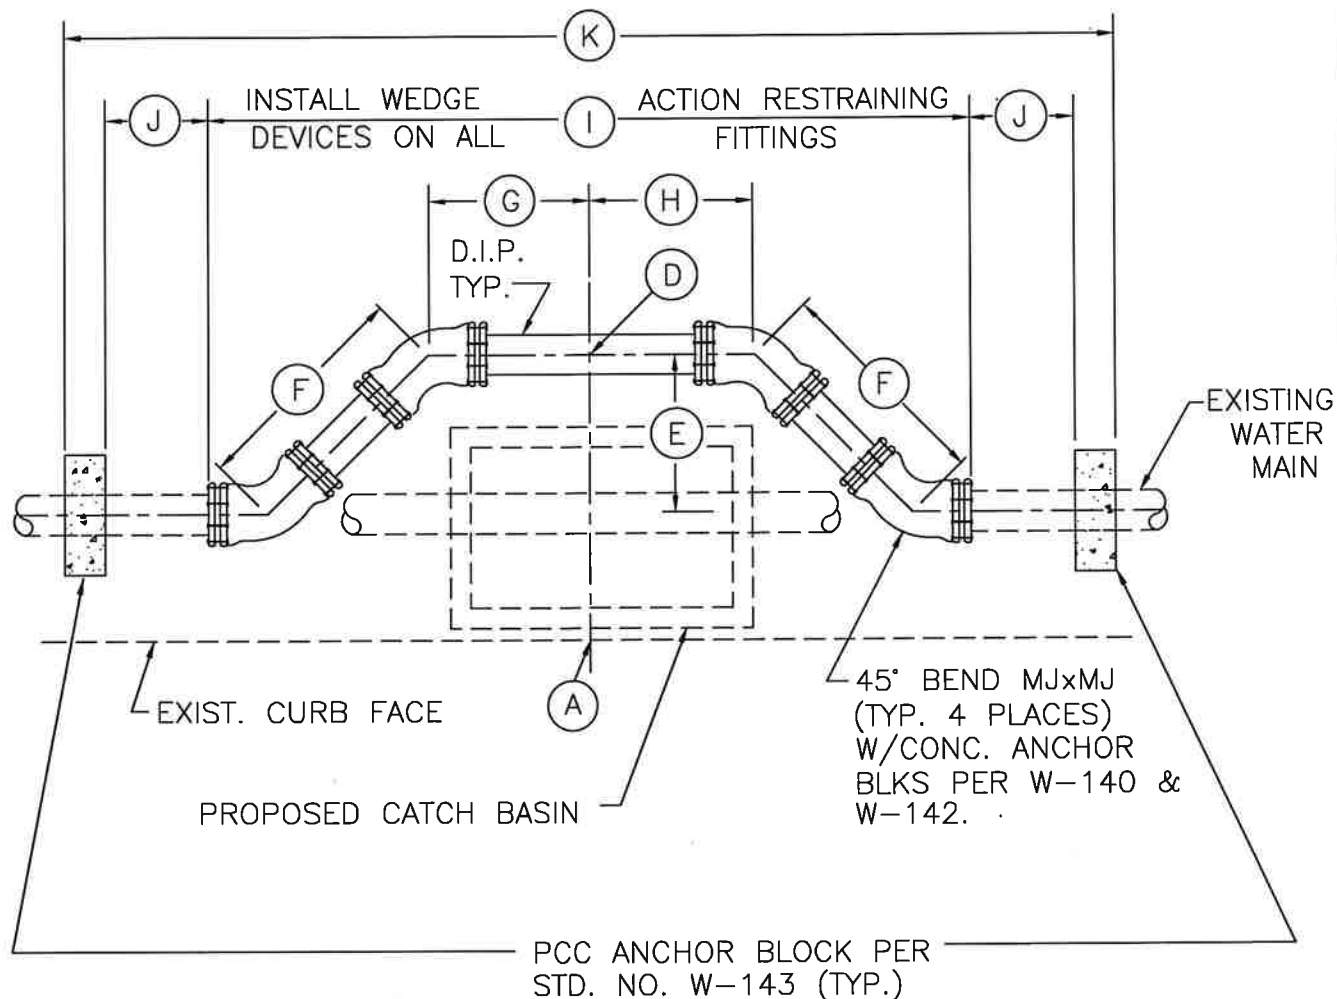

TYPE 1 OFFSET – PLAN

NOTE:

FOR PVC WATER MAIN CONSTRUCTION ONLY— SEE NOTES 9, 10 AND 11 ON SHEET 4.

WATER MAIN OFFSET / SIPHON

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT / WATER DIVISION

STANDARD NO.

W-170

DRAWN	BY AM	DATE 10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

[Signature]

DATE


12/10/24

APPROVED
CITY ENGINEER

DATE

12/11/24

SHEET 1 OF 4

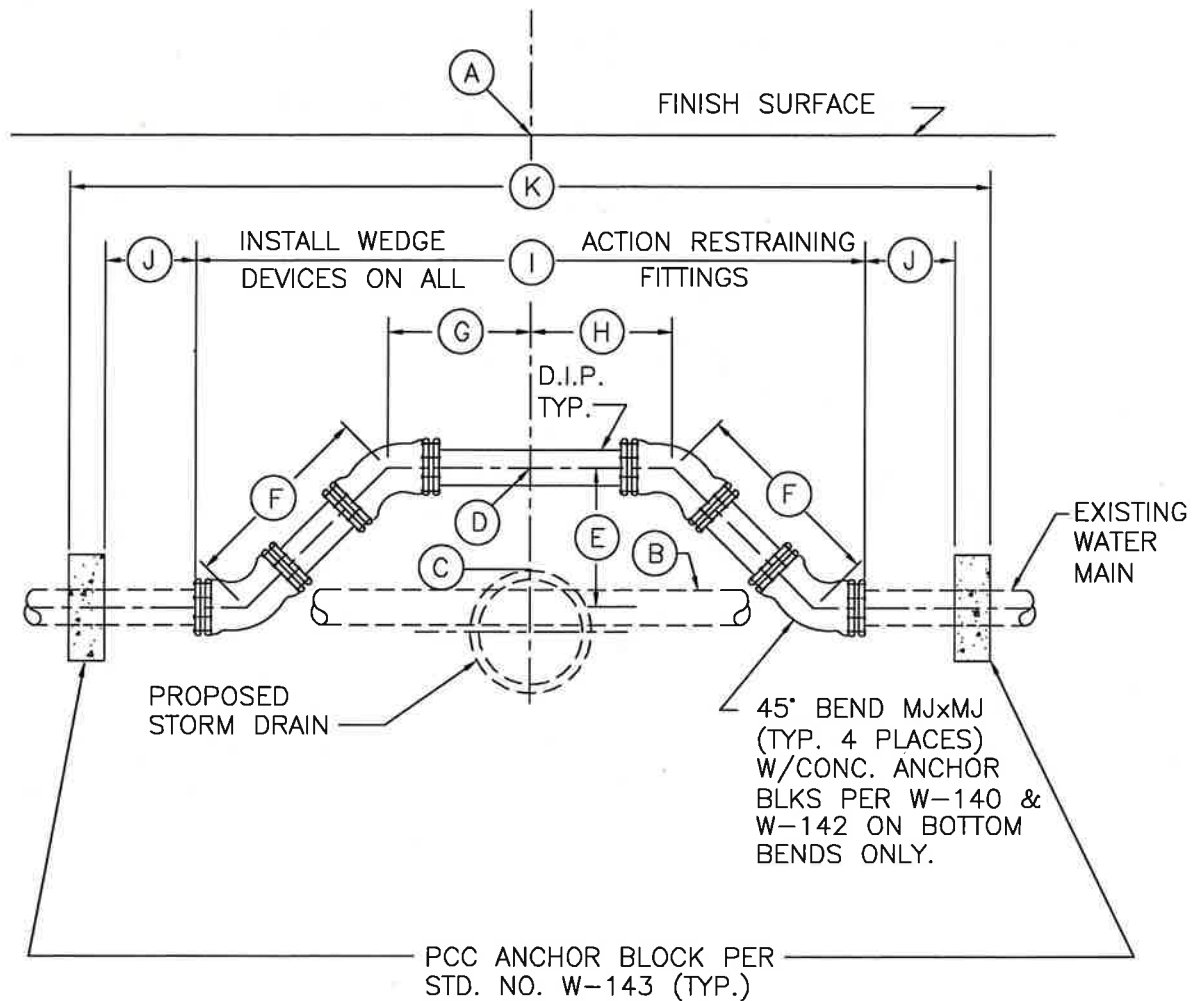

TYPE 2 SIPHON - ELEV.

NOTE:

FOR PVC WATER MAIN CONSTRUCTION ONLY- SEE NOTES 9, 10 AND 11 ON SHEET 4.

WATER MAIN OFFSET / SIPHON

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT-WATER DIVISION

STANDARD NO.

W-170

	BY	DATE
DRAWN	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER


APPROVED
CITY ENGINEER

[Handwritten signatures]

DATE 12/10/24

DATE 12/11/24

SHEET 2 OF 4

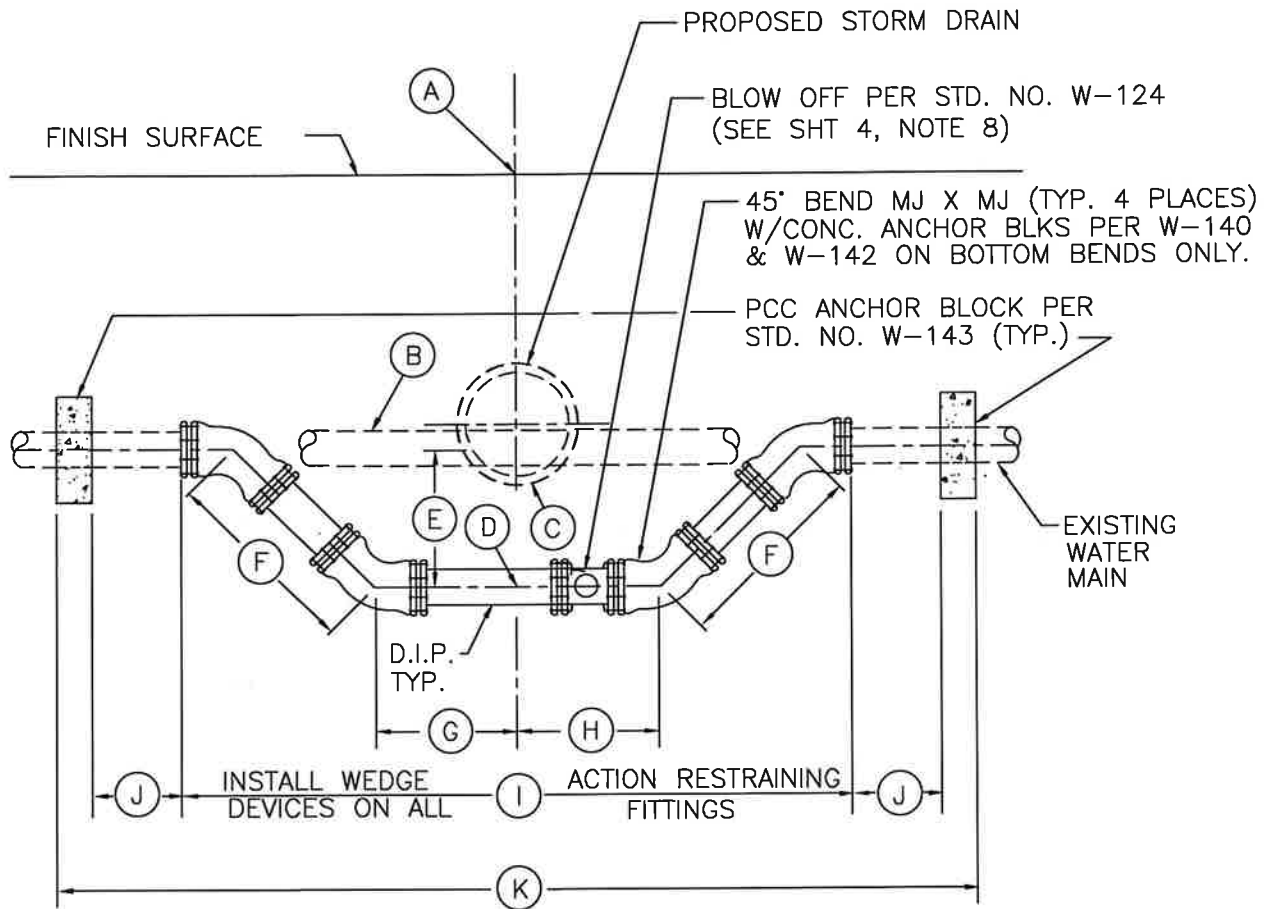

TYPE 3 SIPHON - ELEV.

NOTE:

FOR PVC WATER MAIN CONSTRUCTION ONLY— SEE NOTES 9, 10 AND 11 ON SHEET 4.

WATER MAIN OFFSET / SIPHON

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT—WATER DIVISION

STANDARD NO.

W-170

DRAWN	BY AM	DATE 10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

Fabrizio...

DATE

12/10/24

APPROVED
CITY ENGINEER

[Signature]

DATE

12/11/24

SHEET 3 OF 4

DIMENSIONS

Siphon No.	LOCATION/REMARKS	S.D. Station	Prop. S.D. size	Water Main Size & Type (EX.)	Siphon Type	Exist. Fin. Sur. Elev.	Exist. Top of Wtr. Pipe	Top/BTM Elev. S.D.	Water Siphon Sta.	Water Main Offset	Length Pipe & Fit'g	Length Pipe & Fit'g	Length Pipe & Fit'g	Length Pipe & Fit'g Offset	Length Tie Rod to Anc. Blk.	Total length Offset
						(A)	(B)	(C)	(D)	(E)	(F)	(G)	(H)	(I)	(J)	(K)

NOTES

1. THIS STANDARD TO BE USED ONLY WHERE APPROVED BY UTILITY. ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE MONTEREY PARK WATER UTILITY STANDARD PLANS AND SPECIFICATIONS.
2. THE CONTRACTOR SHALL NOTIFY THE CITY IF MONTEREY PARK WATER UTILITY INSPECTOR TWO (2) WEEKS PRIOR TO BEGINNING OF THE CONSTRUCTION TO ARRANGE FOR INSPECTION. PHONE (626)705-7276.
3. THE CONTRACTOR SHALL VERIFY LOCATION AND ELEVATION OF THE EXISTING CAST IRON PIPE (C.I.P), ASBESTOS-CEMENT PIPE (A.C.P) OR DUCTILE IRON PIPE (D.I.P) WATER MAIN PRIOR TO CONSTRUCTION OF THE OFFSET / SIPHON.
4. THE CONTRACTOR SHALL COORDINATE W/ THE WATER INSPECTOR FOR NOTIFICATION OF ALL WATER CUSTOMERS A MINIMUM OF FOUR (4) WORKING DAYS PRIOR TO SERVICE INTERRUPTION.
5. CONTRACTOR IS NOT PERMITTED TO TURN (OR EXERCISE) WATER VALVES. THE CONTRACTOR SHALL CONTRACT THE CITY OF MONTEREY PARK WATER UTILITY INSPECTOR AT (626)705-7276. A MINIMUM OF ONE (1) WORKING DAYS PRIOR TO REQUIRING VALVE SHUT DOWN AT EACH LOCATION.
6. THE CITY OF MONTEREY PARK WATER SERVICES CANNOT GUARANTEE A COMPLETE SHUT DOWN OF EXISTING MAIN. THE UTILITY WILL ATTEMPT TO SHUT DOWN MAINS AS COMPLETELY AS POSSIBLE: HOWEVER, THE CONTRACTOR SHALL BE RESPONSIBLE FOR DEWATERING AND ISOLATION OF CONSTRUCTION FOR TESTING PURPOSES.
7. IF EXISTING MAIN IS A.C.P CONNECT D.I.P TO THE EXISTING A.C.P USING AN APPROVED SLEEVE TYPE COUPLING IN ACCORDANCE WITH THE SPECIFICATION. DO NOT TIE TO A.C.P. WITH RESTRAINING GLANDS.
8. BLOW-OFF ASSEMBLY SHALL BE INSTALLED ONLY IF APPROVED BY WATER ENGINEERING AND SPECIFICALLY CALLED FOR ON THE PROJECT PLANS.
9. PVC WATER MAIN CONSTRUCTION SHALL BE PER SECTION 2-02.
10. PVC PIPE SHALL BE AWWA C900, CLASS 305 (DR14), P.E.XP.E. (SEE NOTE 9)
11. MECHANICAL JOINT RESTRAINT FOR PVC PIPE SHALL BE 2000PV RESTRAINT BY EBBA IRON OR EQUAL AS PER SPECIFICATION SECTION 2-12.01 FOR PVC.

WATER MAIN OFFSET / SIPHON

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION


STANDARD NO.

W-170

DRAWN	BY	DATE	
	AM	10/02/24	
REVISED	DZ	10/02/24	
CHANGED	XX	XX/XX/XX	

APPROVED WATER UTILITY MANAGER		DATE
		12/10/24
APPROVED CITY ENGINEER		DATE
		12/11/24

SHEET 4 OF 4

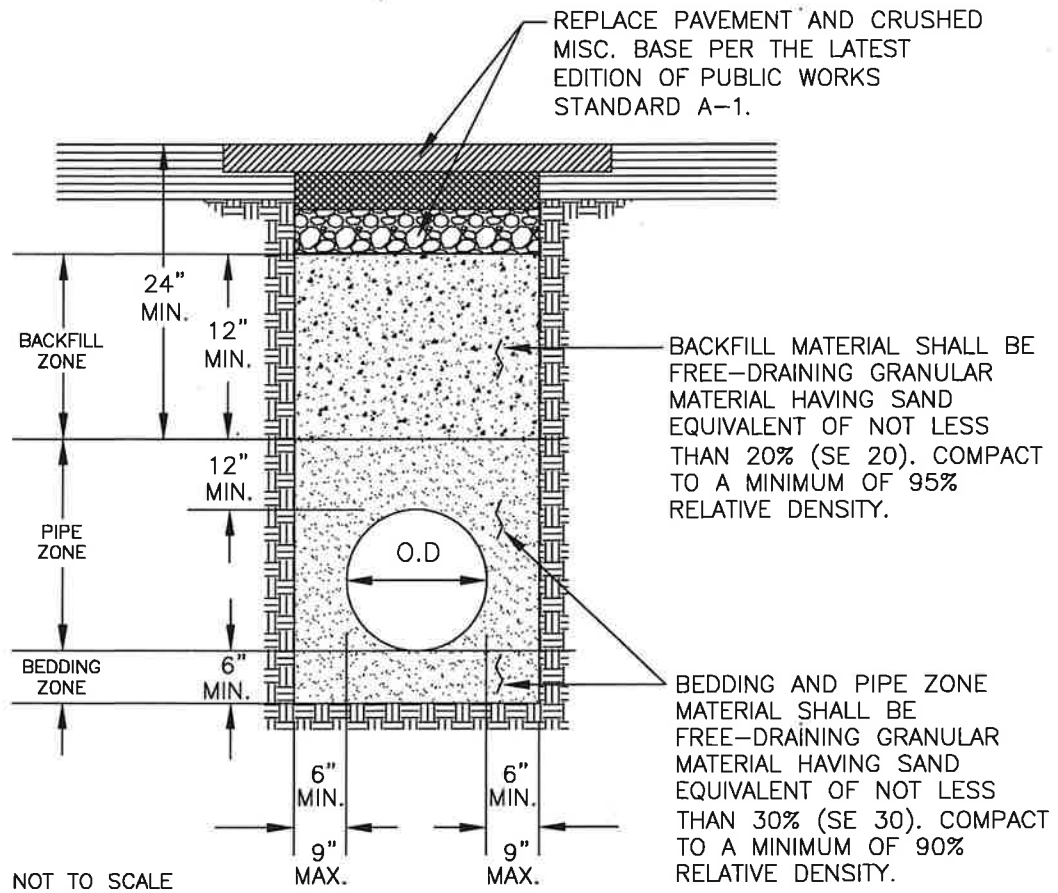

NOTES:

1. DIMENSIONS SHOWN HERE ARE MINIMUM. MORE STRINGENT REQUIREMENTS SHALL BE FOLLOWED PER PROJECT PLANS AND SPECIFICATIONS.
2. SHORING OR SOLID SHEATHING IS REQUIRED FOR DEPTHS OVER 5 FEET. DESIGN CALCULATIONS BY A REGISTERED ENGINEER SHALL BE REQUIRED.

WATER PIPE BEDDING DETAIL

CITY OF MONTEREY PARK
PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-180

DRAWN	BY	DATE
	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

DATE 12/10/24


APPROVED
CITY ENGINEER

DATE 12/11/24

SHEET 1 OF 1

LIST OF MATERIAL

ITEM	DESCRIPTION
1	TEE-FLANGE OUTLET
2	VALVE-FLG X MJ
3	LATERAL-DUCTILE IRON PIPE PER SECTION 2-01
4	MECHANICAL JOINT RESTRAINT PER SECTION 2-12.01 (TYP.).
5	D.1 SOLID SLEEVE COUPLING- MJ X MJ
6	DUCTILE IRON PIPE, CLASS 53, PER SECTION 2-01-PE X FLG
7*	IN LIEU OF ITEM 3, LATERAL PIPE SHALL BE AWWA C900 PVC OR AWWA C909 PVC PIPE,, CLASS 305, P.E. X P.E. (SEE NOTES 7, 8, AND 9 ON SHEET 2)

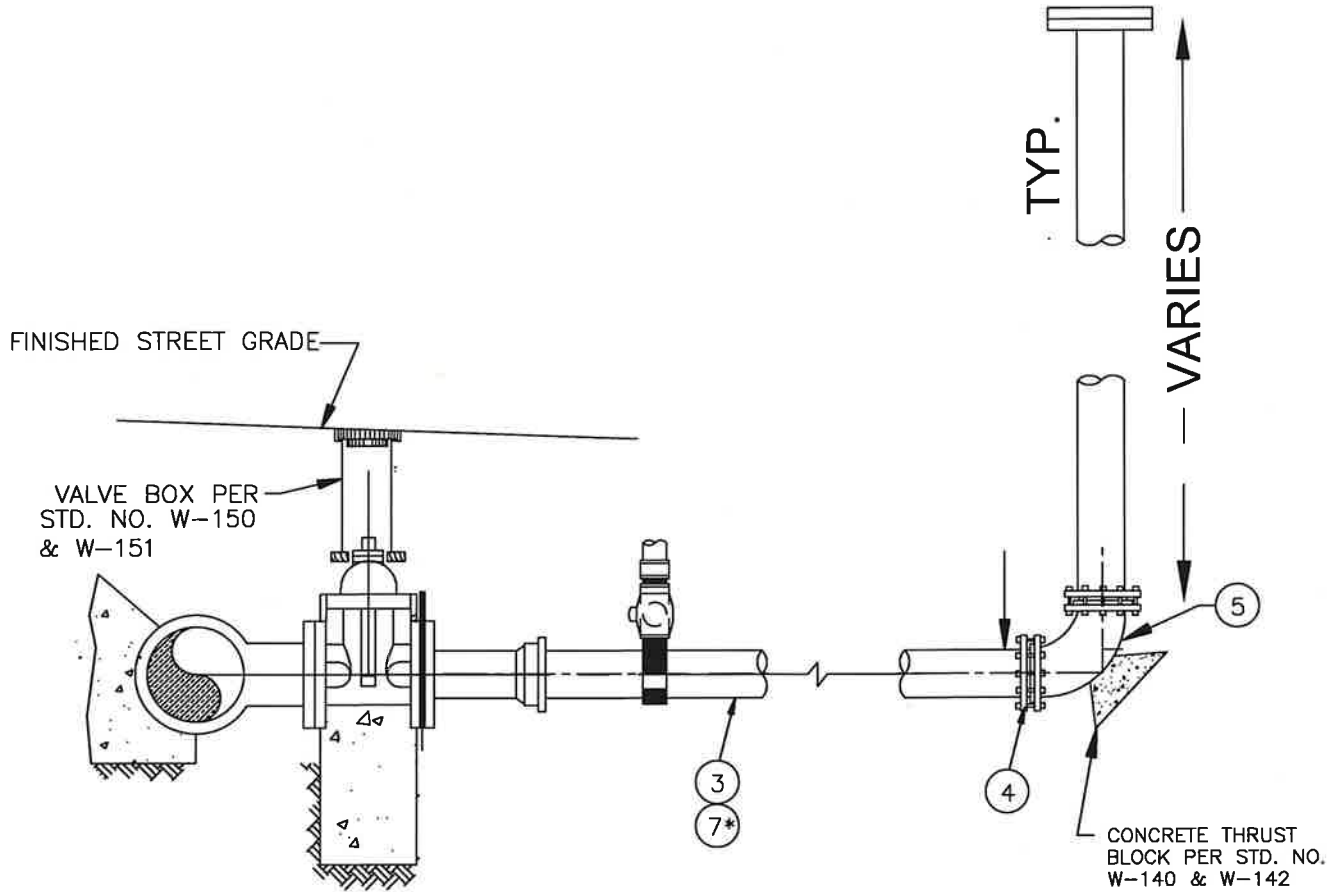

* FOR PVC AND PCVO WATER MAIN CONSTRUCTION ONLY- SEE ITEM 7* ABOVE AND NOTES 7, 8, AND 9 ON SHEET 2

LARGE METER AND FIRE LINE LATERAL INSTALLATION

CITY OF MONTEREY PARK
PUBLIC WORKS DEPARTMENT-WATER DIVISION

STANDARD NO.

W-201

	BY	DATE
DRAWN	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED WATER UTILITY MANAGER	<i>[Signature]</i>	DATE	12/10/24
APPROVED CITY ENGINEER	<i>[Signature]</i>	DATE	12/11/24

SHEET 1 OF 3

NOTES:

1. FOR DEVELOPMENT PROJECTS, METER SIZE AND LATERAL SIZE ARE TO BE DETERMINED BY DEVELOPER'S ENGINEER AND SHALL BE SUBJECT TO REVIEW AND APPROVAL BY THE CITY.
2. TAPPING SLEEVES, WHEN INDICATED PER PLAN OR AS DIRECTED BY MONTEREY PARK SHALL BE PER SECTION 2-8.05.7. TAPPING VALVES 12" AND SMALLER SHALL BE RESILIENT WEDGE GATE VALVES.
3. PIPE VALVE, TEE OUTLET AND CAP SHALL BE OF SAME NOMINAL DIAMETER EXCEPT FOR 3" METER.
4. ALL FIRE LINE, ASSEMBLIES SHALL BE INSTALLED ABOVE GROUND WITH DIMENSION "A" EQUAL TO 34" OR AS OTHERWISE APPROVED BY THE CITY.
5. PLUG 2" OUTLET AFTER DISINFECTION AND FLUSHING OF LATERAL.
6. ALL PUSH ON JOINTS SHALL BE RESTRAINED PER SECTION 2-12.02.
7. PVC OR PVCO WATER MAIN CONSTRUCTION SHALL BE PER SECTION 2-02.
8. MECHANICAL JOINT RESTRAINTS FOR PVC OR PVCO PIPE SHALL BE PER SECTION 2-12.01.
9. FOR PVC OR PVCO LATERAL PIPE, CONNECT AND RESTRAIN PLAN END PPE USING DUCTILE IRON MECHANICAL JOINT SOLID SLEEVES WITH RESTRAINTS PER NOTE 8 ABOVE.
10. CONTRACTOR SHALL COORDINATE HYDROSTATIC TESTING, CHLORINATION, AND BAC-T SAMPLE TESTING WITH MPWD.
11. REMOVE HYDROSTATIC TEST PLATE AND CONNECT CUSTOMER SIDE AFTER CLEARANCE IS OBTAINED BY MPWD.

LARGE METER AND FIRE LINE LATERAL INSTALLATION

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-201

DRAWN	BY AM	DATE 10/02/24	APPROVED WATER UTILITY MANAGER		DATE 12/10/24
REVISED	DZ	10/02/24			
CHANGED	XX	XX/XX/XX	APPROVED CITY ENGINEER		DATE 12/11/24


SHEET 2 OF 3

SERVICE SIZE	A	HEIGHT
4"	30"	30.5"
6"	30"	32"
8"	30"	33"
10"	24"	35"

NOTE:

HEIGHT IS MEASURED FROM FINISHED GRADE TO CENTERLINE OF ASSEMBLY.


ASSEMBLY CENTERLINE HEIGHT

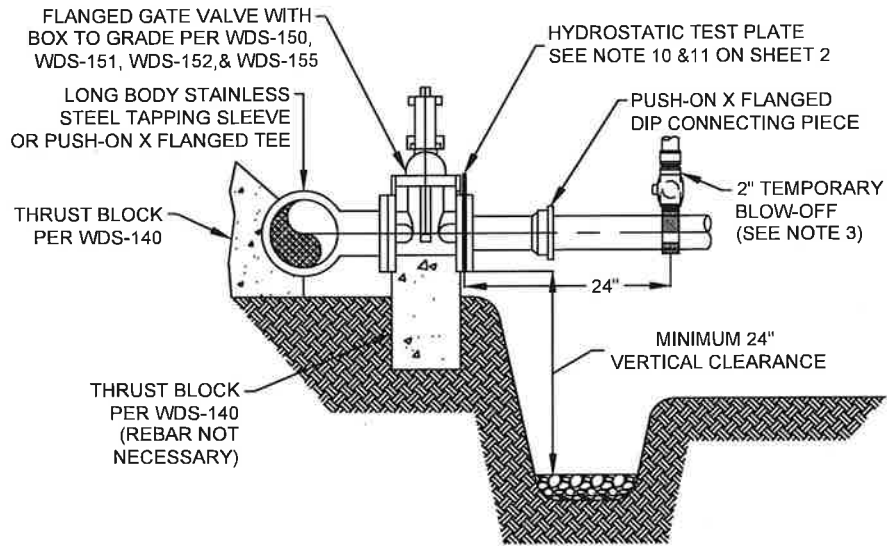

NOTE:

1. MPWD INSPECTOR TO BE PRESENT DURING REMOVAL OF HYDROSTATIC TEST PLATE.
2. IF WATER RISES TO FLANGE DURING REMOVAL OF TEMPORARY HYDROSTATIC TEST PLATE, CONTRACTOR SHALL BE REQUIRED TO RE-SAMPLE BAC-T'S DUE TO POTENTIAL CONTAMINATION.
3. UNLESS DIRECTED BY MPWD ENGINEER, REMOVE CORPORATION STOP DURING FINAL TIE-IN AND INSTALL PLUG IN PLACE.

DETAIL 'A' - CONNECTION DETAIL (SECTION)

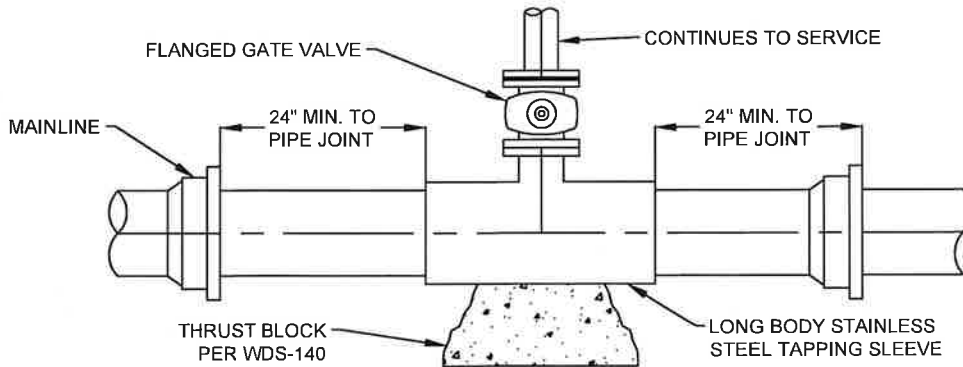

DETAIL 'B' - CONNECTION DETAIL (PLAN)

LARGE METER AND FIRE LINE LATERAL INSTALLATION

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-201

DRAWN	BY	DATE
	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED WATER UTILITY MANAGER

DATE



12/10/24

APPROVED CITY ENGINEER

DATE

12/11/24

SHEET 3 OF 3

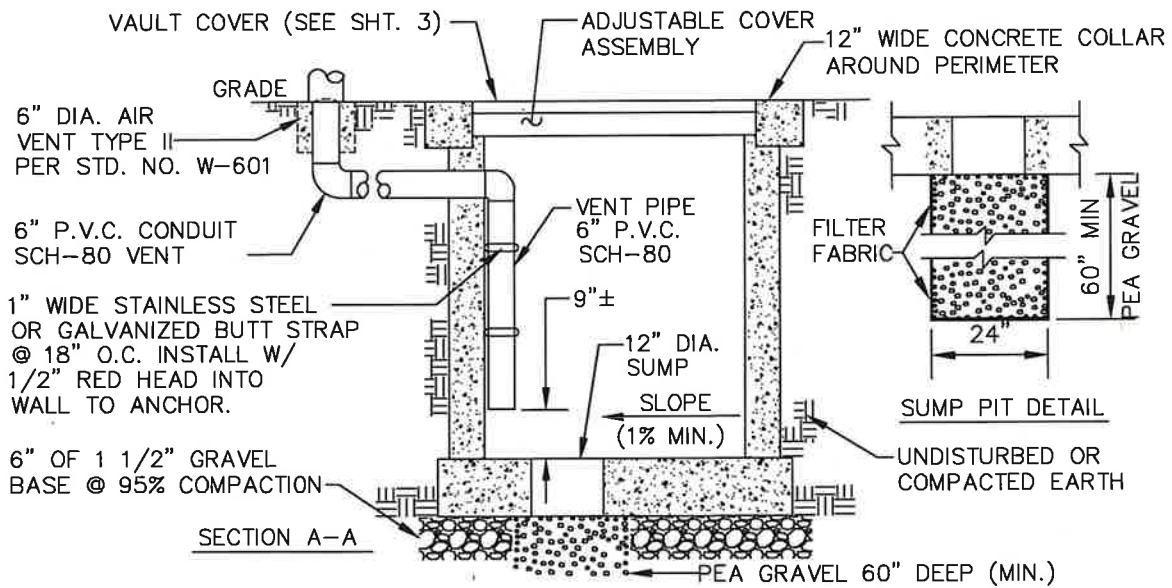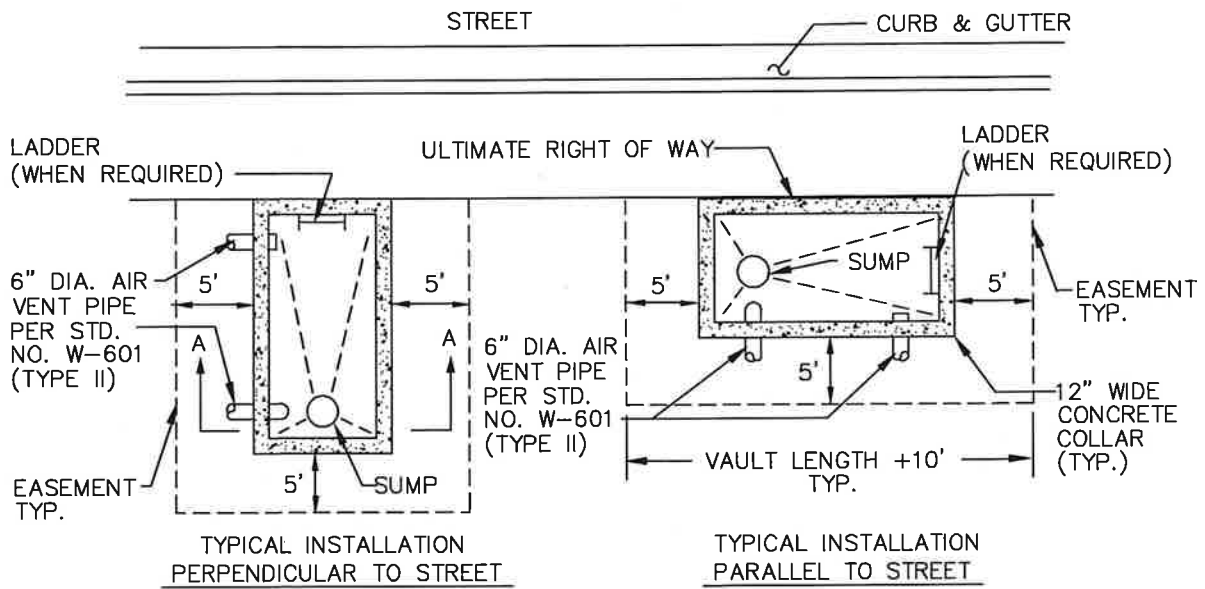

NOTES:

1. POURED IN PLACE FLOORS SHALL BE FORMED. 6" MIN. THICKNESS WITH #3 WIRE TIES 12" O.C. BOTH WAYS. CONCRETE SHALL BE CLASS 560-C-3250 (3250 P.S.I. AT 28 DAYS) FLOOR SHALL BE TROWEL FINISHED WITH PROPER FISHBONE SLOPE TO SUMP HOLE DRAIN.
2. VAULTS GREATER THAN 4' IN DEPTH REQUIRE A FIBER REINFORCED PLASTIC (FRP) LADDER SET PERPENDICULAR TO HINGE.
3. ULTIMATE RIGHT OF WAY SHALL BE DETERMINED BY PUBLIC WORKS.

STANDARD METER VAULT INSTALLATION

CITY OF MONTEREY PARK


PUBLIC WORKS DEPARTMENT-WATER DIVISION

STANDARD NO.

W-203

DRAWN	BY	DATE	APPROVED	DATE
	AM	10/02/24	WATER UTILITY MANAGER	12/10/24
REVISED	DZ	10/02/24		
CHANGED	XX	XX/XX/XX	APPROVED	DATE
			CITY ENGINEER	12/11/24

SHEET 1 OF 3

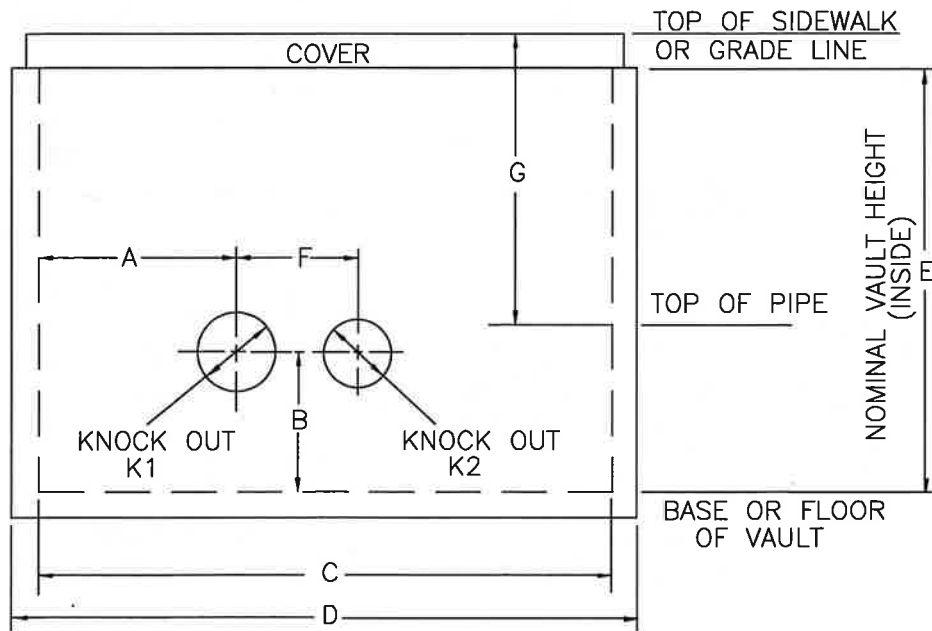

INLET END - STANDARD DIMENSIONS

TURBINE/COMPOUND METERS

METER SIZE	K1	K2	A	B	C	D	E	F	G
3"	10"	N/A	19"	16"	57.5"	63.75"	48"	N/A	34"
4"	10"	N/A	19"	16"	57.5"	63.75"	48"	N/A	34"
6"	12"	N/A	19"	16"	57.5"	63.75"	48"	N/A	34"
DUAL 6"	12"	12"	14.5"	14"	57.5"	63.75"	48"	26.5"	38"
8"/10"	SPECIAL DESIGN								

APPROVED VAULT SUPPLIERS:

1. EISEL ENTERPRISES, INC.
2. JENSEN PRECAST
3. J&R CONCRETE PRODUCTS, INC.
4. OLSON PRECAST COMPANY
5. OLDCASTLE PRECAST, INC.

NOTES:

1. WHEN ORDERING VAULTS, INFORM SUPPLIER THAT VAULT WILL BE INSTALLED IN THE CITY OF MONTEREY PARK.
2. HOLES TO BE SEALED W/ NON SHRINK GROUT, LINK SEALS, OR APPROVED EQUAL.

STANDARD METER VAULT INSTALLATION

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-203

DRAWN	BY	DATE
	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED WATER UTILITY MANAGER

[Signature]

DATE

12/10/24




APPROVED CITY ENGINEER

[Signature]

DATE

12/6/24

SHEET 2 OF 3

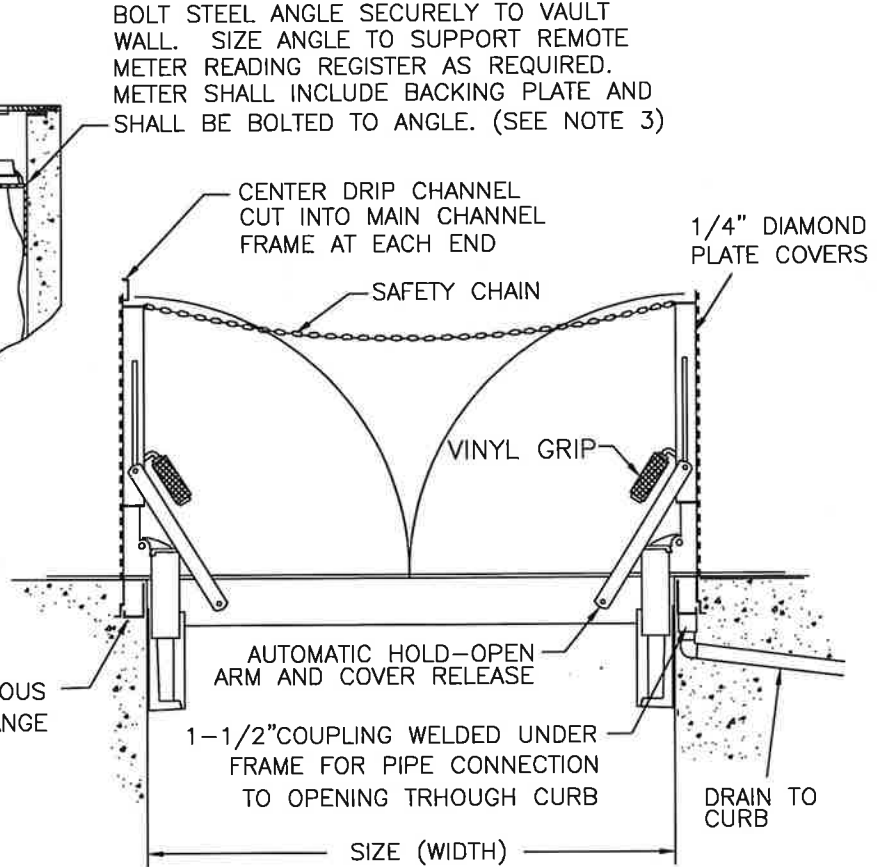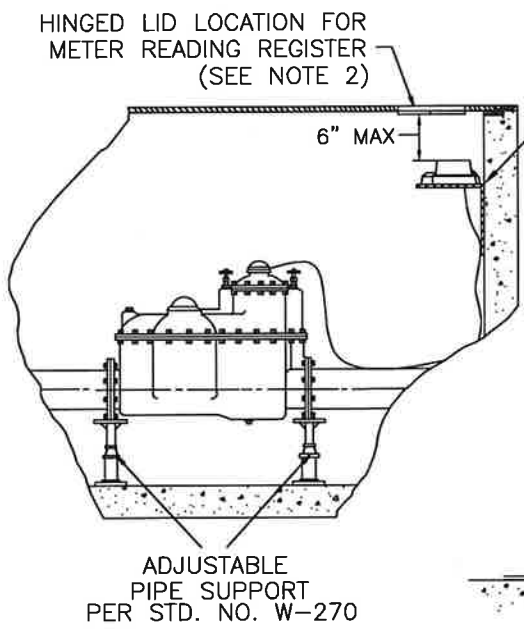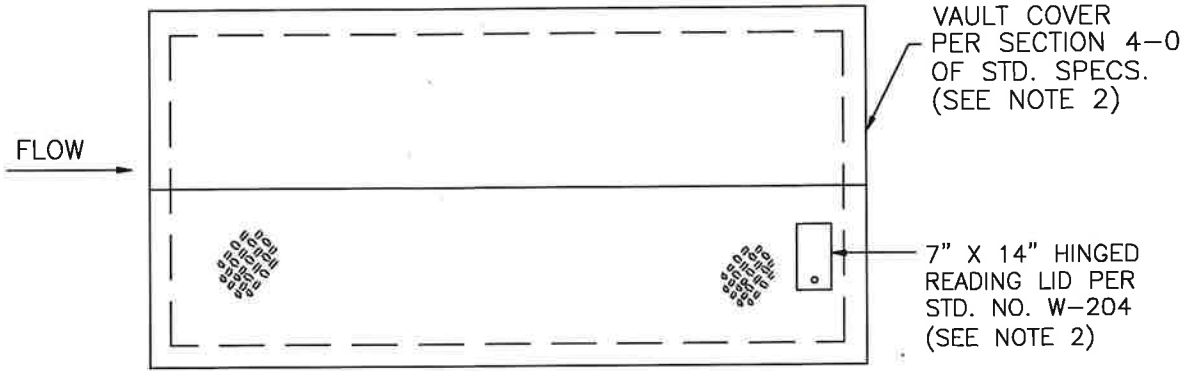

- NOTES:**
1. APPROVED VAULT COVER SUPPLIERS:
 2. THE CONTRACTOR SHALL SUBMIT TO THE UTILITY FOR REVIEW AND APPROVAL THE VAULT COVER DETAIL INDICATING THE LOCATION OF THE HINGED LID OPENING PRIOR TO FABRICATION. THE LOCATION OF THE HINGED LID SHALL ALLOW FOR CLEAR ACCESS TO THE METER READING REGISTER.
 3. STEEL ANGLE SUPPORT FOR REMOTE METER READING REGISTER SHALL BE LOCATED BELOW THE HINGED COVER FOR CLEAR ACCESS TO THE METER. EXACT LOCATION TO BE DETERMINED BY CONTRACTOR IN THE FIELD.

STANDARD METER VAULT INSTALLATION

CITY OF MONTEREY PARK
PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-203


BY	DATE
RAWN	10/02/24
REVISD	10/02/24
CHANGED	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

APPROVED
CITY ENGINEER

[Signature] DATE 12/10/24
[Signature] DATE 12/11/24

SHEET 3 OF 3

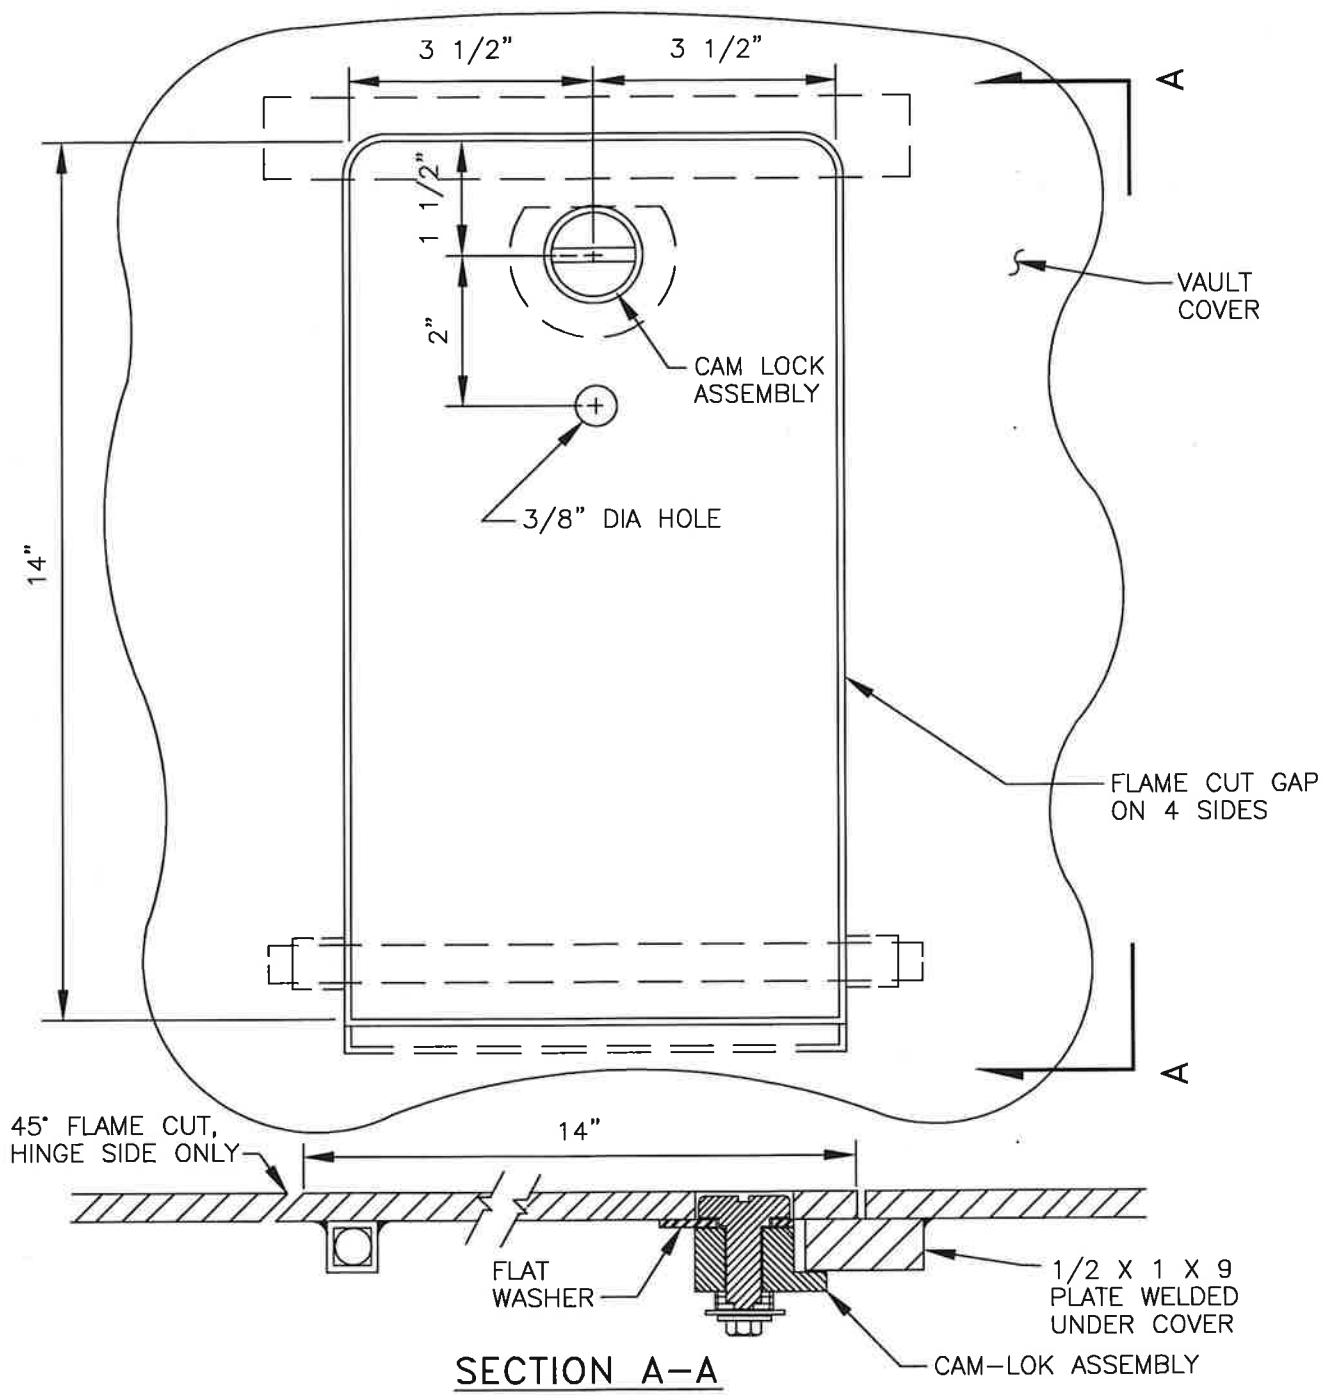

NOTES:

1. THIS READING LID IS TO BE USED IN NON-TRAFFIC AREAS ONLY.

7 INCH X 14 INCH HINGED READING LID

CITY OF MONTEREY PARK
PUBLIC WORKS DEPARTMENT-WATER DIVISION

STANDARD NO.

W-204

DRAWN	BY	DATE
	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER



[Signature]

DATE 12/10/24

APPROVED
CITY ENGINEER

DATE 12/11/24

SHEET 1 OF 1

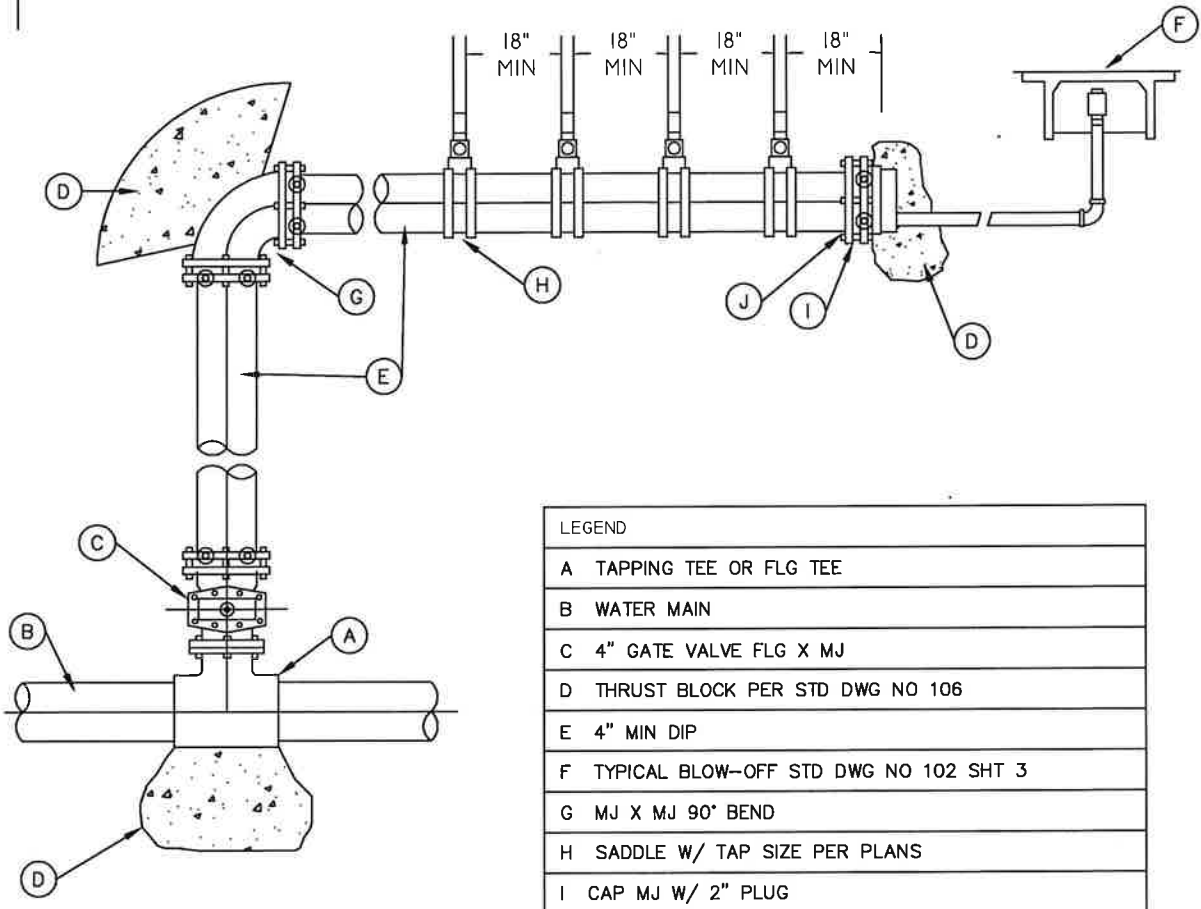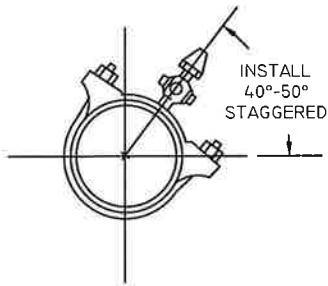

LEGEND	
A	TAPPING TEE OR FLG TEE
B	WATER MAIN
C	4" GATE VALVE FLG X MJ
D	THRUST BLOCK PER STD DWG NO 106
E	4" MIN DIP
F	TYPICAL BLOW-OFF STD DWG NO 102 SHT 3
G	MJ X MJ 90° BEND
H	SADDLE W/ TAP SIZE PER PLANS
I	CAP MJ W/ 2" PLUG
J	MJ MEGA LUG STYLE OR APPROVED EQUAL

NOTES:

1. 2" SERVICE MIN (4) TO MAX (6) PER MANIFOLD OR 1" SERVICE MIN (4) TO MAX (10) PER MANIFOLD
2. BLOWOFF OR IRRIGATION METER AT END OF MANIFOLD
3. SERVICE TAPS WILL BE SPACED TO ALLOW METER BOXES TO BE CENTERED ON METER AND MIN. 2" SEPARATION BETWEEN BOXES

TYPICAL MANIFOLD ASSEMBLY FOR 4 TO 10 1-INCH SERVICES


CITY OF MONTEREY PARK
PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.
W-205

DRAWN	BY	DATE
	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX


APPROVED WATER UTILITY MANAGER	DATE	12/10/24
APPROVED CITY ENGINEER	DATE	12/11/24

SHEET 1 OF 1

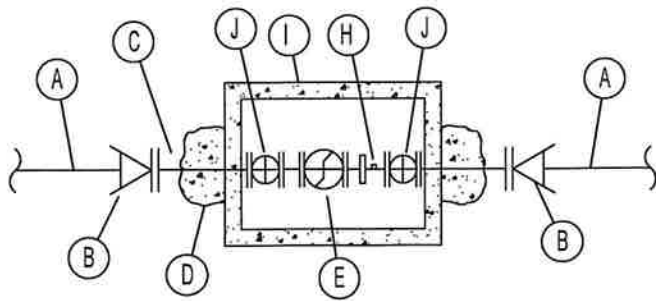

PLAN VIEW
NO SCALE

CITY TO APPROVE SIDE WALL CLEARANCE
MINIMUM 12" CLEARANCE

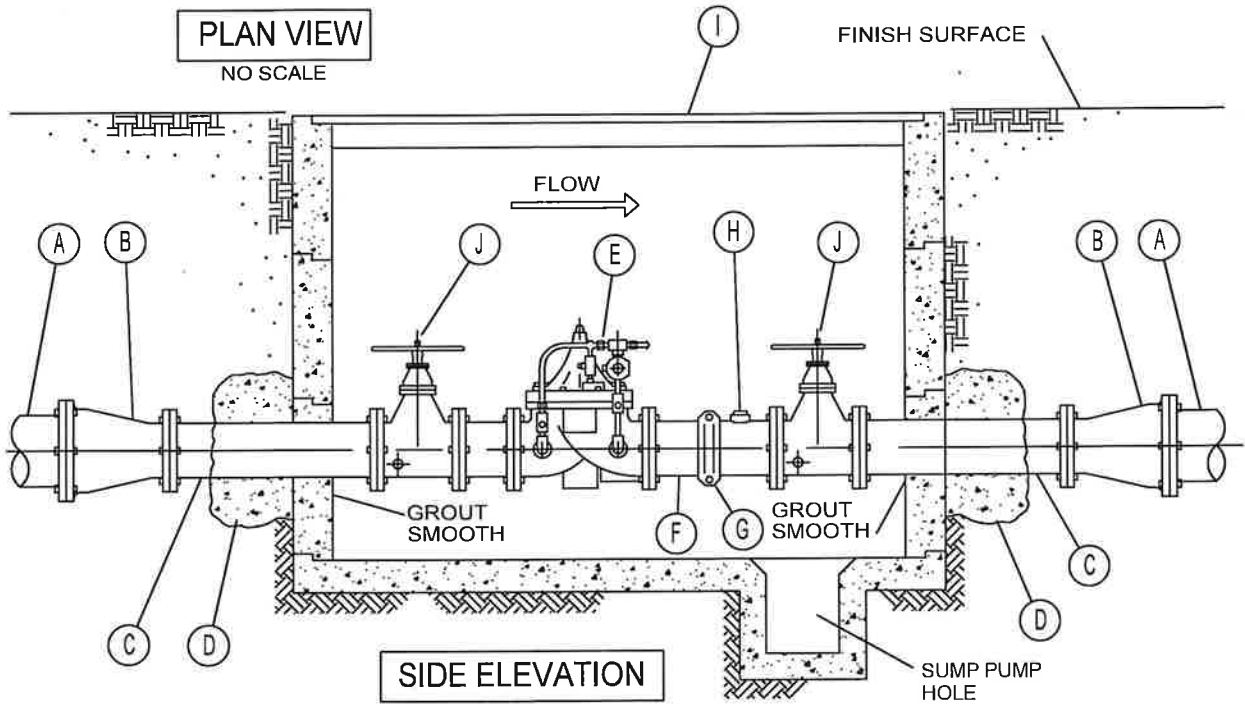

SIDE ELEVATION
NO SCALE

LEGEND

A 6" CLASS 350 DUCTILE IRON PIPE, MIN. 3' EACH SIDE INST TRANS CPLG AS REQUIRED	F 4" D.I. SPOOL CUT IN HALF
B B 6" PO WITH FIELD LOCK GASKET X 4" FLG. REDUCER OR 6" M.J. W/ MEGALUG RESTRAINTS X 4" FLANGE REDUCER	G FLEX. CPLG.
C 4" DIP CLASS 350 SPOOL	H 1" TAP WITH PLUG, DOUBLE STRAP CC SADDLE WITH 1" TAP WITH 1" M.I.P. X F.I.P. BALL VALVE WITH LOCK WINGS
D CONCRETE THRUST BLOCK (MUST BE SET IN UNDISTURBED SOIL)	I CONSULT WATER DIVISION FOR SIZE AND MAKE PER JOB
E 4" PRESS. RED. VLV. CLA-VAL OR APPROVED EQUAL CONSULT WATER DIV. FOR APPLICATION AND PART NUMBER	J 4" FLG RESILIENT WEDGE GATE VALVE WITH HANDWHEEL AFC SERIES 2500 WITH STAINLESS STEEL TRIM KIT

PRESSURE REGULATING VAULTS

CITY OF MONTEREY PARK
PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-210

DRAWN	BY	DATE
	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER


APPROVED
CITY ENGINEER

DATE


DATE

12/10/24
12/11/24

SHEET 1 OF 1

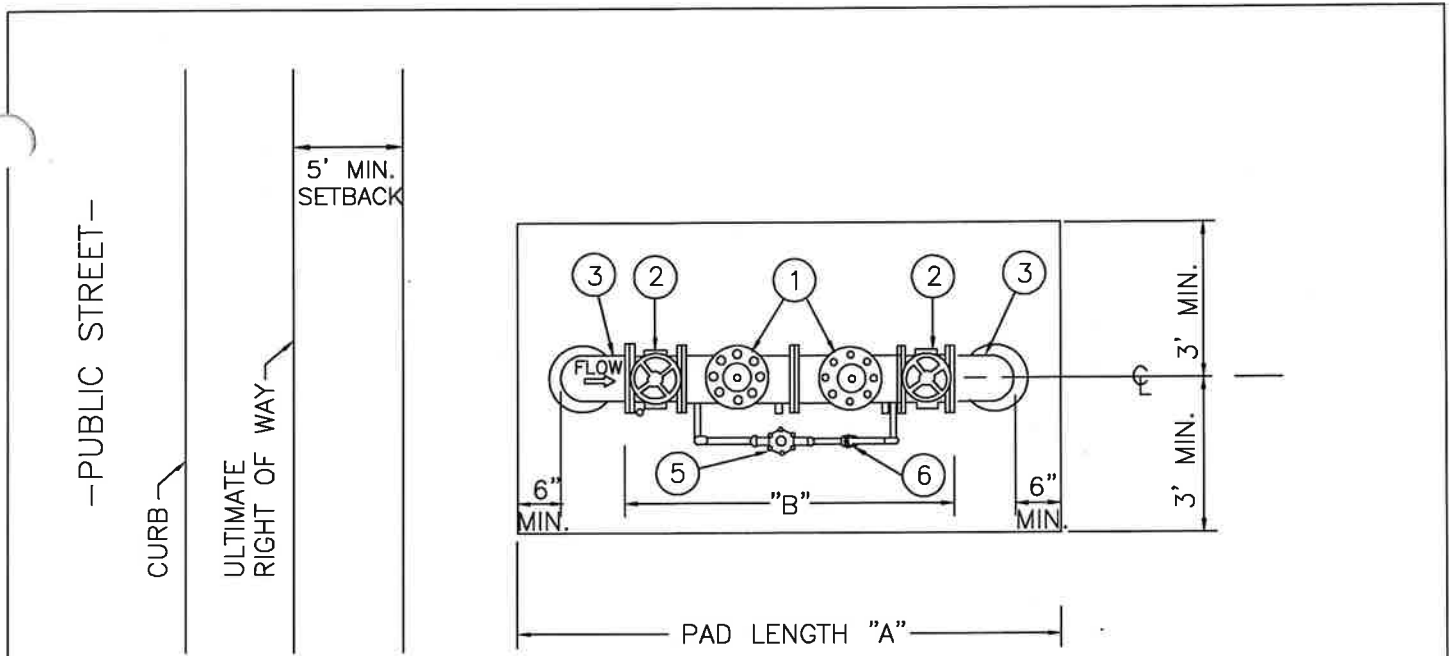

PLAN VIEW

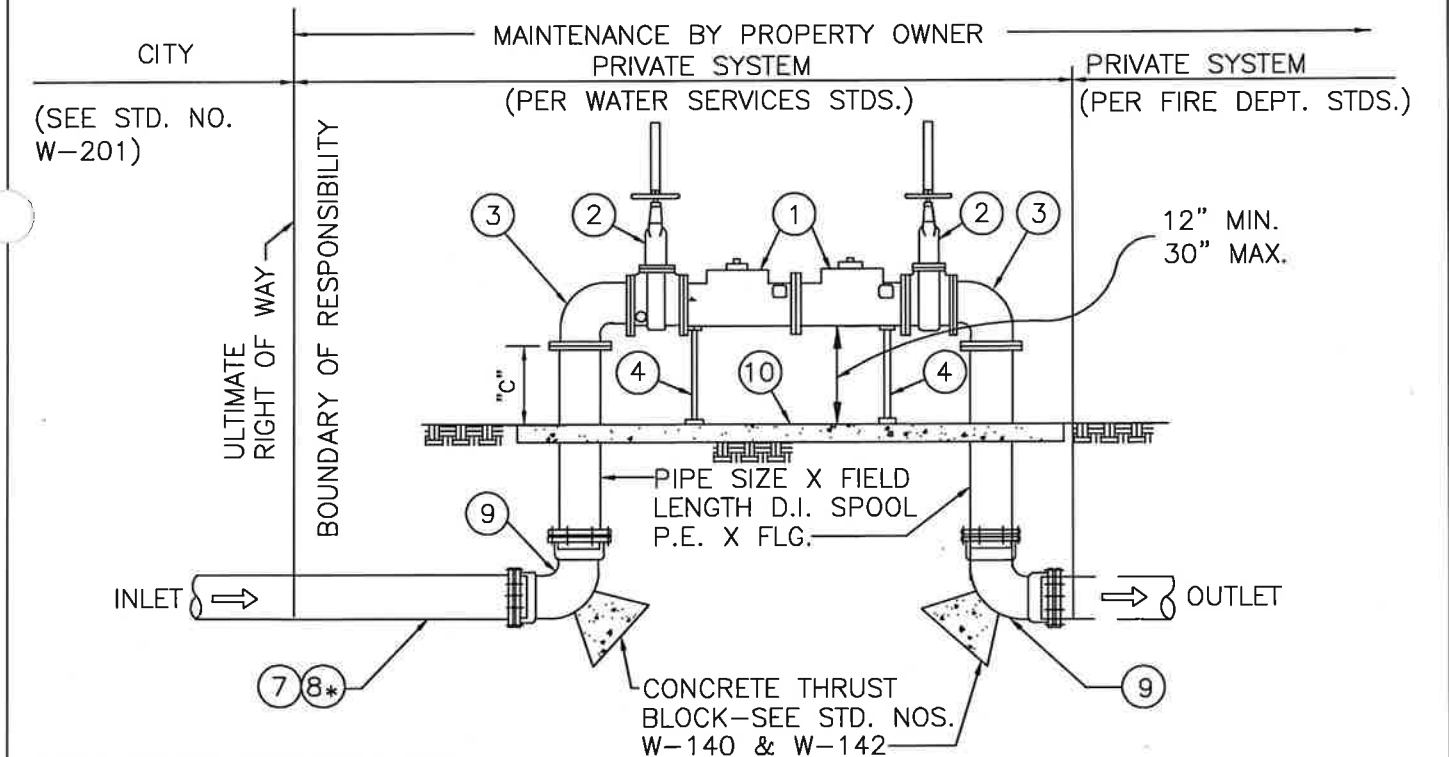

ELEVATION VIEW

* FOR PVC OR PVCO WATER MAIN CONSTRUCTION ONLY - SEE ITEM 8* AND NOTES 8 AND 9 ON SHEET 2

DOUBLE CHECK DETECTOR ASSEMBLY FIRE LINE ONLY

CITY OF MONTEREY PARK
PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-220

DRAWN	BY AM	DATE 10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED WATER UTILITY MANAGER	DATE 12/10/24
APPROVED CITY ENGINEER	DATE 12/11/24

SHEET 1 OF 2

LIST OF MATERIAL

ITEM	DESCRIPTION
1	DOUBLE CHECK DETECTOR ASSEMBLY (SEE SECTION 5-01.)
2	RESILIENT WEDGE VALVE, O.S.&Y, (SEE SECTION 5-01.)
3	SR 90° BEND, FLG X FLG, D.I., CEMENT MOTAR LINED.
4	FLAT PIPE SUPPORT (SEE STD. NO. W-279).
5	BYPASS METER (SEE SECTION 4-06.)
6	BYPASS METER DOUBLE CHECK VALVE.
7	PIPE SIZE X FIELD LENGTH D.I. SPOOL, P.E. X P.E.
8	IN LIEU OF ITEM 7, PIPE SHALL BE AWWA C900 PVC OR AWWA C909 PVCO PIPE, CLASS 305, P.E. X P.E. (SEE NOTES 8 AND 9)
9	D.I. 90° BEND, M.J. X M.J. (2 TYP.), RETRAINED PER SECTION 2-12.01
10	CONCRETE PAD 4" THICK, SIZE AS INDICATED HEREIN; CLASS 520-C-2500 CONCRETE.

FIRELINE SIZE	A	B(MAX.)	C
4"	7.0'	4'-3"	14"
6"	8.5'	5'-3"	14"
8"	9.5'	6'-4"	13.5"
10"	11.5'	7'-5"	12"

NOTES:

1. FIRE DEPT. CONNECTIONS CANNOT BE PLACED ON THE ASSEMBLY WITHOUT PRIOR APPROVAL, CONTACT FIRE DEPT. AT(626)320-1308. WHERE APPROVED BY FIRE DEPT. , A FLG X FLG X FLG, D.I , CEMENT MORTAR LINED TEE MAY BE SUBSTITUTED FOR THE TOP 90° BEND ON FIRELINES
2. O.S. &Y VALVES SHALL BE LOCKED IN OPEN POSITION WITH CHAIN AND OWNER'S PADLOCK(S) PADLOCK(S) SHALL BE BREAKAWAY TYPE
3. ALL PIPE SHALL BE DUCTILE IRON PER SECTION 2-01 .
4. ALL FITTINGS AND APPURTENANCES (GASKETS, NUTS, BOLTS, RESTRAINT) SHALL COMPLY WITH SECTIONS 2-08 & 2-12 OF THESE SPECIFICATIONS.
5. THE COMPLETED ASSEMBLY SHALL BE PAINTED PER SECTION 2-14.
6. PROVIDE A MINIMUM OF 18 INCHES OF CLEAR SPACE FROM THE BYPASS METER TO THE EDGE OF CONCRETE PAD.
7. BACKFLOW DEVICE SIZE SHALL BE EQUAL TO OR GREATER THAN PIPE SIZE.
8. PVC OR PVCO WATER MAIN CONSTRUCTION SHALL BE PRE-APPROVED BY THE UTILITY PER SECTION 2-02.
- 9 . MECHANICAL JOINT RESTRAINT FOR PVC OR PVCO PIPE SHALL BE PER SECTION 2-12.01.
10. THE ULTIMATE RIGHT OF WAY SHALL BE DETERMINED BY PUBLIC WORKS - DEVELOPMENT SERVICES.

DOUBLE CHECK DETECTOR ASSEMBLY FIRE LINE ONLY

CITY OF MONTEREY PARK


PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.


W-220

DRAWN	BY AM	DATE 10/02/24	APPROVED WATER UTILITY MANAGER		DATE	12/10/24
REVISED	DZ	10/02/24				
CHANGED	XX	XX/XX/XX	APPROVED CITY ENGINEER		DATE	12/11/24

SHEET 2 OF 2

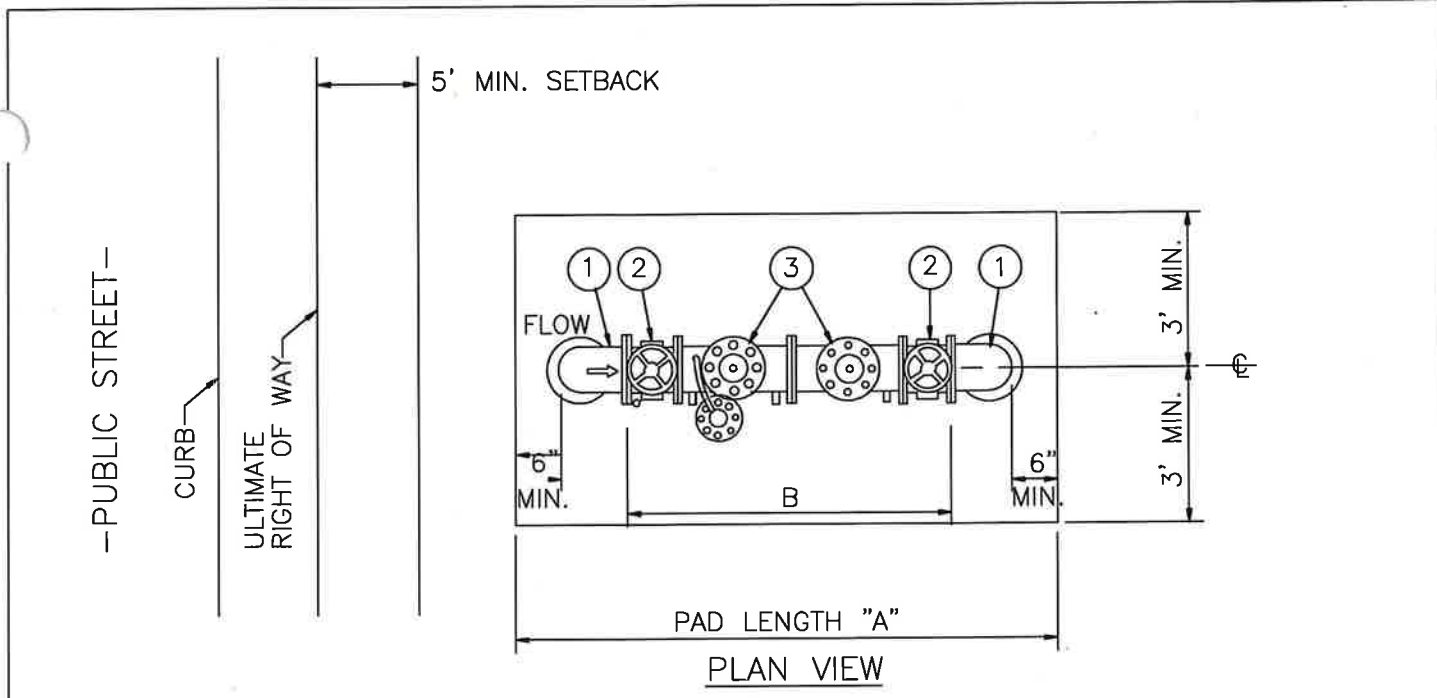

PLAN VIEW

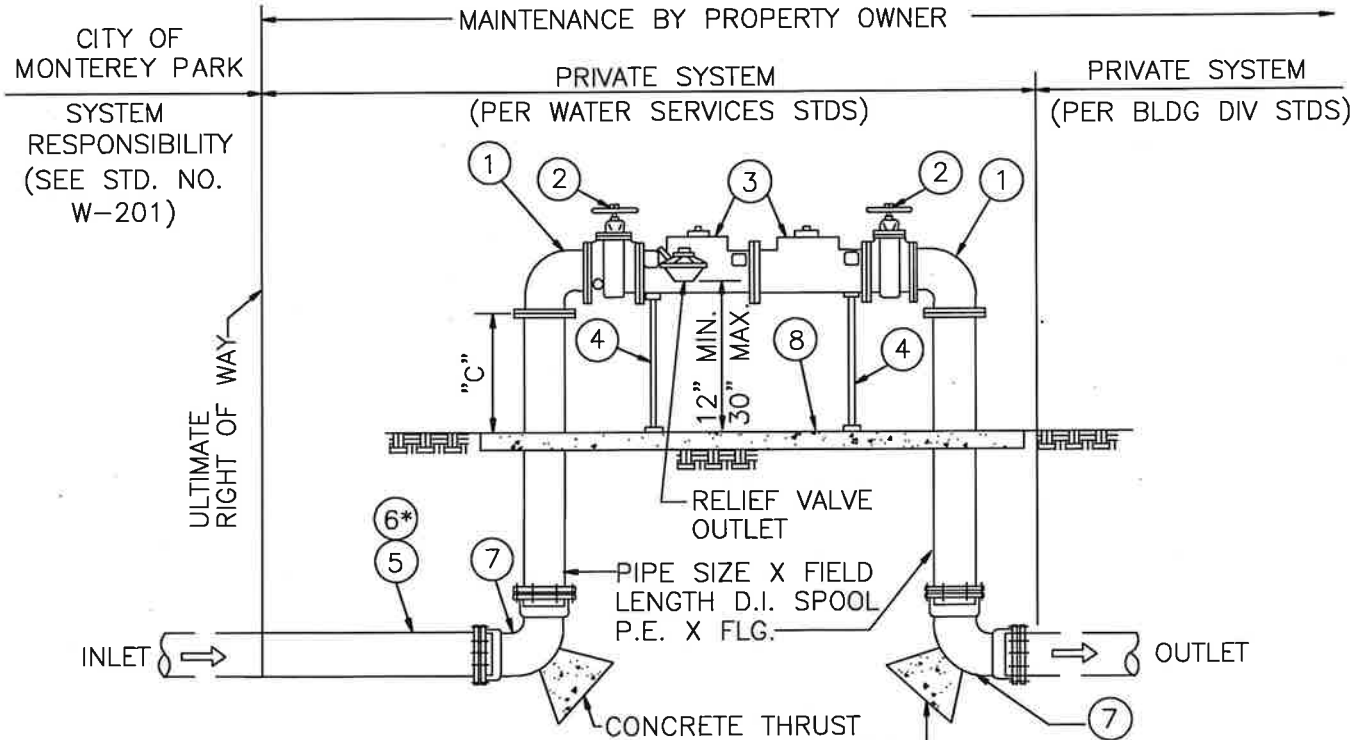

ELEVATION VIEW

* FOR PVC OR PVCO WATER MAIN CONSTRUCTION ONLY - SEE ITEM 6* AND NOTES 5 AND 6 ON SHEET 2

REDUCED PRESSURE PRINCIPLE TYPE ASSEMBLY

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-221

RAWN	BY AM	DATE 10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED WATER UTILITY MANAGER	DATE 12/10/24
APPROVED CITY ENGINEER	DATE 12/11/24

SHEET 1 OF 2

LIST OF MATERIAL

ITEM	DESCRIPTION
1	SR 90° BEND, D.I., FLG X FLG.
2	RESILIENT WEDGE VALVE, FLG X FLG, HAND WHEEL (SEE SECTION 2-06).
3	REDUCED PRESSURE PRINCIPLE TYPE BACKFLOW PREVENTER. THE BACKFLOW DEVICE SHALL BE LEAD FREE FOR DOMESTIC SERVICE.(SEE SECTION 5-01)
4	FLAT PIPE SUPPORT (SEE STD. NO. W-270).
5	PIPE SIZE X FIELD LENGTH D.I. SPOOL, P.E. X P.E.
6*	IN LIEU OF ITEM 5, PIPE SHALL BE AWWA C900 PVC OR AWWA C909 PVCO PIPE, CLASS 305, P.E.XP.E. (SEE NOTES 5 AND 6)
7	D.I. 90° BEND, M.J. X M.J. (2 TYP.), RESTRAINED PER SECTION 2-12.01
8	CONCRETE PAD 4" THICK, SIZE AS INDICATED HEREIN; CLASS 520-C-2500 CONCRETE

LATERAL SIZE	A	B (MAX)	C
2-1/2"	6'-6"	4'-0"	14"
3"	6'-6"	4'-0"	14"
4"	7'-0"	4'-3"	14"
6"	8'-6"	5'-3"	14"
8"	9'-6"	6'-4"	13.5"
10"	11'-6"	7'-5"	12"

NOTES:

1. ALL PIPE SHALL BE DUCTILE IRON PER SECTION 2-01.
2. ALL PIPE FITTINGS AND APPURTENANCES (GASKETS, NUTS, BOLTS, RESTRAINTS) SHALL COMPLY WITH SECTIONS 2-08 & 2-12.
3. SEE STD. NO. W-207, SHEET 2, FOR ABOVE GROUND ASSEMBLY INSTALLATION REQUIREMENTS.
4. THE COMPLETED ASSEMBLY SHALL BE PAINTED PER SECTION 2-14.
5. PVC OR PVCO WATER MAIN CONSTRUCTION SHALL BE PRE-APPROVED BY THE UTILITY PER SECTION 2-02.
6. MECHANICAL JOINT RESTRAINT FOR PVC OR PVCO PIPE SHALL BE PER SECTION 2-12.01.
7. THE ULTIMATE RIGHT OF WAY SHALL BE DETERMINED BY PUBLIC WORKS



REDUCED PRESSURE PRINCIPLE TYPE ASSEMBLY

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT-WATER DIVISION


STANDARD NO.

W-221

DRAWN	BY AM	DATE 10/02/24	APPROVED WATER UTILITY MANAGER		DATE 12/10/24
REVISED	DZ	10/02/24			
CHANGED	XX	XX/XX/XX	APPROVED CITY ENGINEER		DATE 12/11/24

SHEET 2 OF 2

COMPACT BACKFLOW ASSEMBLY PREVENTION

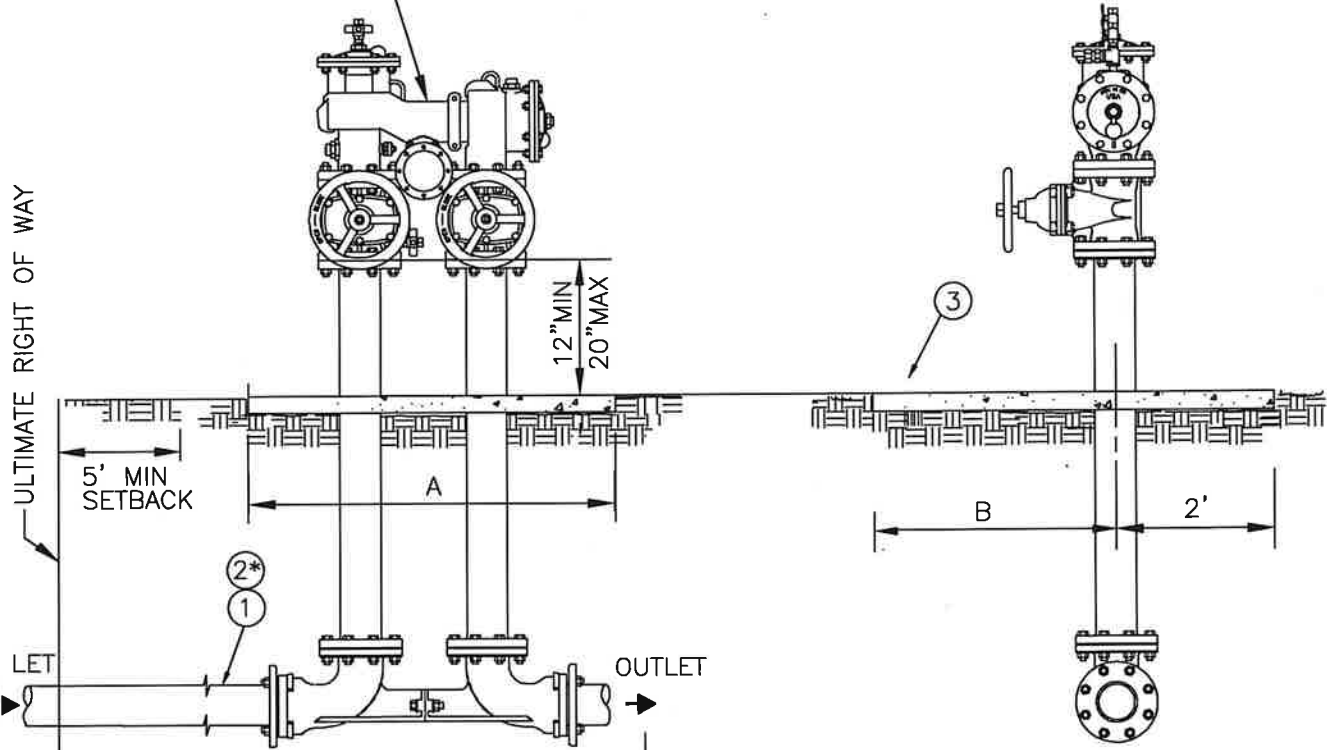

FRONT ELEVATION VIEW

SIDE ELEVATION VIEW

PRIVATE SYSTEM (PER WATER SERVICES STDS.) PRIVATE SYSTEM (PER BLDG. DIV. STDS)

MAINTENANCE BY PROPERTY OWNER

CITY OF MONTEREY PARK SYSTEM RESPONSIBILITY (SEE STD. NO. W-201)

* FOR PVC OR PVCO WATER MAIN CONSTRUCTION ONLY - SEE ITEM 2* AND NOTES 8 AND 9 ON SHEET 2.

COMPACT BACKFLOW PREVENTION ASSEMBLY FOR LARGE SERVICES - EXCLUDING FIRE LINES

CITY OF MONTEREY PARK
PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.
W-222

DRAWN	BY	DATE
	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED WATER UTILITY MANAGER	<i>[Signature]</i>	DATE	12/10/24
APPROVED CITY ENGINEER	<i>[Signature]</i>	DATE	12/11/24

SHEET 1 OF 2

LIST OF MATERIAL



ITEM	DESCRIPTION
1	PIPE SIZE X FIELD LENGTH D.I. SPOOL, P.E.. X P.E. (TYP).
2*	IN LIEU OF ITEM 1, PIPE SHALL BE AWWA C900 PVC OR AWWA C909 PVCO PIPE, CLASS 305, P.E.XP.E. (SEE NOTES 8 AND 9)
3	CONCRETE PAD 4" THICK, SIZE AS INDICATED HEREIN; CLASS 520-C-2500 CONCRETE

BACKFLOW DEVICE SIZE	A	B
2 1/2"	6.0'	3.0'
3"	6.5'	3.5'
4"	6.5'	4.0'
6"	7.0'	4.5'
8"	7.5'	5.0'
10"	8.0'	6.0'


NOTES:

1. THE BACKFLOW PREVENTION ASSEMBLY SHALL BE APPROVED BY THE UTILITY DIVISION AND WILL BE PER SECTION 5-01. THE DEVICE SHALL BE LEAD FREE FOR DOMESTIC SERVICE.
2. LOCATION AND INSTALLATION SHALL BE PER PLANS APPROVED BY THE UTILITY
3. ALL PIPE SHALL BE DUCTILE IRON PER SECTION 2-01
4. ALL PIPE FITTINGS AND APPURTENANCES (GASKETS, NUTS, BOLTS, RESTRAINTS) SHALL BE PER SECTIONS 2-08 AND 2-12.
5. THE COMPLETED ASSEMBLY SHALL BE PAINTED PER SECTION 2-14
6. NO CONNECTIONS SHALL BE MADE BETWEEN METER AND BACKFLOW PREVENTER
7. PVC OR PVCO WATER CONSTRUCTION SHALL BE PRE-APPROVED BY THE UTILITY PER SECTION 2-02.
8. MECHANICAL JOINT RESTRAINT FOR PVC OR PVCO PIPE SHALL BE PER SECTION 2-12.01.
9. THE ULTIMATE RIGHT OF WAY SHALL BE DETERMINED BY PUBLIC WORKS - ENGINEERING

COMPACT BACKFLOW PREVENTION ASSEMBLY FOR LARGE SERVICES - EXCLUDING FIRE LINES

<h2>CITY OF MONTEREY PARK</h2> <p>PUBLIC WORKS DEPARTMENT-WATER DIVISION</p>			STANDARD NO.
DRAWN	BY AM	DATE 10/02/24	<p align="center">W-222</p> <p align="center">SHEET 2 OF 2</p>
REVISED	DZ	10/02/24	
CHANGED	XX	XX/XX/XX	
APPROVED WATER UTILITY MANAGER			DATE 12/10/24
APPROVED CITY ENGINEER			DATE 12/11/24

METER SIZE	BACKFLOW PREVENTION DEVICE SIZE	DIMENSION						
		PAD LENGTH	METER ASSEMBLY	BACKFLOW ASSEMBLY	G1	H1	G2	H2
3"	4"	12'-9"	5'-11"	4'-3"	6.5"	9"	6.5"	9"
4"	4"	13'-7"	6'-9 1/2"	4'-3"	6.5"	9"	6.5"	9"
4"	6"	14'-8"	6'-9 1/2"	5'-3"	6.5"	9"	8"	10"
6"	6"	16'-3"	8'-0"	5'-3"	8"	10"	8"	10"
6"	8"	17'-6"	8'-0"	6'-4"	8"	10"	9"	11"
SEE NOTE 3								

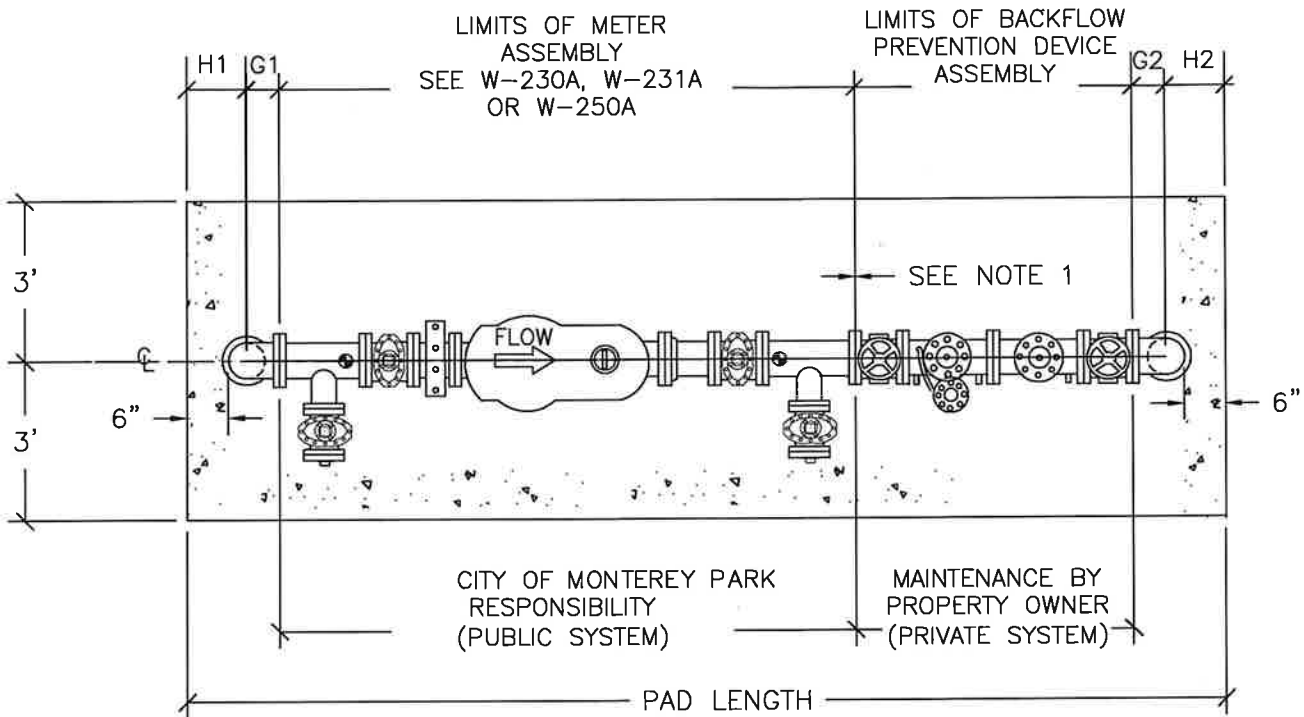

PLAN VIEW

NOTES:

1. A REDUCER (NOT SHOWN) SHALL BE INSTALLED AS REQUIRED BETWEEN BACKFLOW PREVENTION DEVICE VALVE AND METER BYPASS TEE. ADD REDUCER LAYING LENGTH TO PAD LENGTH.
2. METER SIZE LARGER THAN 6" SHALL BE SUBMITTED TO UTILITY FOR REVIEW AND APPROVAL, INCLUDING ASSEMBLY AND PAD DIMENSIONS
3. CONCRETE PAD, MINIMUM 4-IN. THICK, PAD SIZE AS INDICATED HEREIN. CONCRETE SHALL BE 520-C-2500. PAD LENGTH MAY VARY SEE NOTES 1 AND 5 HEREIN
4. AN EASEMENT DEDICATED TO THE CITY IS REQUIRED. LIMITS OF EASEMENT PER CITY ENGINEER.
5. METER ASSEMBLY LENGTH FOR W-250 IS NOT LISTED ABOVE, SEE THOSE DETAILS FOR LAYING LENGTHS, ADJUST PAD LENGTH ACCORDINGLY

COMBINATION METER AND BACKFLOW PREVENTION DEVICE ABOVE GROUND ASSEMBLY

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-229

DRAWN	BY	DATE
	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

[Signature]

DATE

12/10/24


APPROVED
CITY ENGINEER

DATE


12/11/24

SHEET 1 OF 1

METER SIZE	PIPE SIZE	TEST PORT SIZE	DIMENSION								MAXIMUM RATED FLOW (GPM)
			A	B	C	D	E	F	G	H	
3"	3"	2"	5'-11"	8'-6"	11"	8"	23"	10"	6.5"	9"	350
4"	4"	2"	6'-9.5"	9'-4"	13"	9"	27.5"	10"	6.5"	9"	700
6"	6"	2"	8'-0"	11'-0"	16"	10.5"	33"	10"	8"	10"	1400

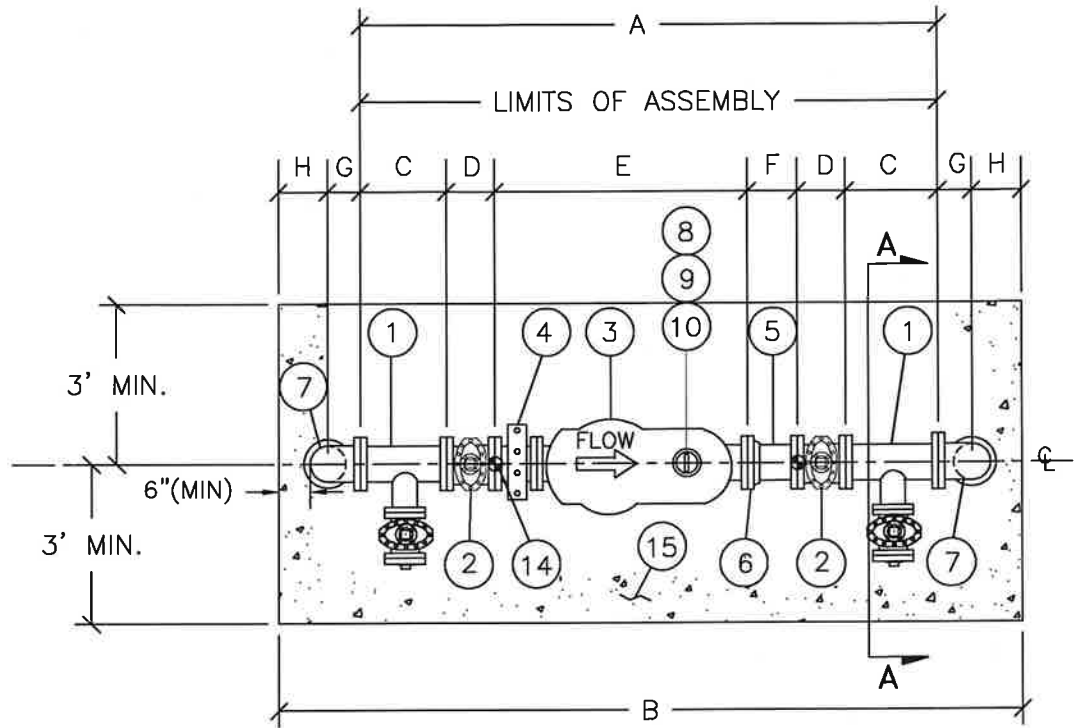

PLAN VIEW

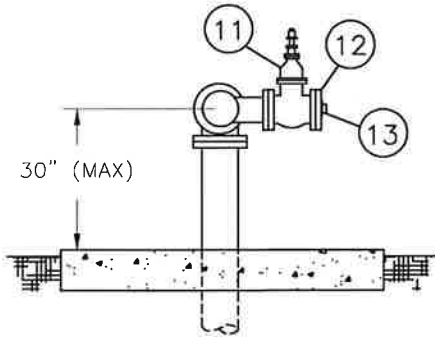

SECTION VIEW A-A
(2 TYP.)

3", 4", AND 6" METER ASSEMBLY - ABOVE GROUND

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-230A

	BY	DATE
DRAWN	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

APPROVED
CITY ENGINEER

[Signature] DATE 12/10/24
[Signature] DATE 12/11/24

SHEET 1 OF 2

LIST OF MATERIAL

ITEM	DESCRIPTION
1	TEE (PIPE SIZE BY 2" OUTLET), FLANGED
2	GATE VALVE (PIPE SIZE), RESILIENT WEDGE, FLANGED, N.R.S. W/ HAND WHEEL PER SECTION 2-05.01
3	METER (SEE SECTION 4-01)
4	STRAINER
5	FLG. X P.E. SPOOL
6	FLANGE ADAPTER PER SECTION 2-09.04
7	90° BENDS, FLANGED (2TYP.)
8	2" BRASS NIPPLE, HEX
9	2" BALL VALVE, FULL OPENING, BRASS, IPS THREAD
10	2" BRASS PLUG, IPS THREAD
11	REDUCER, FLANGED
12	COMPANION FLANGE WITH 2" IPS THREAD
13	FLAT PIPE SUPPORT (2 TYP.) PER STD. NO. W-270

NOTES:

1. METERS SHALL BE IN ACCORDANCE WITH SECTION 4-01.
2. SEE SECTION 2-05.01.1 FOR APPROVED GATE VALVE MANUFACTURERS.
3. ALL METERS SHALL READ IN CUBIC FEET
4. ALL PIPE SHALL BE DUCTILE IRON PER SECTION 2-01.
5. ALL PIPE FITTINGS AND APPURTENANCES (GASKETS, NUTS, BOLTS, ADAPTER) SHALL BE PER SECTION 2-08.
6. THE COMPLETED ASSEMBLY SHALL BE PAINTED PER SECTION 2-14.
7. A BACKFLOW PREVENTION DEVICE SHALL BE INSTALLED IN ACCORDANCE WITH SECTION 5-01.
8. AN EASEMENT DEDICATED TO THE CITY IS REQUIRED. SEE STD. NO. W-203 SHEET 1, FOR REQUIRED LIMITS OF EASEMENT..

3", 4", AND 6" METER ASSEMBLY - ABOVE GROUND

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.


W-230A

DRAWN	BY AM	DATE 10/02/24	APPROVED WATER UTILITY MANAGER		DATE 12/10/24
REVISED	DZ	10/02/24			
CHANGED	XX	XX/XX/XX	APPROVED CITY ENGINEER		DATE 12/11/24

SHEET 2 OF 2

EXISTING CURB

FINISH SURFACE

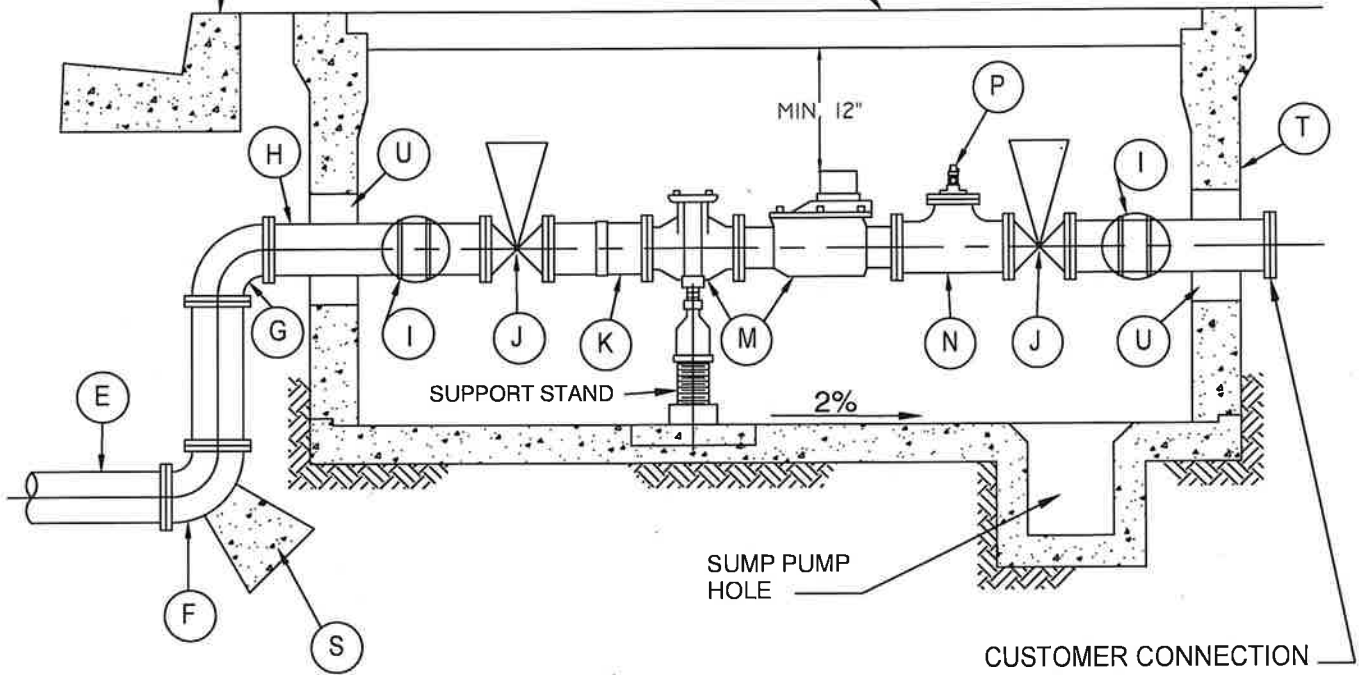

ELEVATION

NO SCALE

NOTES:

- 1. CITY TO REVIEW ALL VAULT SIZES AND DETERMINE LOCATION

3", 4", AND 6" METER & VAULT ASSEMBLY

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-230

DRAWN	BY AM	DATE 10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER


[Signature]
[Signature]

DATE 12/10/24

APPROVED
CITY ENGINEER

DATE 12/11/24

SHEET 1 OF 3

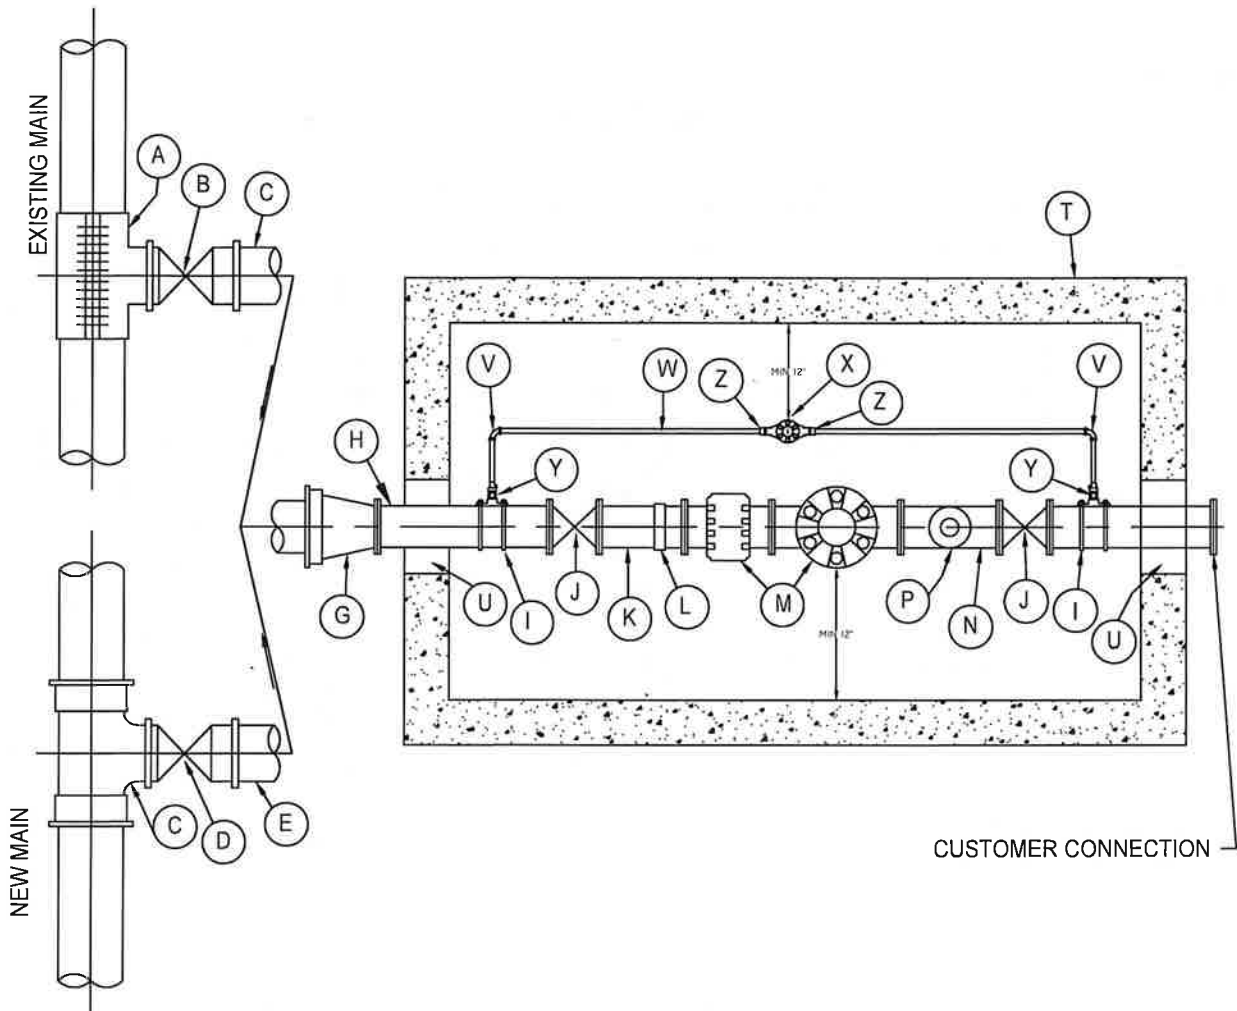

PLAN

NO SCALE

3", 4", AND 6" METER & VAULT ASSEMBLY

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-230

	BY	DATE
DRAWN	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

[Signature]
[Signature]

DATE 12/10/24
DATE 12/11/24

APPROVED
CITY ENGINEER

SHEET 2 OF 3

LIST OF MATERIALS

ITEM	3" METER	4" METER	6" METER	DESCRIPTION
A	Main size x 4"	Main size x 4"	Main size x 6"	Bolted Tapping Sleeve Stainless Steel
B	4"	4"	6"	Flg x M.J. Tapping Valve AFC
C	Main size x 4"	Main size x 4"	Main size x 6"	M.J. x M.J. x Flg. Tee
D	4"	4"	6"	Flg x M.J. Gate Valve and box
E	4"	4"	6"	Class 52 D.I. Pipe
F	4"	4"	6"	M.J. x Flg Ell
G	--	4"	6"	Flg x Flg Ell (4" & 6")
G	4 x 3"	--	--	Flg x Flg Reducer Ell (3")
H	3"	4"	6"	Flg D.I. Spool (minimum 12" length)
I	3"	4"	6"	2" Saddle* Ford B202B
J	3"	4"	6"	Flg Gate Valve AFC
K	3" x 15"	4" x 20"	6" x 30"	Flg x Flg Nipple (cut in half)
L	3"	4"	6"	Flex Coupling (Romac 501 or equal)
M	3"	4"	6"	Meter & Strainer (provided by City)
N	3" x 12"	4" x 16"	6" x 24"	Flg x Flg Spool with 2-inch tap**
P	3"	4"	6"	Corp Stop**
S	--	--	--	Thrust Block, Std. Dwg. No. W-140
T	R37 P36 Pit	R37 P36 Pit	R37 P36 Pit***	Meter box and lid****
U	R37-54H Lid	R37-54H Lid	R37-54H Lid	with 3" layer of round rock under base 8" opening and grout

2" By-Pass*

V	Swt x Swt 90° Bend
W	2" Copper 'K'
X	2" P.D. Meter (Supplied by the City)
Y	2" P.J. x M.I.P. Ball Valve w/ lockwing
Z	Swt x M.I.P. coupling

Meter lid to be steel-hinged, parkway cover, double leaf.
Reading lid to be centered over register and include hole for Radio read equipment.

*By-Pass size as requested by customer.

**Tap to be located at 2 pipe diameters downstream of meter flange
(deleted for compound meter).

***May require portion of piping outside vault.

****(equivalent may be approved by Water Utility Manager).

3", 4", AND 6" METER & VAULT ASSEMBLY

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-230


DRAWN	BY AM	DATE 10/02/24	APPROVED WATER UTILITY MANAGER	DATE 12/10/24
REVISD	DZ	10/02/24		
CHANGED	XX	XX/XX/XX	APPROVED CITY ENGINEER	DATE 12/11/24

SHEET 3 OF 3

LIST OF MATERIAL

ITEM	DESCRIPTION
1	TEE (PIPE SIZE BY 2" OUTLET), FLANGED
2	GATE VALVE (PIPE SIZE), RESILIENT WEDGE, FLANGED, N.R.S. W/ HAND WHEEL PER SECTION 2-05.01
3	METER (SEE SECTION 4-01)
4	STRAINER
5	FLG. X P.E. SPOOL
6	FLANGE ADAPTER PER SECTION 2-09.04
7	90° BENDS, FLANGED (2TYP.)
8	2" BRASS NIPPLE, HEX
9	2" BALL VALVE, FULL OPENING, BRASS, IPS THREAD
10	2" BRASS PLUG, IPS THREAD
11	REDUCER, FLANGED
12	COMPANION FLANGE WITH 2" IPS THREAD
13	FLAT PIPE SUPPORT (2 TYP.) PER STD. NO. W-270

METER SIZE	PAD LENGTH	DIMENSIONS						
		A	B	C	D	E	F	G
3"	7'-2"	55"	8"	6"	12"	11"	6.5"	9"
4"	7'-9"	62.5"	9"	7 1/2"	14"	13"	6.5"	9"
6"	9'-2"	74"	10 1/2"	9"	18"	16"	8"	10"

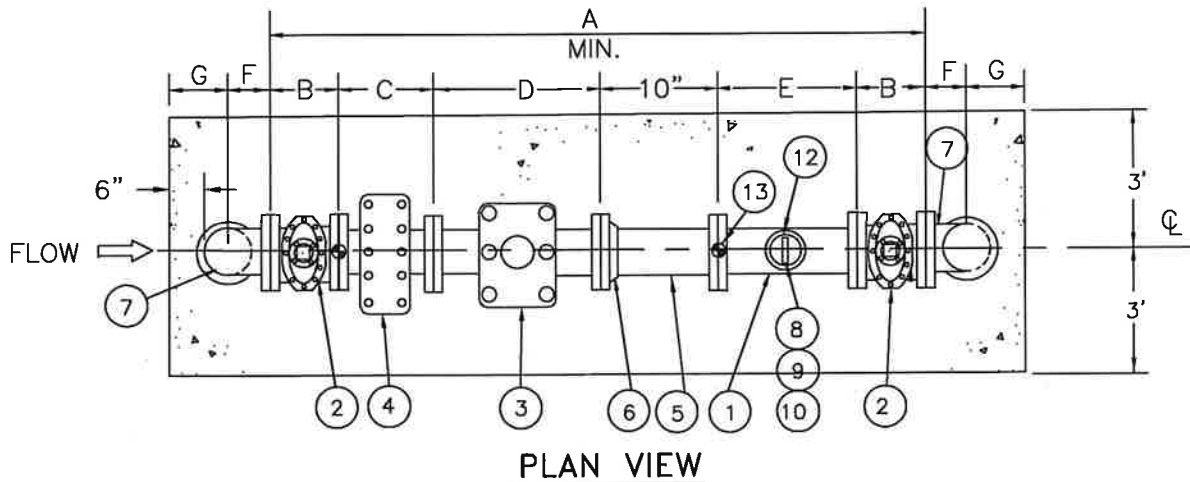

3", 4" AND 6" IRRIGATION METER - ABOVE GROUND ASSEMBLY

CITY OF MONTEREY PARK
PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-250A

	BY	DATE
DRAWN	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

[Signature]

DATE 12/10/24

APPROVED
CITY ENGINEER

[Signature]

DATE 12/11/24

SHEET 1 OF 2

NOTES:

1. ALL PIPE SHALL BE DUCTILE IRON PER SECTION 2-01.
2. ALL PIPE FITTINGS AND APPURTENANCES (GASKETS, NUTS, BOLTS, ADAPTER) SHALL BE PER SECTION 2-08.
3. THE COMPLETED ASSEMBLY SHALL BE PAINTED PER SECTION 2-14.
4. CONCRETE PAD SHALL BE MINIMUM 4-INCH THICK, SIZE AS INDICATED HEREIN. CONCRETE SHALL BE CLASS 520-C-2500.
5. A BACKFLOW PREVENTION DEVICE SHALL BE INSTALLED IN ACCORDANCE WITH SECTION 5-01.

3",4" AND 6" IRRIGATION METER - ABOVE GROUND ASSEMBLY

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-250A


DRAWN	BY AM	DATE 10/02/24	APPROVED WATER UTILITY MANAGER		DATE 12/10/24
REVISED	DZ	10/02/24			
CHANGED	XX	XX/XX/XX	APPROVED CITY ENGINEER		DATE 12/11/24

SHEET 2 OF 2

LIST OF MATERIAL

ITEM	DESCRIPTION
1	TEE (PIPE SIZE BY 2" OUTLET), FLANGED
2	GATE VALVE (PIPE SIZE), RESILIENT WEDGE, FLANGED, N.R.S. W/ HAND WHEEL PER SECTION 2-05.01
3	METER, (SEE SECTION 4-01)
4	STRAINER
5	FLG. X P.E. SPOOL, LENGTH AS INDICATED OR AS REQUIRED TO MATCH VAULT DIMENSIONS
6	FLANGE ADAPTER PER SECTION 2-09.04
7	2" NIPPLE, HEX, BRASS
8	2" VALVE, BALL, FULL OPENING, BRASS, IPS THREAD
9	2" PLUG, BRASS, IPS THREAD
10	REDUCER, M.J. X M.J. MECHANICAL JOINTS RESTRAINED PER SECTION 2-12.01
11	COMPANION FLANGE WITH 2" IPS THREAD
12	FLAT PIPE SUPPORT (2 TYP.) PER STD. NO. W-270

METER SIZE	DIMENSIONS						
	A	B	C	D	E	F	G
3"	55"	8"	6"	12"	11"	10"	8"
4"	62.5"	9"	7 1/2"	14"	13"	10"	8"
6"	74"	10 1/2"	9"	18"	16"	10"	10"

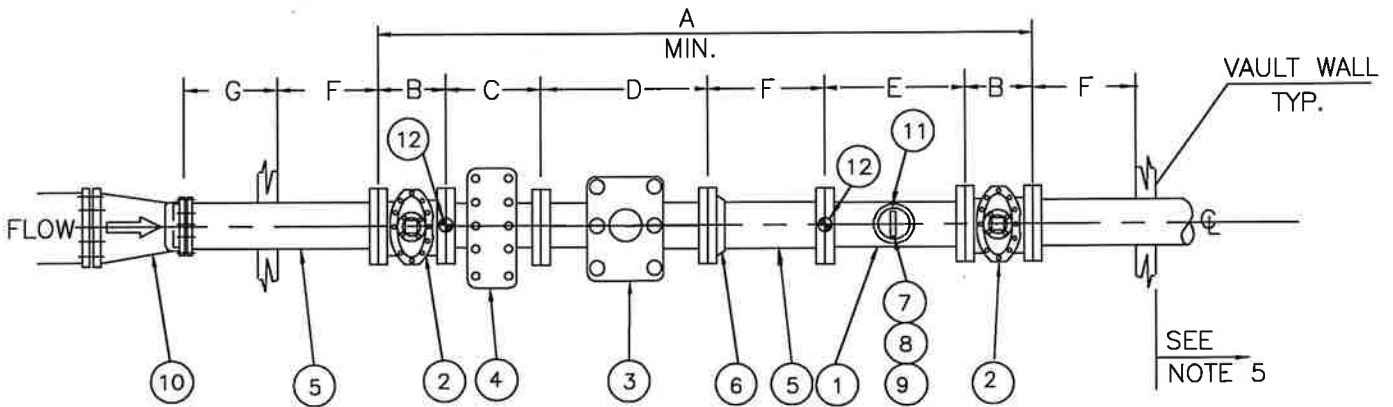

PLAN VIEW

3", 4" AND 6" IRRIGATION METER VAULT ASSEMBLY

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-250

DRAWN	BY	DATE
	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED WATER UTILITY MANAGER	<i>[Signature]</i>	DATE	12/10/24
APPROVED CITY ENGINEER	<i>[Signature]</i>	DATE	12/11/24

SHEET 1 OF 2

NOTES:

1. SEE STD. NO. W-203 FOR STANDARD METER VAULT INSTALLATION REQUIREMENTS.
2. ALL PIPE SHALL BE DUCTILE IRON PER SECTION 2-01.
3. ALL PIPE FITTINGS AND APPURTENANCES (GASKETS, NUTS, BOLTS, ADAPTER) SHALL BE PER SECTION 2-08.
4. THE COMPLETED ASSEMBLY SHALL BE PAINTED PER SECTION 2-14.
5. A BACKFLOW PREVENTION DEVICE SHALL BE INSTALLED IN ACCORDANCE WITH SECTION 5-01.
6. AN EASEMENT DEDICATED TO THE CITY IS REQUIRED IF LOCATED ON PRIVATE PROPERTY. SEE STD. NO. W-203 SHEET 1, FOR REQUIRED LIMITS OF EASEMENT.
7. REMOTE METER READING SYSTEM REQUIRED. SEE STD. NO. W-203, SHEET 3.

3",4" AND 6" IRRIGATION METER VAULT ASSEMBLY

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION



STANDARD NO.

W-250


DRAWN	BY AM	DATE 10/02/24	APPROVED WATER UTILITY MANAGER		DATE 12/10/24
REVISED	DZ	10/02/24	APPROVED CITY ENGINEER		DATE 10/14/24
CHANGED	XX	XX/XX/XX			

SHEET 2 OF 2

FLAT SUPPORT FOR FIRE LINES & METERS

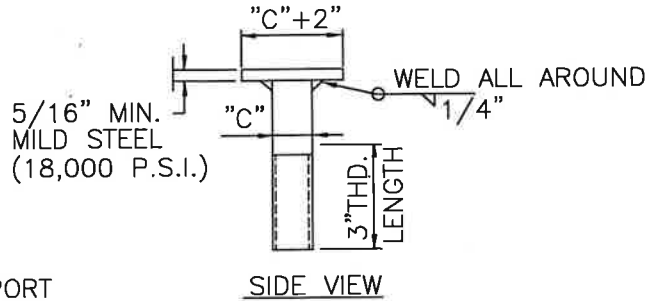

ADJUSTABLE PIPE SADDLE SUPPORT
GRINNELL FIG. 264

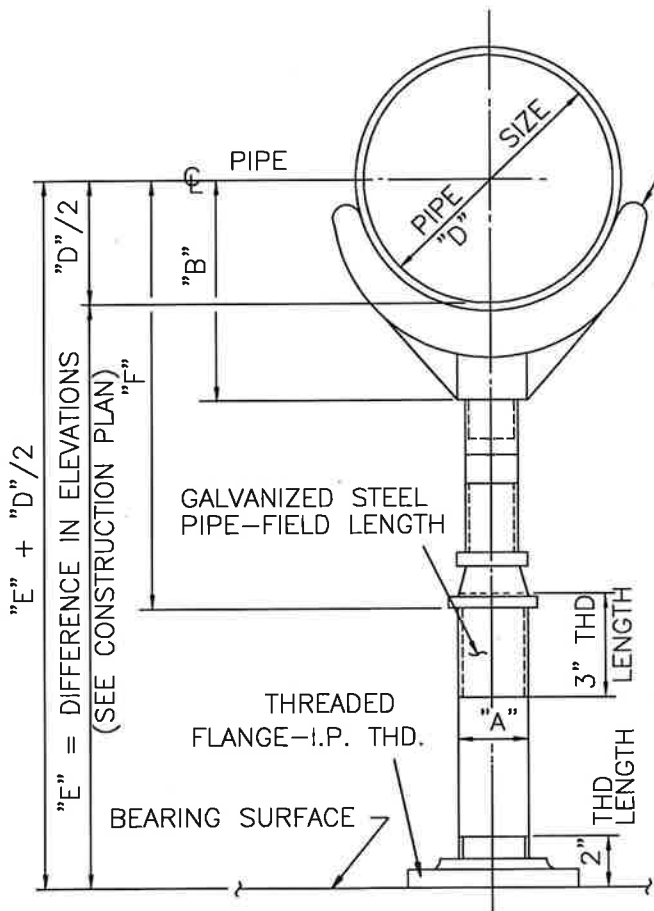

D	A	B	C	F	
				MIN.	MAX.
2 1/2"	2 1/2"	3 1/2"	1 1/2"	8"	13"
3	2 1/2	3 3/4	1 1/2	8 1/4	13 1/4
4	3	4 1/4	2 1/2	9 1/4	14
6	3	5 1/2	2 1/2	10 1/2	15 1/4
8	3	6 7/8	2 1/2	11 3/4	16 1/2
10	3	8 1/2	2 1/2	13 1/2	18 1/4
12	3	9 15/16	2 1/2	15	19 3/4
14	4	10 15/16	3	16 1/4	20 3/4
16	4	12 3/8	3	17 3/4	22 1/4
18	6	13 7/8	3 1/2	19 1/2	24
20	6	15 3/8	3 1/2	21	25 1/2
24	6	17 15/16	4	23 3/4	28 1/4
30	6	21 5/16	4	27	31 1/2
36	6	24 1/2	4	30 1/4	34 3/4

NOTES:

THE FLAT SUPPORT SHOWN IN THIS DETAIL SHALL BE USED FOR ALL METER ASSEMBLIES AND FIRE LINES IN LIEU OF THE SADDLE SUPPORT.

ADJUSTABLE PIPE SUPPORT

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT-WATER DIVISION

STANDARD NO.

W-270

DRAWN	BY	DATE
	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

[Signature]

DATE

12/10/24


APPROVED
CITY ENGINEER

DATE

12/11/24

SHEET 1 OF 1

PIPE SADDLE W/ U-BOLT & NUTS
GRINNELL FIG. 259
OR TOLCO FIG. 318

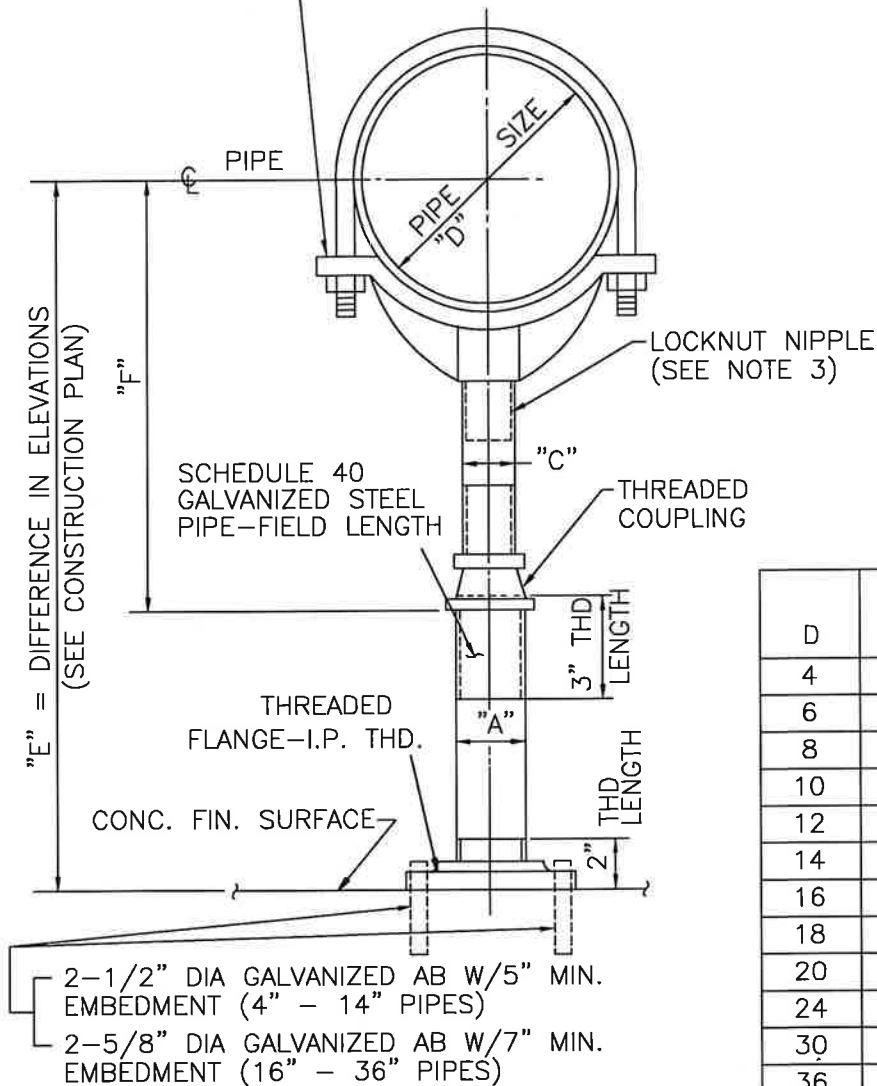

D	A	C	F	
			MIN.	MAX.
4	3	2 1/2	9 1/4	14
6	3	2 1/2	10 1/2	15 1/4
8	3	2 1/2	11 3/4	16 1/2
10	3	2 1/2	13 1/2	18 1/4
12	3	2 1/2	15	19 3/4
14	4	3	16 1/4	20 3/4
16	4	3	17 3/4	22 1/4
18	6	4	19 1/2	24
20	6	4	21	25 1/2
24	6	4	23 3/4	28 1/4
30	6	4	27	31 1/2
36	6	4	30 1/4	34 3/4

NOTES:

1. ALL MATERIAL SHALL BE GALVANIZED STEEL, UNLESS OTHERWISE SPECIFIED.
2. INSTALLED PIPE SUPPORT SHALL PROVIDE VERTICAL ADJUSTMENT OF APPROXIMATELY 4 1/2 INCHES.
3. LOWER END OF NIPPLE SHALL BE STAKED, UPSETTING THE THREADS TO PREVENT SEPARATION OF NIPPLE & COUPLING DURING ADJUSTMENT.

ADJUSTABLE PIPE SUPPORT W/ U-BOLT

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-271

	BY	DATE
DRAWN	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

[Signature]

DATE

12/10/24


APPROVED
CITY ENGINEER

[Signature]


DATE

12/11/24

SHEET 1 OF 1

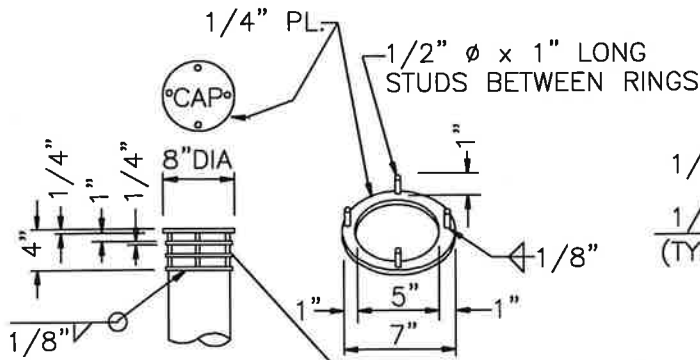

VENT CAP

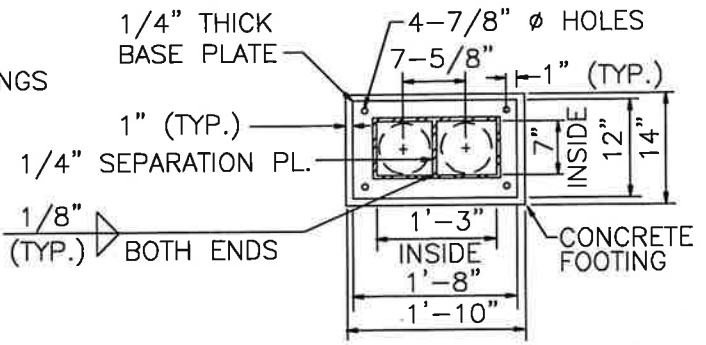

PLAN-VENT BASE SECTION A-A

ALL EXTERIOR SURFACE METAL ABOVE GROUND TO BE PAINTED AS PER A.W.W.A. STD. C218 3 COAT SYSTEM


SEE NOTE 4 ON SHT 2

6" STD. STEEL PIPE


RANDOM SPACING 1" C.-C. 5/8" Ø HOLES ON FRONT & REAR-INLET SIDE ONLY

1/4" PL. HOUSING ADAPTER GR.

P.C. CONCRETE TYPE 500-C-2500

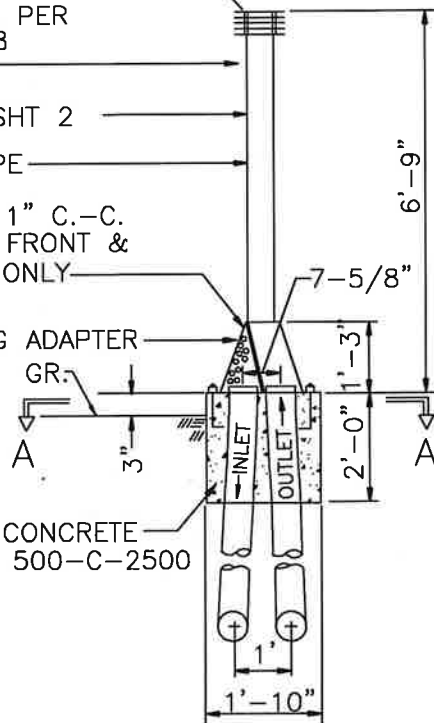

FRONT VIEW

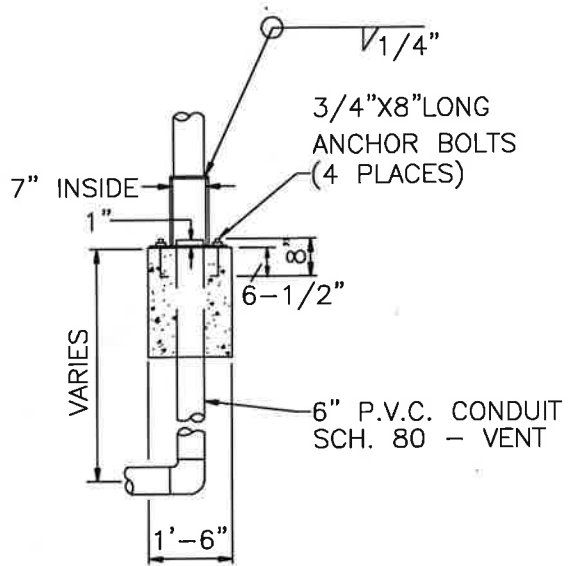

SIDE VIEW

DUAL INLET-OUTLET VENT STACK TYPE I

SEE NOTES ON SHT. 2.

AIR VENT FOR U.G. STRUCTURES

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-601


DRAWN	BY	DATE
	AM	10/02/24
REVISED	XX	XX/XX/XX
CHANGED	XX	XX/XX/XX

APPROVED WATER UTILITY MANAGER


APPROVED CITY ENGINEER

[Handwritten Signature] DATE 12/10/24
[Handwritten Signature] DATE 12/11/24

SHEET 1 OF 2

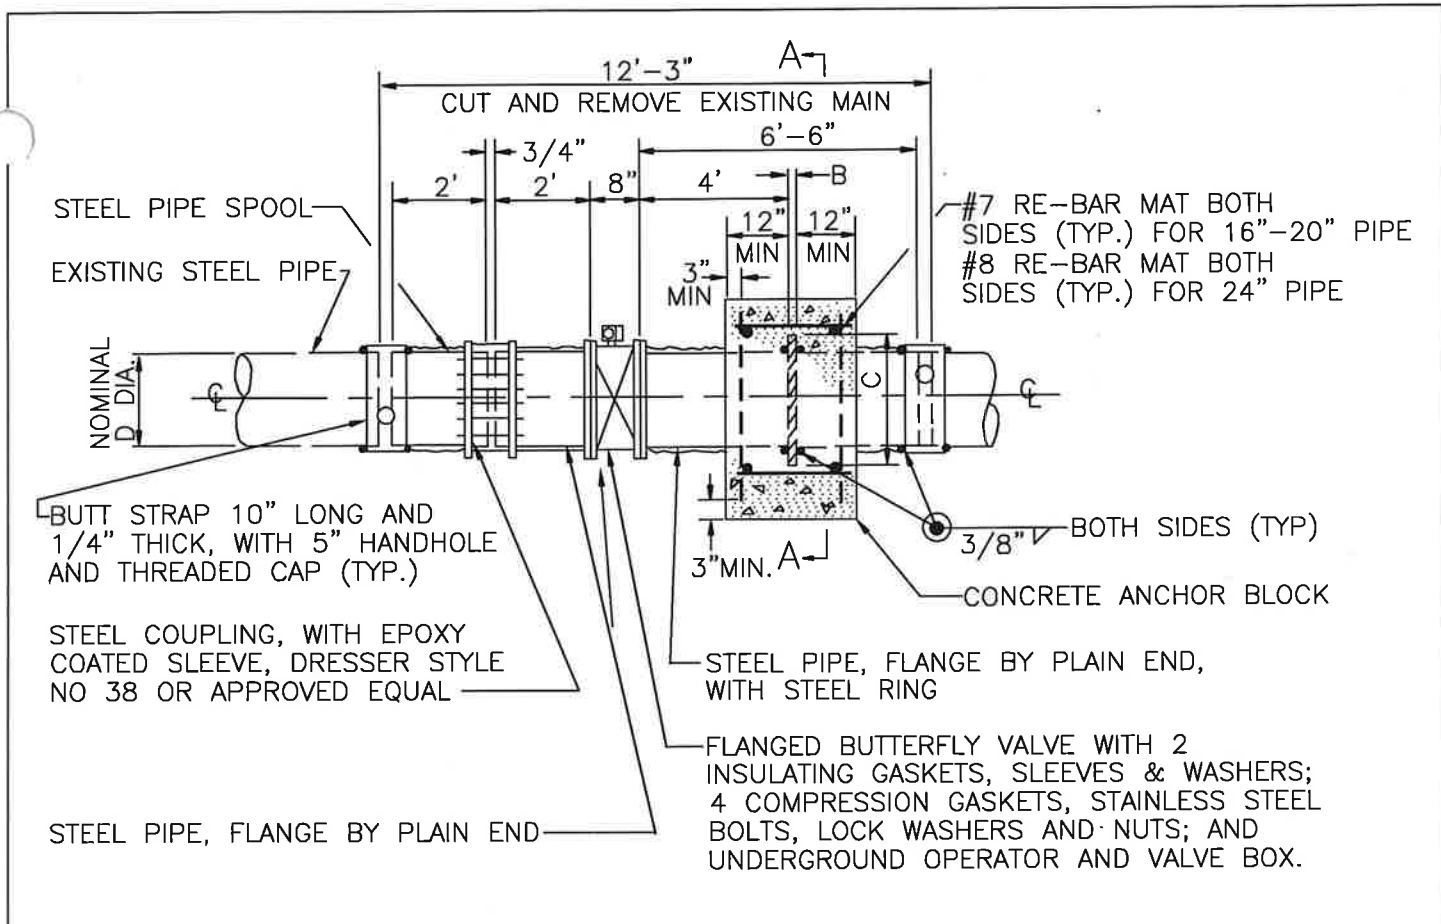

PLAN VIEW
NTS

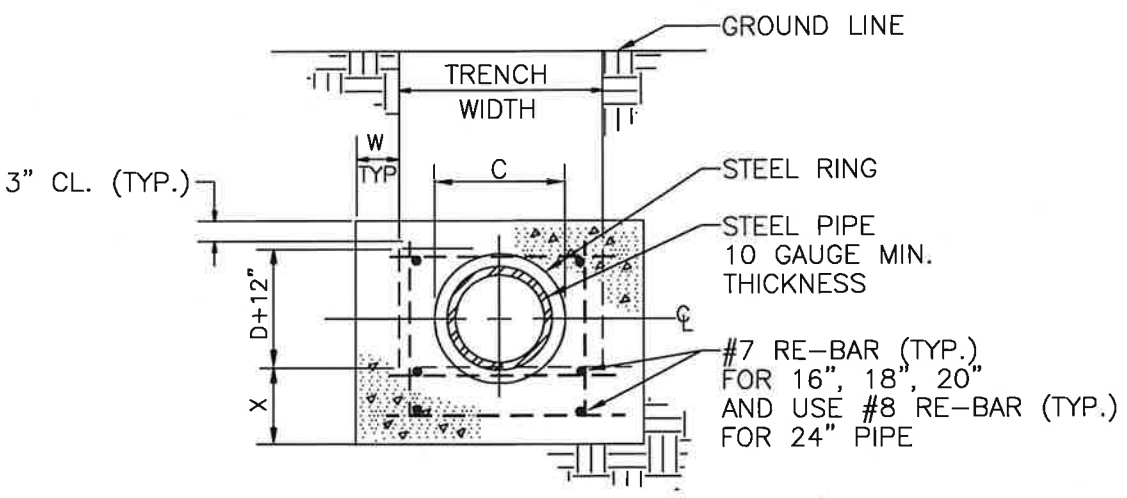

SECTION A-A

VALVE INSTALLATION ON EXISTING STEEL PIPE (CCP)

CITY OF MONTEREY PARK
PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-605

DRAWN	BY	DATE
AM	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	10/02/24

APPROVED WATER UTILITY MANAGER	DATE
<i>[Signature]</i>	12/10/24
APPROVED CITY ENGINEER	DATE
<i>[Signature]</i>	12/11/24

SHEET 1 OF 2

ANCHOR BLOCK AND STEEL RING DIMENSIONS

D \ VARIABLE		STATIC WATER PRESSURE – P.S.I.					
		100	110	120	130	140	150
16"	W(INCH)	18	18	18	18	18	18
	X(INCH)	15	15	18	21	25	30
	B(INCH)	1 7/16	1 7/16	1 7/16	1 7/16	1 7/16	1 7/16
	C(INCH)	23 1/2	23 1/2	23 1/2	23 1/2	23 1/2	23 1/2
18"	W(INCH)	18	18	18	18	18	20
	X(INCH)	21	24	27	30	34	36
	B(INCH)	1 9/16	1 9/16	1 9/16	1 9/16	1 9/16	1 9/16
	C(INCH)	25	25	25	25	25	25
20"	W(INCH)	18	18	18	24	24	26
	X(INCH)	27	30	35	33	34	36
	B(INCH)	1 11/16	1 11/16	1 11/16	1 11/16	1 11/16	1 11/16
	C(INCH)	27 1/2	27 1/2	27 1/2	27 1/2	27 1/2	27 1/2
24"	W(INCH)	27	30	30	32	35	38
	X(INCH)	27	30	34	37	37	38
	B(INCH)	1 7/8	1 7/8	1 7/8	1 7/8	1 7/8	1 7/8
	C(INCH)	32	32	32	32	34	36

NOTES:

1. REMOVE CEMENT MOTAR COATING FROM EXISTING PIPE TO FACILITATE WELDING OF BUTT STRAP TO EXISTING PIPE.
2. STEEL PIPE CEMENT MOTAR LINING SHALL BE 1/2" THICK AND CEMENT MOTAR COATING SHALL BE 3/4" THICK.
3. ALL EXPOSED METAL SURFACES SHALL BE COATED WITH "BITUMASTIC" OR APPROVAL EQUAL.
4. CONCRETE FOR ANCHOR BLOCK SHALL BE CLASS 520-C-2500.
5. CONCRETE IN AREAS "W" AND "X" SHALL BE POURED AGAINST UNDISTURBED EARTH.
6. AREA REQUIREMENTS ARE BASED UPON 1 1/2 TIMES STATIC WATER PRESSURE AND SOIL BEARING PRESSURE OF 2000 LBS./SQ. FT.

VALVE INSTALLATION ON EXISTING STEEL PIPE (CCP)

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT – WATER DIVISION

STANDARD NO.

W-605

DRAWN	BY AM	DATE 10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	10/02/24

APPROVED
WATER UTILITY MANAGER

DATE


12/10/24

APPROVED
CITY ENGINEER

DATE

12/11/24

SHEET 2 OF 2

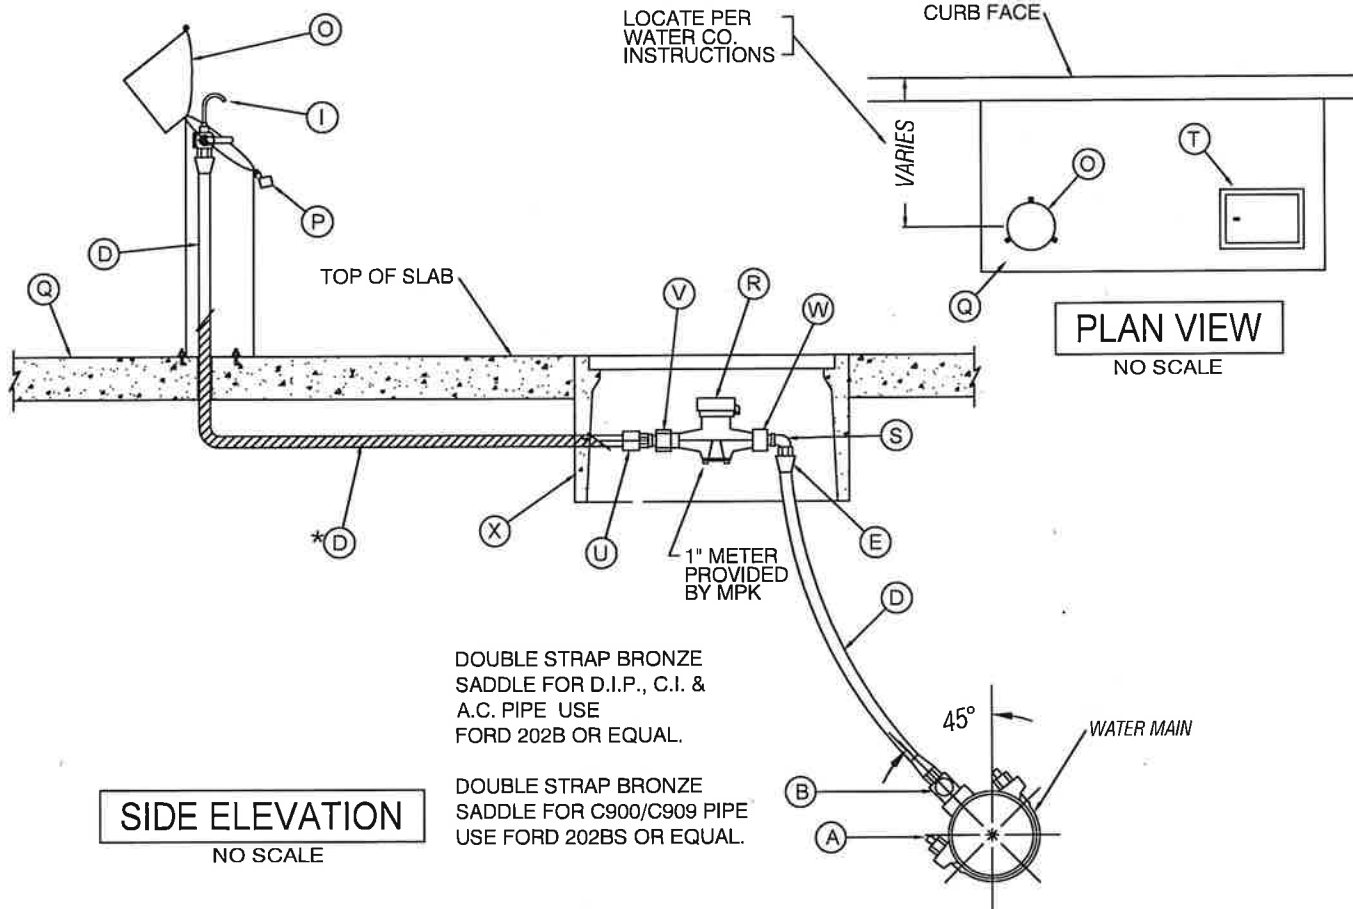

SIDE ELEVATION
NO SCALE

NOTES:

1. MATERIALS AND INSTALLATION SHALL CONFORM WITH THE APPLICABLE SECTIONS OF MONTEREY PARK WATER DEPARTMENT SPECIFICATIONS FOR DOMESTIC WATER SYSTEMS.
2. FINISH COLOR SHALL BE DESERT TAN, INSIDE AND OUT.

WATER SAMPLING STATION

CITY OF MONTEREY PARK
PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-607

DRAWN	BY AM	DATE 10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	10/02/24

APPROVED
WATER UTILITY MANAGER

APPROVED
CITY ENGINEER

[Signature] DATE 12/10/24

[Signature] DATE 12/11/24

LEGEND			
A	DOUBLE STRAP BRONZE SADDLE	Δ L	PUMP CONNECTOR
B	1" BRASS BALL CORPORATION STOP FORD FB1000-4	Δ M	BRASS NOZZLE WITH THREADS
C	1" SWT X F.I.P. COUPLING ATTACHED TO STRAIGHT COUPLING	Δ N	IRON HANDLE
D	1" COPPER TUBING*WRAP WITH 10 MIL WRAP TAPE	Δ O	SAMPLING STATION WITH HINGED COVER ARMOR CAST #P6002010 OR APPROVED EQUAL
Δ E	ANGLE METER STOP - 1" FORD #KV43-444W OR 2" FORD #FV43-777W	Δ P	PADLOCK PROVISION
Δ F	3/8" BRASS PIPE INSIDE 1" BRAS PIPE	Q	2'-6" X 4'-6" X 4" THICK CONCRETE PAD
Δ G	BRASS VALVE BODY & ASSEMBLY	R	1" METER PROVIDED BY THE CITY
Δ H	1/4" BRASS ELBOW	S	FIBERGLASS ARMORCAST PRODUCT METER BOX & COVER
Δ I	1/4" COPPER TUBING	T	1" SWT X F.I.P. COUPLING ATTACHED TO STRAIGHT COUPLING
Δ J	ALUMINUM BASE	U	STAIGHT METER COUPLING FORD #C38-44-2.625
K	BRASS PET COCK	V	ARMORCAST PRODUCTS #66 METER VAULT OR CITY APPROVED EQUAL

Δ - TO BE SUPPLIED BY THE CITY



WATER SAMPLING STATION

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION





STANDARD NO.

W-607

DRAWN	BY AM	DATE 10/02/24	APPROVED WATER UTILITY MANAGER		DATE 12/10/24
REVISD	DZ	10/02/24	APPROVED CITY ENGINEER		DATE 12/11/24
CHANGED	XX	10/02/24			

SHEET 2 OF 2

ITEM NO.	SIZE AND DESCRIPTION
1	(8"x8"x16") CONCRETE OR SLUMP BLOCK (SOLID GROUT ALL CELLS)
2	COLD JOINT STRIP
3	(7'-4" X 5'-4" X 4" THICK) CONCRETE PAD
4	FIRE HYDRANT - SEE NOTE 1.
5	(8"x8"x16") CAP BLOCK.
6	#4 REBAR, TYPICAL - SEE NOTE 2. REBAR SHALL CONFORM TO ASTM A615, GRADE 60
7	CONCRETE FOOTING, CLASS 560-C-3250 PER SSPWC SECTION 201

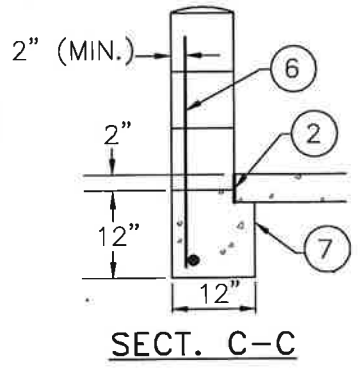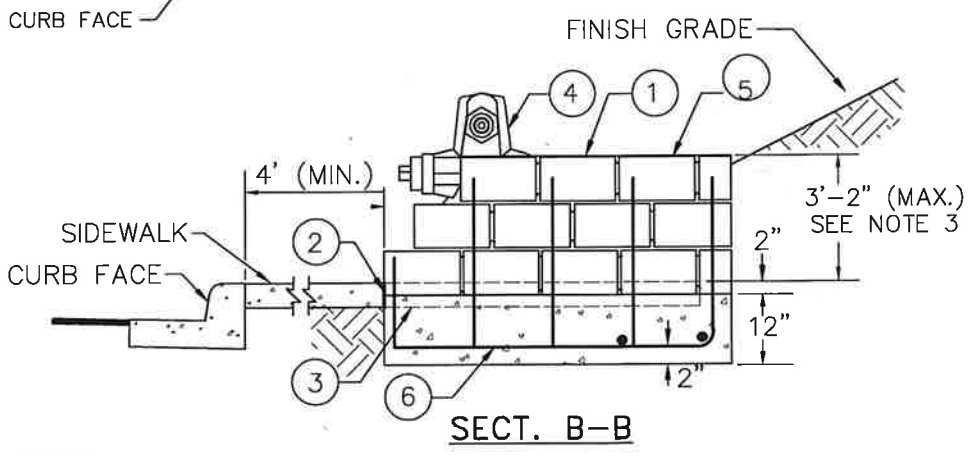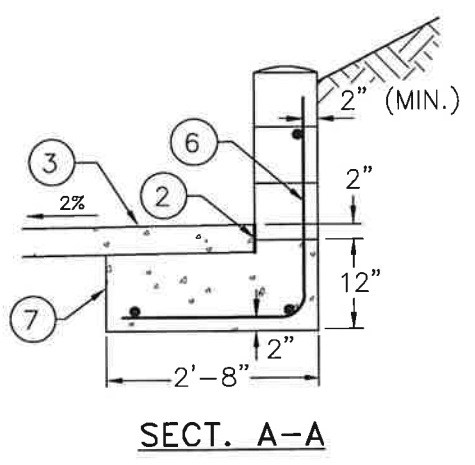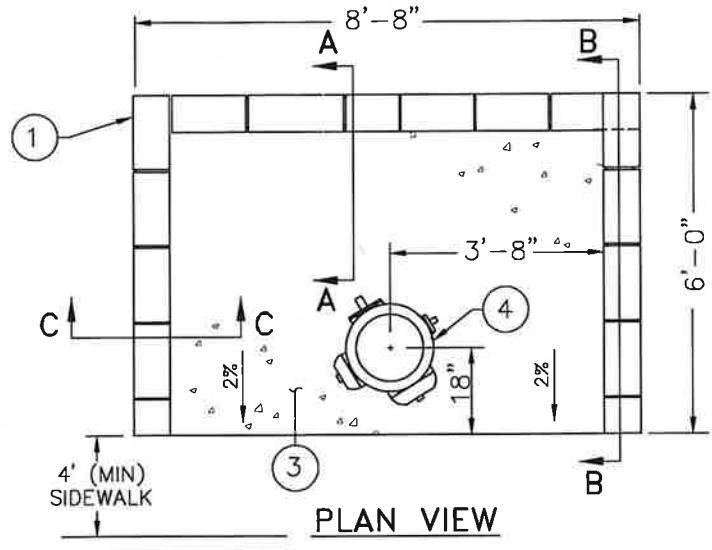

- NOTES:
- 1 RETAINING WALLS SHALL BE INSTALLED WHERE SHOWN ON THE PLANS OR AS DIRECTED BY THE ENGINEER.
 - 2 VERTICAL BARS TO BE INSTALLED AT 16 INCH ON CENTER
 - 3 RETAINING WALLS IN EXCESS OF 3'-2" SHALL BE DESIGNED BY THE ENGINEER OF WORK
 - 4 SUBMIT BLOCK STYLE AND COLOR FOR PRE-APPROVAL BY THE UTILITY.
 - 5 A 36" CLEARANCE SHALL BE MAINTAINED OF ANY OBSTRUCTION FROM FIRE HYDRANT TO THE WALL
 - 6 OMIT MORTAR FROM VERTICAL JOINT OF FIRST BLOCK COURSE ABOVE FINISHED GRADE TO PROVIDE WEEP HOLES FOR SUB-DRAINAGE PURPOSES

RETAINING WALL FOR FIRE HYDRANT AND OTHER WATER APPURTENANCES

CITY OF MONTEREY PARK
PUBLIC WORKS DEPARTMENT WATER DIVISION

STANDARD NO.
W-608



DRAWN	BY	DATE
	AM	10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	10/02/24

APPROVED
WATER UTILITY MANAGER

APPROVED
CITY ENGINEER

[Signature] DATE 12/10/24

[Signature] DATE 12/11/24

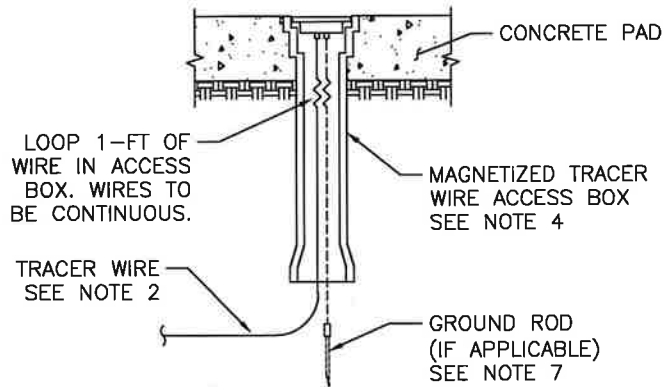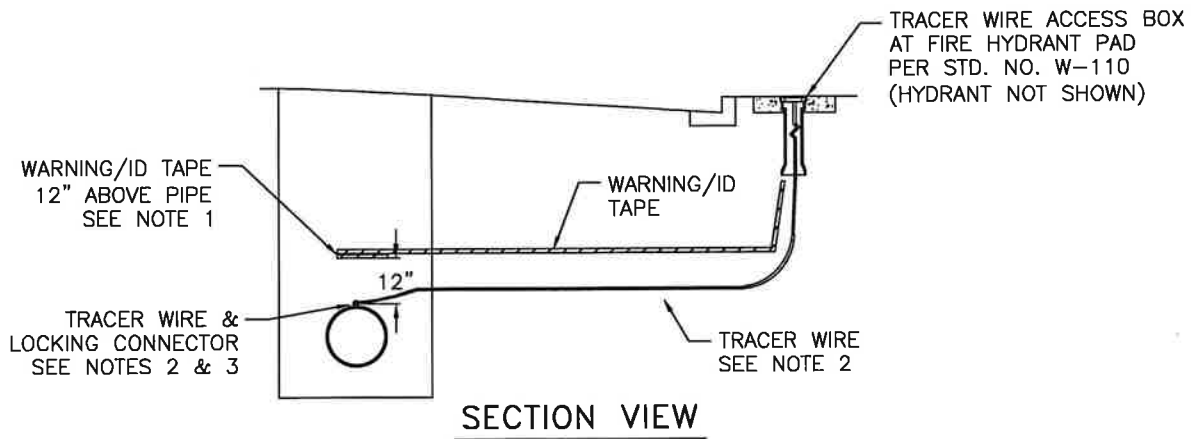

TRACER WIRE ACCESS BOX

NOTES:

1. WARNING/IDENTIFICATION TAPE SHALL BE 6-INCH WIDE, BLUE IN COLOR AND MARKED "CAUTION WATER LINE BELOW".
2. TRACER WIRE SHALL BE COPPERHEAD HIGH STRENGTH CCS TRACER WIRE 1030B-HS (BLUE) WITH COPPERHEAD SNAKEBITE LOCKING CONNECTOR LSC1030C OR APPROVED EQUAL SEE SECTION 2-02.05.
3. TRACER WIRE SHALL BE SECURED TO THE PIPE AT 10-FOOT INTERVALS WITH PLASTIC ADHESIVE TAPE, DUCT TAPE OR PLASTIC TIE STRAPS PER SECTION 2-02.05. THE WIRE SHALL RUN CONTINUOUSLY ALONG THE TOP OF PIPE FOR THE ENTIRE LENGTH OF PIPE AND CONTINUOUSLY BETWEEN HYDRANT CONNECTIONS, EXCEPT WHEN USING CONNECTORS.
4. ACCESS BOX SHALL BE INSTALLED WITHIN THE CONCRETE PAD OF ALL EXISTING AND NEW FIRE HYDRANTS UNLESS OTHERWISE NOTED ON PLANS REPLACE EXISTING CONCRETE PAD TO NEAREST JOINT AS REQUIRED FOR BOX INSTALLATION ADDITIONAL ACCESS BOXES MAY BE REQUIRED BY THE UTILITY.
5. SUFFICIENT SLACK SHALL BE LEFT IN LEADS NEAR CONNECTIONS TO PIPE TO PREVENT BREAKAGE OF CONNECTION DURING BACKFILLING.
6. UPON INSTALLATION, TESTING SHALL BE CONDUCTED IN THE PRESENCE OF THE WATER UTILITY INSPECTOR AND A REPORT INDICATING POSITIVE TRACING PERFORMANCE FOR EACH SECTION OF THE SYSTEM SHALL BE SUBMITTED TO THE CITY.
7. IF GROUNDING IS REQUIRED ON PLANS, USE COPPERHEAD SNAKEPIT ACCESS POINT CD14B2T-SW (BLUE WITH TWO-TERMINAL SWITCHABLE LID) AND 1 5 LB MAGNESIUM GROUND ROD WITH 12-AWG CCS WIRE (COPPERHEAD ANO-12 OR APPROVED EQUAL) AT EACH ACCESS POINT LID DRIVE GROUND ROD INTO SOIL BENEATH ACCESS POINT AND CONNECT WIRE TO GROUND ROD TERMINAL ON ACCESS POINT LID WITH 1 FOOT OF EXCESS/SLACK WIRE.

WARNING IDENTIFICATION TAPE AND TRACER WIRE INSTALLATION FOR PVC OR PVCO PIPE

CITY OF MONTEREY PARK
PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-609

DRAWN	BY AM	DATE 10/02/24
REVISED	DZ	10/02/24
CHANGED	XX	XX/XX/XX

APPROVED
WATER UTILITY MANAGER

[Signature]

DATE


12/10/24

APPROVED
CITY ENGINEER

DATE

12/11/24

SHEET 1 OF 1

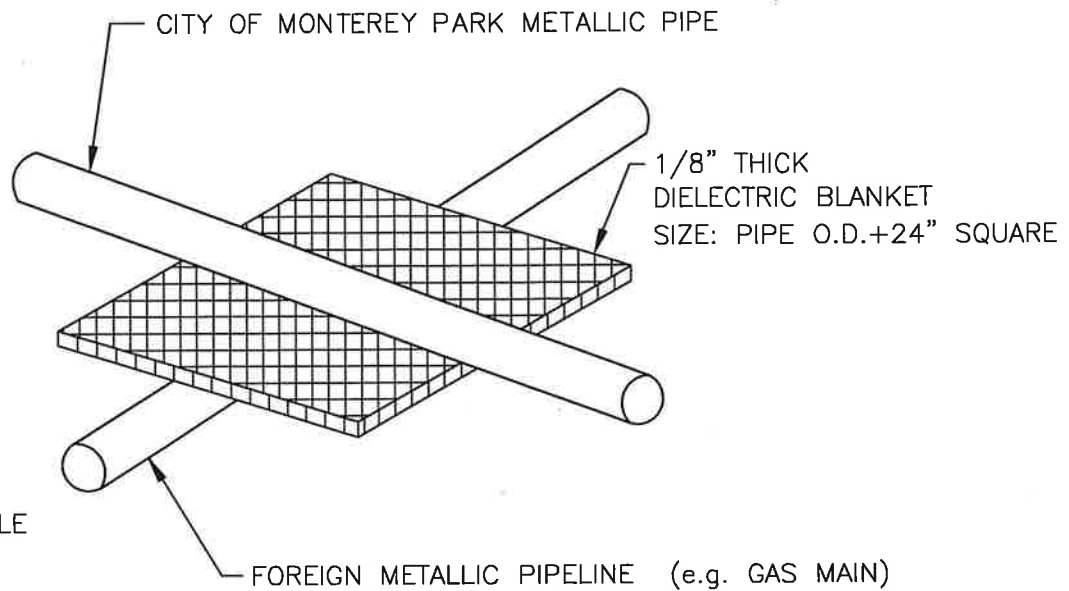

NOTES:

1. INSTALL INSULATING BLANKET BETWEEN METALLIC PIPELINES WHEN THE DISTANCE SEPARATING THE PIPE LINES IS 12" OR LESS.
2. MAKE SURE BLANKET IS FLAT ON SOIL BACKFILL AND CENTERED BETWEEN THE PIPES.
3. BLANKET SHALL BE SQUARE AND MIN. 12" LARGER THAN THE DIAMETER OF THE LARGEST PIPELINE INVOLVED.
4. APPROVED MANUFACTURER: NEOPRENE BLENDED SHEET, STYLE NO.10 SMOOTH FINISH BY BILTRITE, OR APPROVED EQUAL.

INSULATING BLANKET

CITY OF MONTEREY PARK


PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-610

DRAWN	BY AM	DATE 10/02/24	APPROVED WATER UTILITY MANAGER	<i>[Signature]</i>	DATE	12/10/24
REVISED	DZ	10/02/24	APPROVED CITY ENGINEER	<i>[Signature]</i>	DATE	12/11/24
CHANGED	XX	XX/XX/XX				

SHEET 1 OF 1

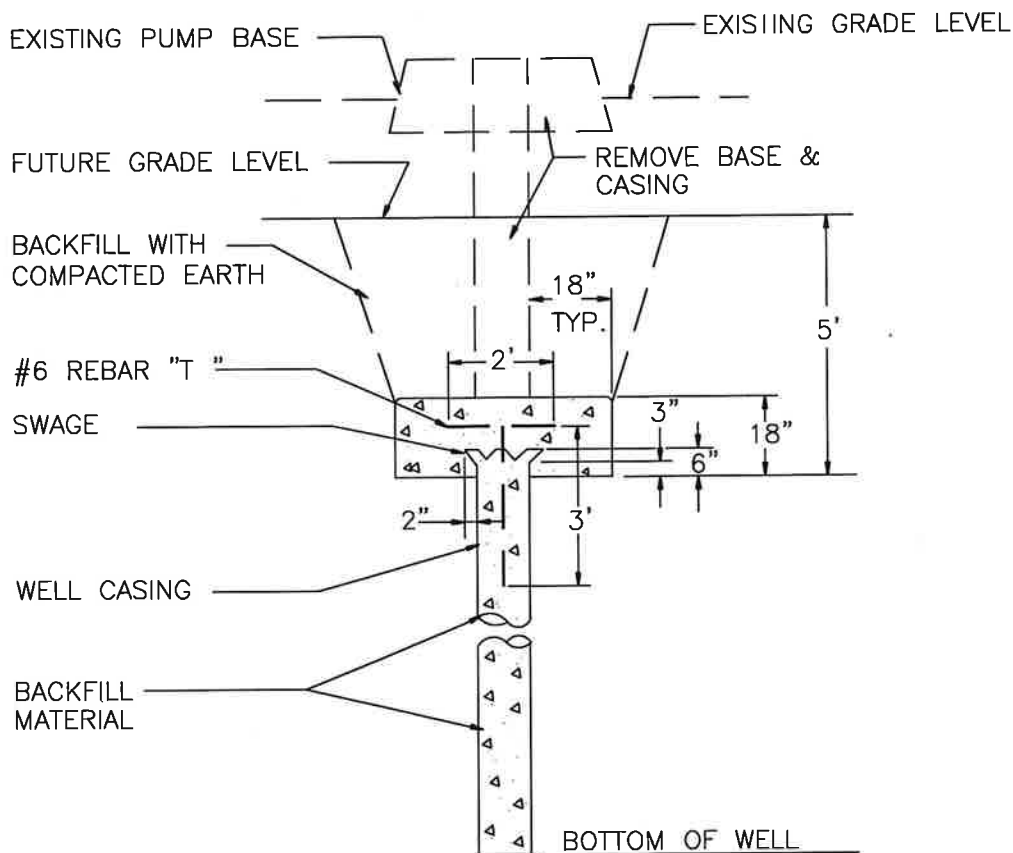

REFERENCES:

1. STATE OF CALIFORNIA, DEPT. OF WATER RESOURCES BULLETIN 74. "WATER WELL STANDARDS"
2. CITY OF MONTEREY PARK MUNICIPAL CODE

NOTES:

1. ALL WORK SHALL BE DONE UNDER PERMIT ISSUED BY THE UTILITIES DIRECTOR AND SUBJECT TO HIS INSPECTION.
2. CASTING TO BE PERFORATED, IF NECESSARY, TO INSURE BACKFILLING OF ANNULAR SPACE OUTSIDE OF CASING.
3. BACKFILL MATERIAL TO BE INTRODUCED UNDER PRESSURE TO CLOSE ALL VOIDS IN GRAVEL PACKED WELLS.
4. ACCEPTABLE BACKFILL MATERIAL TO BE:
 - A. NEAT CEMENT: 5-7 GAL PER SACK
 - B. CEMENT GROUT: 5-57 GAL PER SACK, 2 PARTS SAND/1 PART CEMENT
 - C. CONCRETE: CLASS B, 5 SACK/CU. YARD
 - D. BENTONITE (UP TO 5 PERCENT BY WIEGHT OF CEMENT) OR SIMILAR WORKABILITY AGENTS MAY BE USED.

DESTRUCTION OF ABANDONED WATER WELLS

CITY OF MONTEREY PARK

PUBLIC WORKS DEPARTMENT - WATER DIVISION

STANDARD NO.

W-630

DRAWN	BY AM	DATE 10/02/24	APPROVED WATER UTILITY MANAGER	DATE 12/10/24
REVISD	DZ	10/02/24		
CHANGED	XX	XX/XX/XX	APPROVED CITY ENGINEER	DATE 12/11/24

SHEET 1 OF 1